

OIL ANALYSIS REPORT

Area [43806484] 9493

Component **Diesel Engine**

DIESEL ENGINE OIL SAE 10W30 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.




			Dec2023	Mar2024		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0853475	WC0853294	
Sample Date		Client Info		15 Mar 2024	02 Dec 2023	
Machine Age	kms	Client Info		671539	642494	
Oil Age	kms	Client Info		0	0	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				NORMAL	ABNORMAL	
CONTAMINATION	N	method	limit/base	current	history1	history2
Fuel		WC Method	>3.0	<1.0	<1.0	
Water		WC Method	>0.2	NEG	NEG	
Glycol		WC Method		NEG	0.0	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>90	18	72	
Chromium	ppm	ASTM D5185(m)	>20	<1	2	
Nickel	ppm	ASTM D5185(m)	>2	<1	<1	
Titanium	ppm	ASTM D5185(m)	>2	0	0	
Silver	ppm	ASTM D5185(m)	>2	0	<1	
Aluminum	ppm	ASTM D5185(m)	>20	2	10	
Lead	ppm	ASTM D5185(m)	>40	3	1	
Copper	ppm	ASTM D5185(m)	>330	2	31	
Tin	ppm	ASTM D5185(m)	>15	<1	<1	
Antimony	ppm	ASTM D5185(m)		0	0	
Vanadium	ppm	ASTM D5185(m)		0	0	
Beryllium	ppm	ASTM D5185(m)		0	0	
Derymum						
Cadmium	ppm	ASTM D5185(m)		0	0	


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	53	25	
Barium	ppm	ASTM D5185(m)	10	0	3	
Molybdenum	ppm	ASTM D5185(m)	100	2	50	
Manganese	ppm	ASTM D5185(m)		0	8	
Magnesium	ppm	ASTM D5185(m)	450	666	810	
Calcium	ppm	ASTM D5185(m)	3000	1449	1252	
Phosphorus	ppm	ASTM D5185(m)	1150	732	665	
Zinc	ppm	ASTM D5185(m)	1350	814	844	
Sulfur	ppm	ASTM D5185(m)	4250	2670	1956	
Lithium	ppm	ASTM D5185(m)		<1	<1	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	4	A 29	
Sodium	ppm	ASTM D5185(m)		2	12	
Potassium	ppm	ASTM D5185(m)	>20	4	37	
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>6	0.2	0.1	
Nitration	Abs/cm	ASTM D7624*	>20	11.0	10.9	
Sulfation	Abs/.1mm	ASTM D7415*	>30	23.3	22.4	





OIL ANALYSIS REPORT



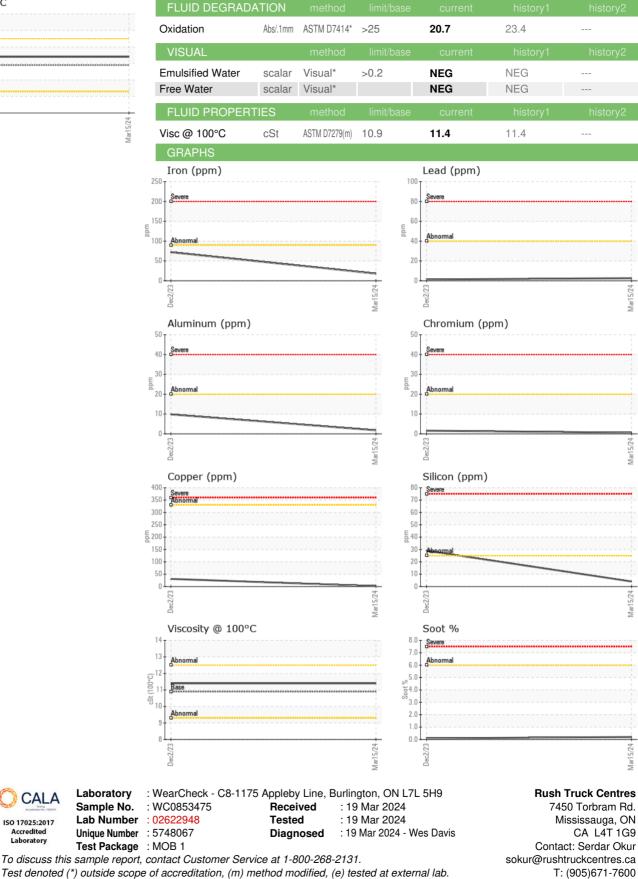

Validity of results and interpretation are based on the sample and information as supplied.

Contact/Location: Serdar Okur - RUSMIS Page 2 of 2

F:

CALA

ISO 17025:2017 Accredited

Laboratory