




PROBLEM SUMMARY

Area
BRUCE B/0B/54600
 Machine Id
0B-54600-SG8-TK2 Pwr Turbine
 Component
Turbine
 Fluid
MOBIL SHC 825 (--- GAL)

Sample Rating Trend

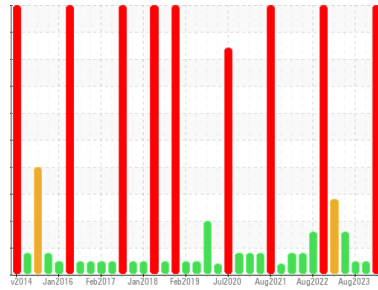


CONTAMINANT




COMPONENT CONDITION SUMMARY

▲ Water Separability

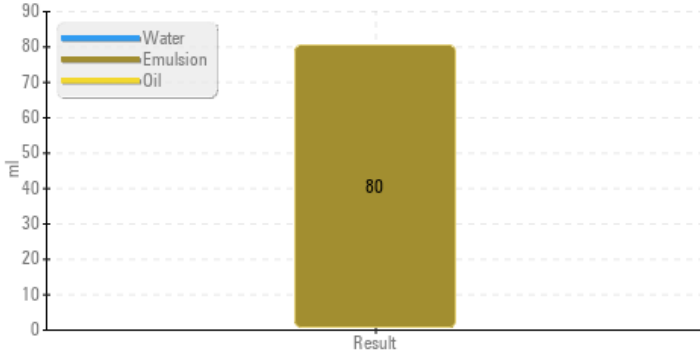

▲ Varnish Potential

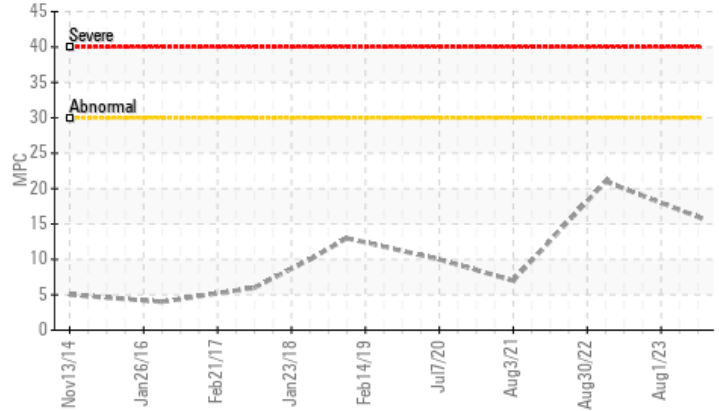

RECOMMENDATION

We recommend an early resample to monitor this condition. No other corrective action is recommended at this time. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Diagnostician's Note: This oil product has poor water shedding properties. Ensure that moisture levels remain low.

PROBLEMATIC TEST RESULTS

Sample Status	SEVERE	NORMAL	NORMAL
MPC Varnish Potential	▲ 16	---	---
Separability	▲ 0/0/80 (30)	---	---

Customer Id: BRUTIV
 Sample No.: WC0756835
 Lab Number: 02623039
 Test Package: AOM 3



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Bill Quesnel CLS, OMA II, MLA-III, LLA-I +1
 (289)291-4641 x4641
Bill.Quesnel@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

HISTORICAL DIAGNOSIS

28 Nov 2023 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



01 Aug 2023 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. NOTE: An increase in the particle count is noted. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Jun 2023 Diag: Kevin Marson

DIRT



Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

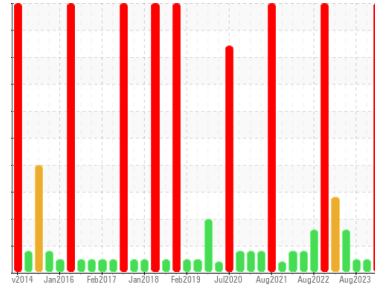

CONTAMINANT



Area
BRUCE B/0B/54600
 Machine Id
0B-54600-SG8-TK2 Pwr Turbine
 Component
Turbine
 Fluid
MOBIL SHC 825 (--- GAL)

DIAGNOSIS

Recommendation

We recommend an early resample to monitor this condition. No other corrective action is recommended at this time. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Diagnostician's Note: This oil product has poor water shedding properties. Ensure that moisture levels remain low.

Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

Contaminants

MPC (Membrane Patch Colorimetry) test indicates a light concentration of varnish present. Water Separability results (ASTM D1401) are poor and indicate that the oil will form emulsions with water. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible.

Oil Condition

Rust Prevention test (ASTM D665) indicates the oil retains good anti-corrosion properties. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0756835	WC0677279	WC0642782
Sample Date	Client Info	12 Mar 2024	28 Nov 2023	01 Aug 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		SEVERE	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
PQ	ASTM D8184*	0	---	---	
Iron	ppm	ASTM D5185(m) >3	<1	<1	<1
Chromium	ppm	ASTM D5185(m) >1	0	0	0
Nickel	ppm	ASTM D5185(m) >1	0	<1	<1
Titanium	ppm	ASTM D5185(m) >1	0	0	0
Silver	ppm	ASTM D5185(m) >2	0	<1	0
Aluminum	ppm	ASTM D5185(m) >1	<1	<1	<1
Lead	ppm	ASTM D5185(m) >2	<1	<1	<1
Copper	ppm	ASTM D5185(m) >1	0	<1	<1
Tin	ppm	ASTM D5185(m) >1	0	0	0
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m) 0	<1	<1	<1
Barium	ppm	ASTM D5185(m) 0	0	<1	0
Molybdenum	ppm	ASTM D5185(m) 0	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m) 0	<1	0	0
Calcium	ppm	ASTM D5185(m) 0	<1	<1	<1
Phosphorus	ppm	ASTM D5185(m) 1200	1213	1167	1209
Zinc	ppm	ASTM D5185(m) 0	<1	<1	2
Sulfur	ppm	ASTM D5185(m) 0	0	9	7
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >5	1	3	1
Sodium	ppm	ASTM D5185(m) >5	0	<1	<1
Potassium	ppm	ASTM D5185(m) >20	<1	<1	<1
Water	%	ASTM D6304* >0.005	0.003	0.004	0.002
ppm Water	ppm	ASTM D6304* >50	30	41	21.8


INFRA-RED

method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*	0	---	---
Nitration	Abs/cm	ASTM D7624*	3.9	---	---
Sulfation	Abs/.1mm	ASTM D7415*	23.1	---	---




OIL ANALYSIS REPORT


Water Separability

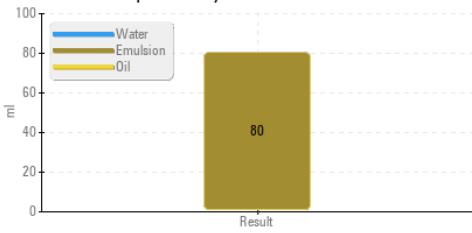


Varnish Potential

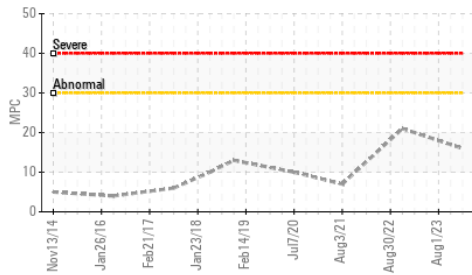


RPVOT

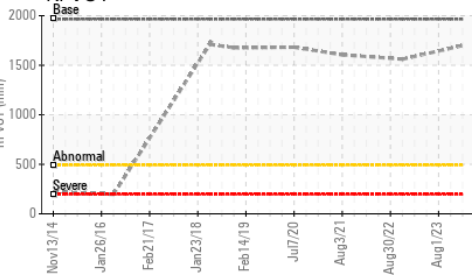

Remaining Life (RULER)

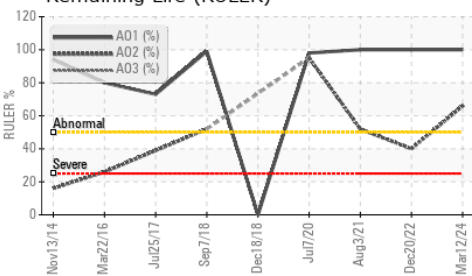

Foaming SEQ I/II/III

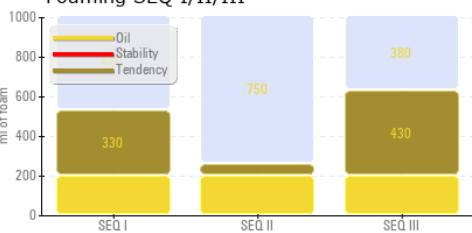

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	2990	777	4281
Particles >6µm	ASTM D7647	>1300	490	200	1122
Particles >14µm	ASTM D7647	>320	17	9	80
Particles >21µm	ASTM D7647	>80	5	2	14
Particles >38µm	ASTM D7647	>20	1	0	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/15	19/16/11	17/15/10	19/17/13


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm ASTM D7414*		28.5	---	---
Acid Number (AN)	mg KOH/g ASTM D974*	0.5	0.18	0.14	0.15
Anti-Oxidant 1	% ASTM D6971*	<25	100	---	---
Anti-Oxidant 2	% ASTM D6971*	<25	66	---	---
MPC Varnish Potential	Scale ASTM D7843(m)*	>15	▲ 16	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	VLITE	VLITE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>0.005	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	44	44.3	44.0	44.2
Visc @ 100°C	cSt ASTM D7279(m)	7.9	7.6	7.6	---
Viscosity Index (VI)	Scale ASTM D2270*	145	139	140	---
Separability	oil/h ₂ o/em ASTM D1401*	42/38/0	▲ 0/0/80 (30)	---	---
Air Release Time	min ASTM D3427*	4.8	6.20	---	---
Foam Tendency	I/II/III ASTM D892*	25	330/60/430	---	---
Foam Stability	I/II/III ASTM D892*	0	0/0/0	---	---
ASTM Color	scalar ASTM D1500*	0.5	2.0	---	---
Rust Prevention	PASS/FAIL ASTM D665*	PASS	PASS	---	---
Oxidation Test (RPVOT)	minutes ASTM D2272*	1965	1699	---	---

SEDIMENT	method	limit/base	current	history1	history2
Pentane Insolubles	% ASTM D893(m)*		0.258	---	---
Toluene Insolubles	% ASTM D893(m)*		0.004	---	---

SAMPLE IMAGES

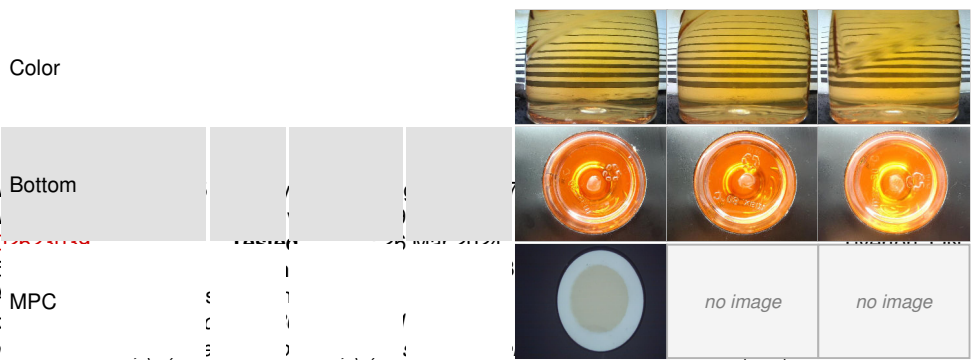

Laboratory Sample No. : \

Lab Number : ()

Unique Number : 5

Test Package : / MPC

To discuss this sample report, call ()

Test denoted (*) outside scope of ()

Validity of results and interpretation are based on the sample and information as supplied.



FERROGRAPHY REPORT

Area
BRUCE B/0B/54600
 Machine Id
0B-54600-SG8-TK2 Pwr Turbine
 Component
Turbine
 Fluid
MOBIL SHC 825 (--- GAL)


Magn: 200x Illum: BC



Magn: 50x Illum: RW



Magn: 100x Illum: RW

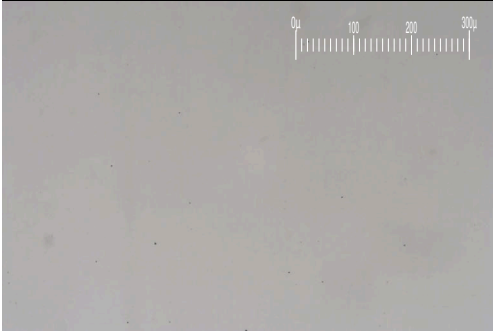

DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		1.2	---	---
Small Particles		DR-Ferr*		0.9	---	---
Total Particles		DR-Ferr*	>---	2.1	---	---
Large Particles Percentage	%	DR-Ferr*		14.3	---	---
Severity Index		DR-Ferr*		0	---	---

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		2		
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		1		
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1		
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1		

WEAR

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

