


FUEL REPORT

Sample Rating Trend

DIRT

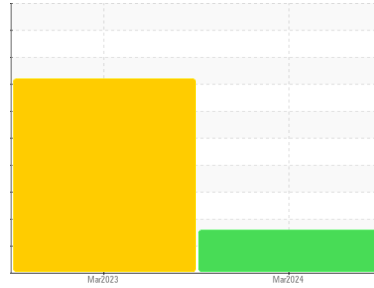

Area
[270634]
Machine Id
GD10689

Component
Diesel Fuel
Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

▲ Recommendation

Nous vous recommandons de vérifier tous les endroits par lesquels des contaminants peuvent pénétrer dans le système. Nous vous recommandons d'échantillonner de nouveau dès que possible afin de contrôler la situation.

▲ Contaminants

La teneur en eau est négligeable.

Fuel Condition

Le niveau de silicone est supérieur à la normale; ceci provient de la composition chimique de le carburant et non d'une infiltration de saleté. le carburant peut encore servir si la contamination peut être réduite à un niveau acceptable.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|----------|
| Sample Number | Client Info | | | WA0019643 | GD0005912 | --- |
| Sample Date | Client Info | | | 13 Mar 2024 | 23 Mar 2023 | --- |
| Machine Age | yrs | Client Info | | 0 | 0 | --- |
| Sample Status | | | | ABNORMAL | SEVERE | --- |

| PHYSICAL PROPERTIES | | method | limit/base | current | history1 | history2 |
|----------------------------|------|----------------|------------|--------------|----------|----------|
| Specific Gravity | | ASTM D1298* | 0.839 | 0.830 | 0.834 | --- |
| Fuel Color | text | Visual Screen* | Yellow | Red | Pink | --- |
| Visc @ 40°C | cSt | ASTM D7279(m) | 3.0 | 2.4 | 2.3 | --- |
| Pensky-Martens Flash Point | °C | ASTM D7215* | 52 | 54.3 | 56.7 | --- |

| SULFUR CONTENT | | method | limit/base | current | history1 | history2 |
|----------------|-----|---------------|------------|----------|----------|----------|
| Sulfur | ppm | ASTM D5185(m) | 10 | 5 | 5 | --- |

| DISTILLATION | | method | limit/base | current | history1 | history2 |
|------------------------|----|-------------|------------|------------|----------|----------|
| Initial Boiling Point | °C | ASTM D2887* | 165 | 164 | 168 | --- |
| 5% Distillation Point | °C | ASTM D2887* | | 185 | 188 | --- |
| 10% Distill Point | °C | ASTM D2887* | 201 | 194 | 197 | --- |
| 15% Distillation Point | °C | ASTM D2887* | | 202 | 204 | --- |
| 20% Distill Point | °C | ASTM D2887* | 216 | 209 | 211 | --- |
| 30% Distill Point | °C | ASTM D2887* | 230 | 224 | 225 | --- |
| 40% Distill Point | °C | ASTM D2887* | 243 | 238 | 238 | --- |
| 50% Distill Point | °C | ASTM D2887* | 255 | 252 | 252 | --- |
| 60% Distill Point | °C | ASTM D2887* | 267 | 267 | 266 | --- |
| 70% Distill Point | °C | ASTM D2887* | 280 | 282 | 281 | --- |
| 80% Distill Point | °C | ASTM D2887* | 295 | 298 | 298 | --- |
| 85% Distillation Point | °C | ASTM D2887* | | 311 | 310 | --- |
| 90% Distill Point | °C | ASTM D2887* | 310 | 324 | 322 | --- |
| 95% Distillation Point | °C | ASTM D2887* | | 347 | 342 | --- |
| Final Boiling Point | °C | ASTM D2887* | 341 | 382 | 366 | --- |


| IGNITION QUALITY | | method | limit/base | current | history1 | history2 |
|------------------|--|-------------|------------|-----------|----------|----------|
| API Gravity | | ASTM D1298* | 37.7 | 38 | 38 | --- |
| Cetane Index | | ASTM D4737* | <40.0 | 50 | 48 | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|---------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185(m) | <1.0 | ▲ 11 | 0 | --- |
| Sodium | ppm | ASTM D5185(m) | <0.1 | <1 | <1 | --- |
| Potassium | ppm | ASTM D5185(m) | <0.1 | 0 | 0 | --- |
| Water | % | ASTM D6304* | <0.05 | 0.001 | 0.001 | --- |
| ppm Water | ppm | ASTM D6304* | <500 | 11 | 9.7 | --- |


| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-----------------|------------|----------|
| Particles >4µm | | ASTM D7647 | >2500 | 1811 | ● 4398 | --- |
| Particles >6µm | | ASTM D7647 | >1300 | 232 | ● 1143 | --- |
| Particles >14µm | | ASTM D7647 | >160 | 16 | 30 | --- |
| Particles >21µm | | ASTM D7647 | >40 | 3 | 7 | --- |
| Particles >38µm | | ASTM D7647 | >10 | 0 | 0 | --- |
| Particles >71µm | | ASTM D7647 | >3 | 0 | 0 | --- |
| Oil Cleanliness | | ISO 4406 (c) | >18/17/14 | 18/15/11 | ● 19/17/12 | --- |

FUEL REPORT


▲ Silicon (ppm)

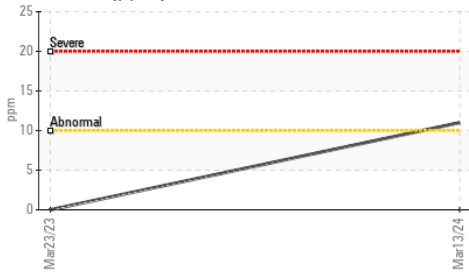


Particle Count

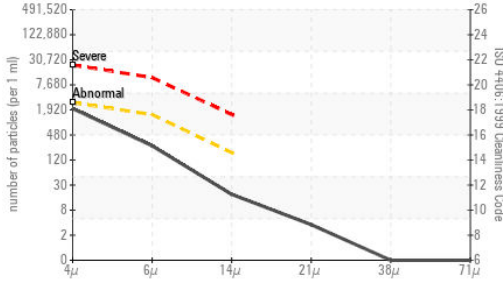


Water (KF)

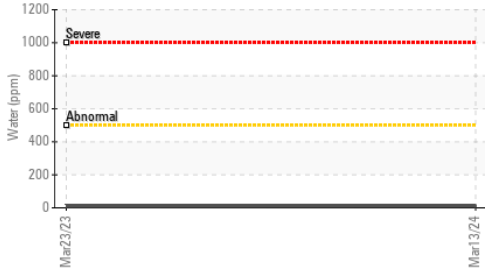

Viscosity @ 40°C

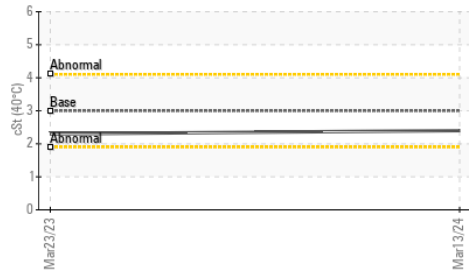

Particle Trend

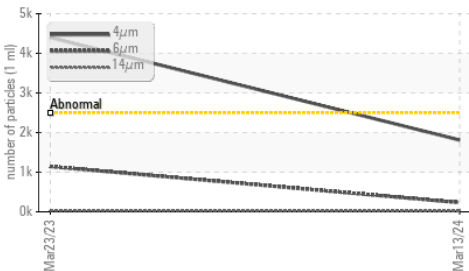


| HEAVY METALS | | method | limit/base | current | history1 | history2 |
|--------------|-----|---------------|------------|---------|----------|----------|
| Aluminum | ppm | ASTM D5185(m) | <0.1 | 0 | 0 | --- |
| Nickel | ppm | ASTM D5185(m) | <0.1 | 0 | 0 | --- |
| Lead | ppm | ASTM D5185(m) | <0.1 | <1 | ▲ 27 | --- |
| Vanadium | ppm | ASTM D5185(m) | <0.1 | 0 | 0 | --- |
| Iron | ppm | ASTM D5185(m) | <0.1 | 0 | <1 | --- |
| Calcium | ppm | ASTM D5185(m) | <0.1 | <1 | <1 | --- |
| Magnesium | ppm | ASTM D5185(m) | <0.1 | 0 | <1 | --- |
| Phosphorus | ppm | ASTM D5185(m) | <0.1 | <1 | <1 | --- |
| Zinc | ppm | ASTM D5185(m) | <0.1 | 0 | <1 | --- |

SAMPLE IMAGES


| method | limit/base | current | history1 | history2 |
|--------|------------|---------|----------|----------|
| Color | | | | |
| Bottom | | | | |

GRAPHS


Fuel Distillation Curve

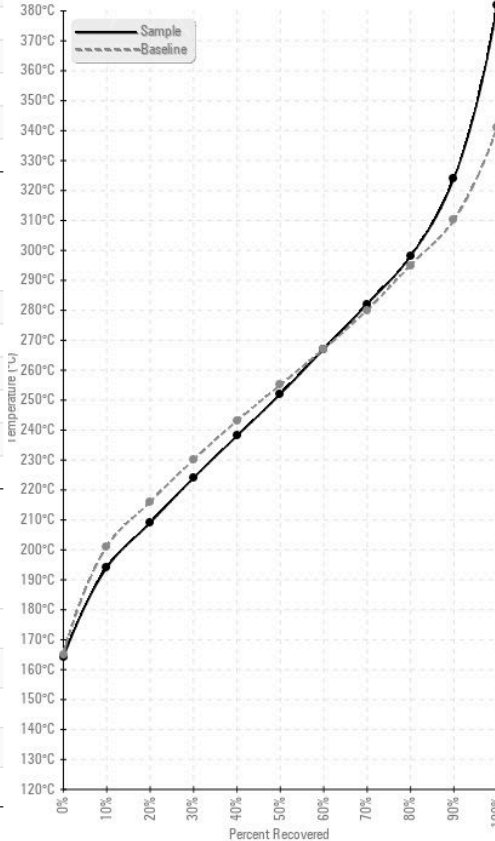

Pensky-Martens Flash Point (°C)

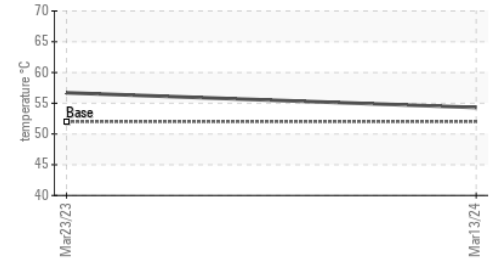

GCD Spectrum

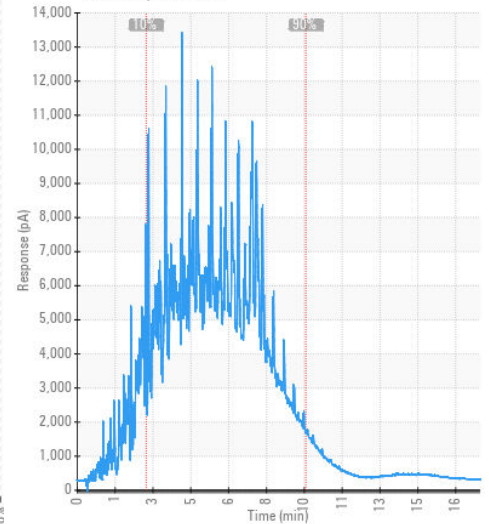

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0019643
Lab Number : 02623561
Unique Number : 5748680
Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount)

Received : 20 Mar 2024
Tested : 21 Mar 2024
Diagnosed : 22 Mar 2024 - Kevin Marson

Generatrice Drummond
 243 rue des ARTISANS
 SAINT-GERMAIN-DE-GRANTHAM, QC
 CA J0C 1K0
 Contact: Valerie Poirier
 poiirivalerie@generatricedrummond.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T: (819)398-6811
 F: (819)398-7022