


FUEL REPORT

Sample Rating Trend

NORMAL

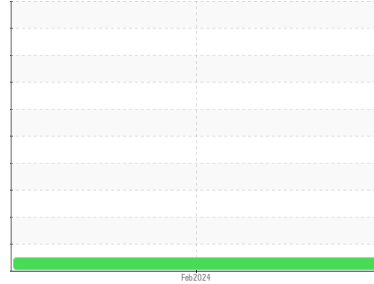

Area
[R1-23566]
Machine Id
F040656205
Component
Diesel Fuel
Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

Please contact your representative for information regarding the proper sampling kits for your service.

Contaminants

There is no indication of any contamination in the component(unconfirmed).

Fuel Condition

Not enough sample submitted to determine fuel condition and/or classification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			VPA058976	---	---
Sample Date	Client Info			17 Feb 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				NORMAL	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	2.7	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	10	3	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	6	---	---
Sodium	ppm	ASTM D5185(m)	<0.1	<1	---	---
Potassium	ppm	ASTM D5185(m)	<0.1	0	---	---



HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---	---
Iron	ppm	ASTM D5185(m)	<0.1	0	---	---
Calcium	ppm	ASTM D5185(m)	<0.1	<1	---	---
Magnesium	ppm	ASTM D5185(m)	<0.1	<1	---	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1	---	---
Zinc	ppm	ASTM D5185(m)	<0.1	<1	---	---

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

FUEL REPORT

GRAPHS

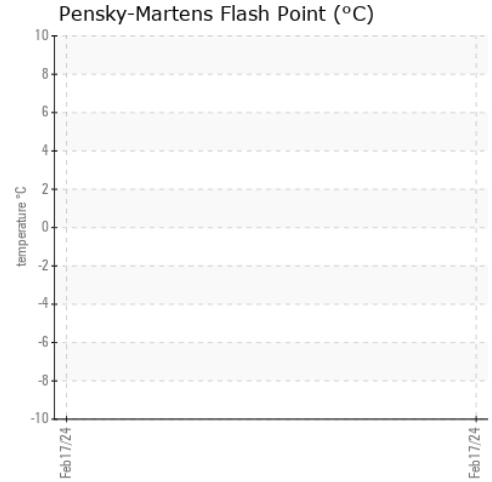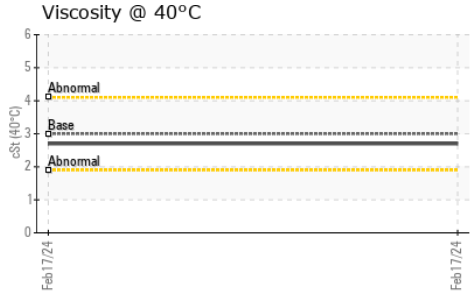

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : VPA058976
Lab Number : **02623577**
Unique Number : 5748696
Test Package : MOB 1
Received : 20 Mar 2024
Tested : 20 Mar 2024
Diagnosed : 20 Mar 2024 - Kevin Marson

CULLEN DIESEL POWER - 695335
 9300 192 ST
 SURREY, BC
 CA V4N 3R8
 Contact: Michelle Sayers
 mns@cullendiesel.com
 T: (604)888-1211
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.