




OIL ANALYSIS REPORT

Area
Gary Steacy - G02900
 Machine ID
A2403115
 Component
Transformer Oil
 Fluid
{not provided} (--- GAL)

Sample Rating Trend

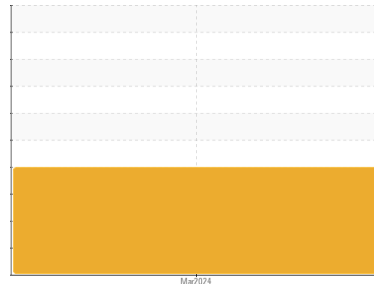

CONTAMINANT



DIAGNOSIS

▲ **Recommendation**
 The PCBs content is between 2.0 and 5.0 ppm.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Batch #	Client Info			2024 03 0360	---	---
Department	Client Info			Production	---	---
Sample From	Client Info			Machine	---	---
Production Stage	Client Info			Initial	---	---
Sent to WC	Client Info			03/18/2024	---	---
Sample Number	Client Info			E30001700	---	---
Sample Date	Client Info			15 Mar 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				ABNORMAL	---	---

CONTAMINATION	method	limit/base	current	history1	history2
Water	WC Method	>0.0035	NEG	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>125	<1	---	---
Chromium	ppm	ASTM D5185(m)		0	---	---
Nickel	ppm	ASTM D5185(m)		0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>5	0	---	---
Lead	ppm	ASTM D5185(m)	>30	0	---	---
Copper	ppm	ASTM D5185(m)	>10	<1	---	---
Tin	ppm	ASTM D5185(m)	>2	0	---	---
Antimony	ppm	ASTM D5185(m)		0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
Beryllium	ppm	ASTM D5185(m)		0	---	---
Cadmium	ppm	ASTM D5185(m)		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		0	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		0	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)		0	---	---
Calcium	ppm	ASTM D5185(m)		0	---	---
Phosphorus	ppm	ASTM D5185(m)		18	---	---
Zinc	ppm	ASTM D5185(m)		2	---	---
Sulfur	ppm	ASTM D5185(m)		837	---	---
Lithium	ppm	ASTM D5185(m)		<1	---	---



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	0	---	---
Sodium	ppm	ASTM D5185(m)		0	---	---
Potassium	ppm	ASTM D5185(m)	>20	0	---	---
PCBs	ppm	EPA 8082(e)*		▲ 2.7	---	---

OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

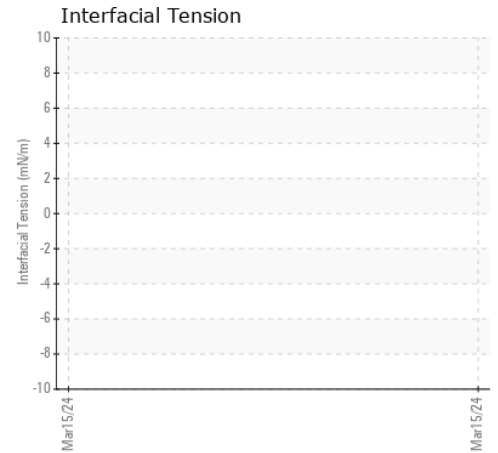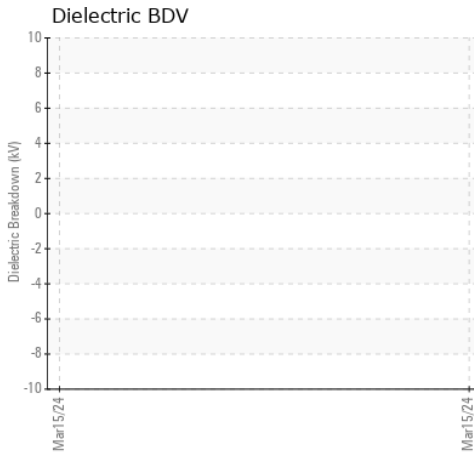

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : E30001700 **Received** : 20 Mar 2024
Lab Number : **02623587** **Tested** : 20 Mar 2024
Unique Number : 5748706 **Diagnosed** : 09 Apr 2024 - Tatiana Sorkina
Test Package : TEST (Additional Tests: ICP, PCBTransformer)

Environmental 360 Solutions Ltd.
 640 Victoria Street
 Cobourg, ON
 CA K9A 5H5
 Contact: Tatiana Sorkina
 tsorkina@e360s.ca
 T: (800)263-3939
 F: (905)373-4950

To discuss this sample report, contact Customer Service at 1-905-372-2251.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.