



OIL ANALYSIS REPORT

Sample Rating Trend

WEAR



Machine Id
SGR1

Component
Gearbox

Fluid
GEAR OIL ISO 150 (--- GAL)



DIAGNOSIS

Recommendation

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) GEAR OIL ISO 150. Please confirm. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

Iron ppm levels are noted. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The oil viscosity is higher than typical. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0909079	---	---
Sample Date	Client Info		20 Mar 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ATTENTION	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		58	---	---
Iron	ppm	ASTM D5185(m) >200	253	---	---
Chromium	ppm	ASTM D5185(m) >15	3	---	---
Nickel	ppm	ASTM D5185(m) >15	<1	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m)	0	---	---
Aluminum	ppm	ASTM D5185(m) >25	0	---	---
Lead	ppm	ASTM D5185(m) >100	0	---	---
Copper	ppm	ASTM D5185(m) >200	<1	---	---
Tin	ppm	ASTM D5185(m) >25	0	---	---
Antimony	ppm	ASTM D5185(m) >5	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES


	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 50	17	---	---
Barium	ppm	ASTM D5185(m) 15	14	---	---
Molybdenum	ppm	ASTM D5185(m) 15	0	---	---
Manganese	ppm	ASTM D5185(m)	3	---	---
Magnesium	ppm	ASTM D5185(m) 50	<1	---	---
Calcium	ppm	ASTM D5185(m) 50	15	---	---
Phosphorus	ppm	ASTM D5185(m) 350	304	---	---
Zinc	ppm	ASTM D5185(m) 100	10	---	---
Sulfur	ppm	ASTM D5185(m) 12500	12856	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	<1	---	---
Sodium	ppm	ASTM D5185(m)	2	---	---
Potassium	ppm	ASTM D5185(m) >20	1	---	---



OIL ANALYSIS REPORT

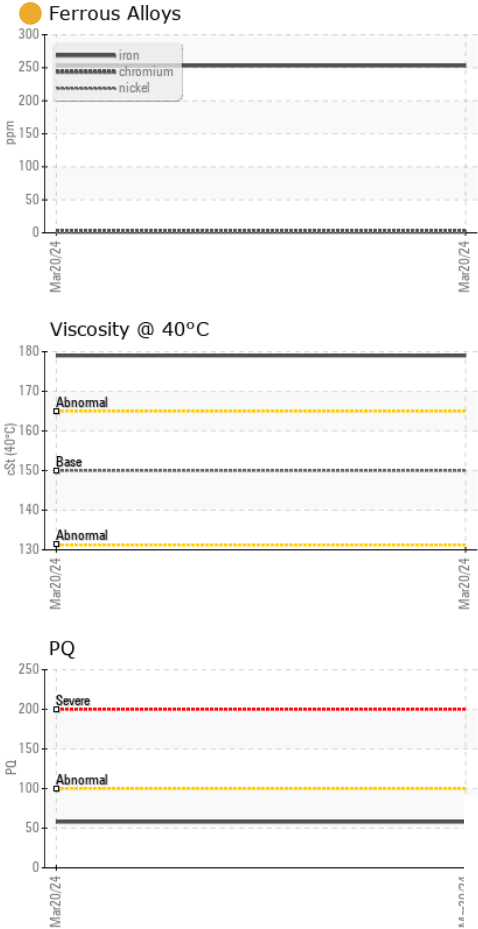



VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	150	179	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

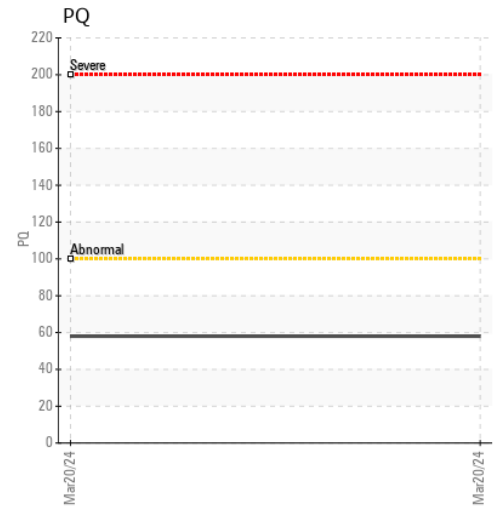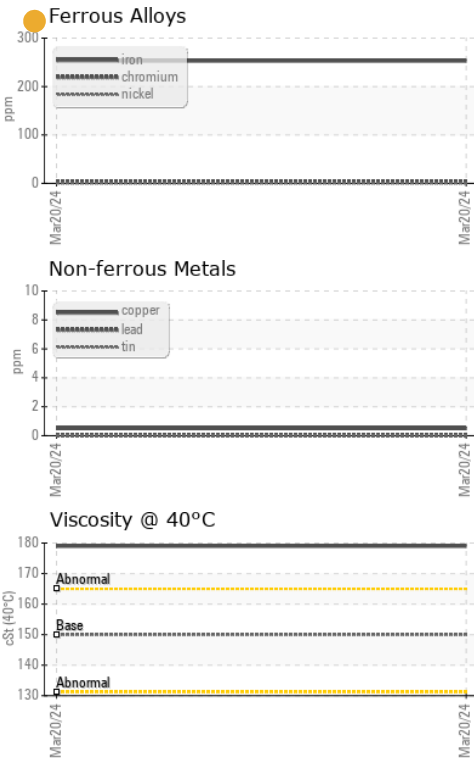

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0909079 **Received** : 21 Mar 2024
Lab Number : **02623851** **Tested** : 21 Mar 2024
Unique Number : 5748970 **Diagnosed** : 21 Mar 2024 - Kevin Marson
Test Package : IND 1 (Additional Tests: PQ)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

EMF ELECTRICAL SERVICES
 2690 SLOUGH STREET
 MISSISSAUGA, ON
 CA L4T 1G3
 Contact: Wilson
 Wilson@emfelectrical.ca
 T: (905)405-8836
 F: