




# OIL ANALYSIS REPORT

Sample Rating Trend

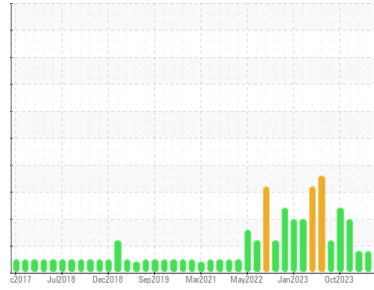

**NORMAL**



Area  
**BOF/DESULF**  
Machine Id  
**D Desulph Skimmer West**  
Component  
**Hydraulic System**  
Fluid  
**FORSYTHE NO FIRE WG 200R (130 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable. The water concentration level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0926498</b>	WC0910444	WC0901980
Sample Date	Client Info	<b>22 Mar 2024</b>	16 Feb 2024	22 Jan 2024
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	ATTENTION	ATTENTION

## WEAR METALS

method	limit/base	current	history1	history2	
PQ	ASTM D8184*	>99999	<b>5</b>	0	0
Iron	ppm	ASTM D5185(m)	>20	<b>0</b>	0
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0
Nickel	ppm	ASTM D5185(m)	>20	<b>0</b>	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0
Silver	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1
Aluminum	ppm	ASTM D5185(m)	>20	<b>0</b>	0
Lead	ppm	ASTM D5185(m)	>20	<b>0</b>	0
Copper	ppm	ASTM D5185(m)	>20	<b>0</b>	0
Tin	ppm	ASTM D5185(m)	>20	<b>0</b>	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1
Barium	ppm	ASTM D5185(m)		<b>0</b>	<1
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0
Magnesium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1
Calcium	ppm	ASTM D5185(m)		<b>0</b>	<1
Phosphorus	ppm	ASTM D5185(m)		<b>0</b>	<1
Zinc	ppm	ASTM D5185(m)		<b>0</b>	0
Sulfur	ppm	ASTM D5185(m)		<b>55</b>	56
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1

## CONTAMINANTS






method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>15	<b>&lt;1</b>	0
Sodium	ppm	ASTM D5185(m)		<b>169</b>	192
Potassium	ppm	ASTM D5185(m)	>20	<b>17</b>	15
Water	%	ASTM D6304*		<b>37.7</b>	38.6
ppm Water	ppm	ASTM D6304*	>10%	<b>377000</b>	386000

## FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	<b>3591</b>	5819	7445
Particles >6µm	ASTM D7647	>1300	<b>911</b>	1258	1137
Particles >14µm	ASTM D7647	>160	<b>126</b>	63	87
Particles >21µm	ASTM D7647	>40	<b>38</b>	19	22
Particles >38µm	ASTM D7647	>10	<b>0</b>	4	3
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	2
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>19/17/14</b>	20/17/13	20/17/14



# OIL ANALYSIS REPORT

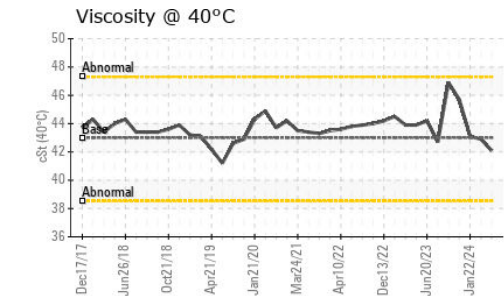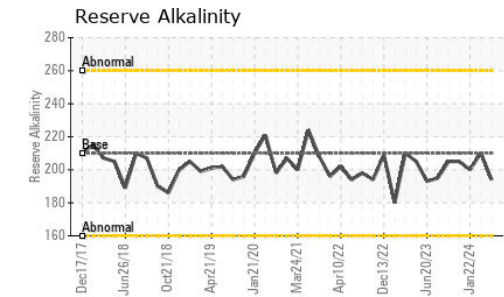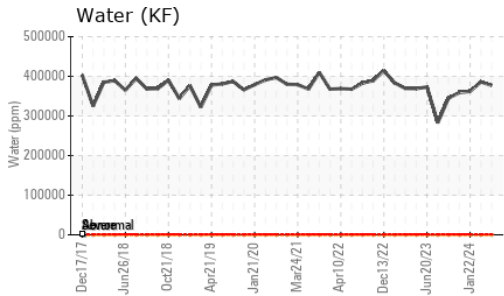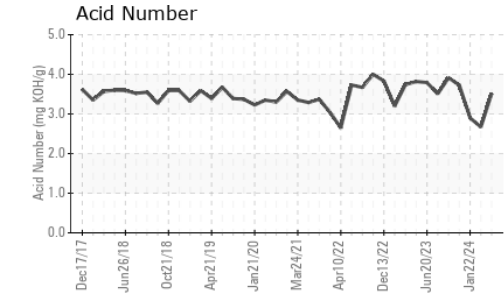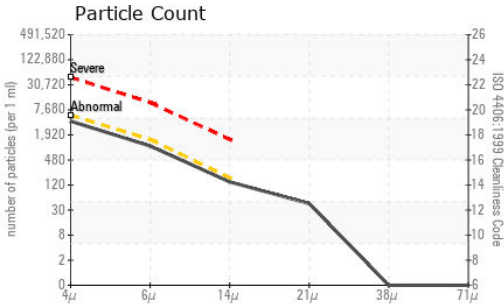

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0926498 **Received** : 22 Mar 2024  
**Lab Number** : 02624033 **Tested** : 26 Mar 2024  
**Unique Number** : 5749152 **Diagnosed** : 26 Mar 2024 - Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: KF, pH, PQ, ReserveAlk, TAN Man )

**STELCO - BOSC - Basic Oxygen Slab Caster**  
 2330 Regional Road #3, Door: BOSC8  
 NANTICOKE, ON  
 CA N0A 1L0  
 Contact: Tom Walden  
 Thomas.Walden@stelco.com  
 T: (519)587-4541  
 F: (519)587-7702

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	<b>3.51</b>	2.67	2.90
Alkiline Reserve (Oils)	ml KOH/g	ASTM D1121*	<b>194</b>	210	200

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	FRGLY	FRGLY
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	<b>NEG</b>	>10%	>10%
Free Water	scalar	Visual*	<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
pH	Scale 0-14	ASTM D1287*	<b>9.68</b>	9.72	9.46
Visc @ 40°C	cSt	ASTM D7279(m)	<b>42.1</b>	42.9	43.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

