




OIL ANALYSIS REPORT

Sample Rating Trend

DEGRADATION



Area
[GTT224-333]
 Machine Id
YORK SMYM479420
 Component
Chiller
 Fluid
YORK TYPE K (--- GAL)

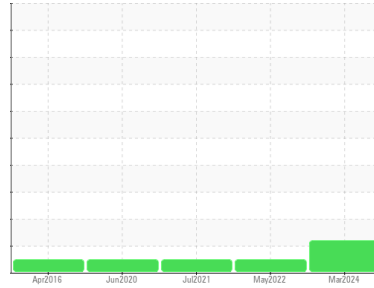

DIAGNOSIS

- Recommendation**
We recommend an early resample to monitor this condition.
- Wear**
All component wear rates are normal.
- Contamination**
The water content is negligible. There is no indication of any contamination in the oil.
- Fluid Condition**
The AN level is above the recommended limit. The oil is no longer serviceable.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GTT0001618	GTT69062	GTT69063
Sample Date	Client Info		12 Mar 2024	31 May 2022	27 Jul 2021
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	0	<1	<1
Chromium	ppm	ASTM D5185(m) >2	0	<1	<1
Nickel	ppm	ASTM D5185(m)	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >2	0	---	---
Aluminum	ppm	ASTM D5185(m) >3	0	<1	<1
Lead	ppm	ASTM D5185(m) >2	0	<1	<1
Copper	ppm	ASTM D5185(m) >8	0	<1	<1
Tin	ppm	ASTM D5185(m) >4	0	<1	<1
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	0	---	---
Barium	ppm	ASTM D5185(m) 0	0	---	---
Molybdenum	ppm	ASTM D5185(m) 0	0	---	---
Manganese	ppm	ASTM D5185(m) 0	0	---	---
Magnesium	ppm	ASTM D5185(m) 0	0	---	---
Calcium	ppm	ASTM D5185(m) 0	0	---	---
Phosphorus	ppm	ASTM D5185(m) 5	0	---	---
Zinc	ppm	ASTM D5185(m) 0	<1	<1	<1
Sulfur	ppm	ASTM D5185(m) 10	13	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<1	---	---
Sodium	ppm	ASTM D5185(m)	<1	---	---
Potassium	ppm	ASTM D5185(m) >20	<1	---	---
ppm Water	ppm	ASTM D6304* >300	128	77	164

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.03	0.18	0.057	0.093

OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	32.0	32.7	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS



Sample No. : GTT0001618
Lab Number : 02624071
Unique Number : 5749190
Test Package : IND 2 (Additional Tests: KV40)

Received : 22 Mar 2024
Tested : 26 Mar 2024
Diagnosed : 26 Mar 2024 - Bill Quesnel

Johnson Controls -Hamilton
 40 Hempstead Drive,
 Hamilton, ON
 CA L8W 2E7
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

T:
F: