




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
Core Science Building Ch #1 [GTT224-338]
 Machine Id
TRANE CAA168A(1)
 Component
Chiller
 Fluid
REFRIG COMP OIL ISO 46 (--- GAL)

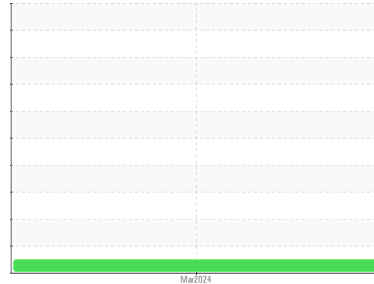

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) REFRIG COMP OIL ISO 46. Please confirm.

Wear
 All component wear rates are normal.

Contamination
 The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GTT0002249	---	---
Sample Date	Client Info		13 Mar 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed		Client Info	N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	3	---	---
Chromium	ppm	ASTM D5185(m) >2	0	---	---
Nickel	ppm	ASTM D5185(m)	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >2	0	---	---
Aluminum	ppm	ASTM D5185(m) >3	0	---	---
Lead	ppm	ASTM D5185(m) >2	0	---	---
Copper	ppm	ASTM D5185(m) >8	3	---	---
Tin	ppm	ASTM D5185(m) >4	1	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 5	0	---	---
Barium	ppm	ASTM D5185(m) 5	<1	---	---
Molybdenum	ppm	ASTM D5185(m) 5	0	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m) 5	<1	---	---
Calcium	ppm	ASTM D5185(m) 12	0	---	---
Phosphorus	ppm	ASTM D5185(m) 12	<1	---	---
Zinc	ppm	ASTM D5185(m) 12	<1	---	---
Sulfur	ppm	ASTM D5185(m) 1000	191	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	12	---	---
Sodium	ppm	ASTM D5185(m)	0	---	---
Potassium	ppm	ASTM D5185(m) >20	0	---	---
ppm Water	ppm	ASTM D6304* >100	5	---	---



FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.10	0.06	---	---


OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	46	47.5	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS



Sample No. : GTT0002249
Lab Number : 02624082
Unique Number : 5749201
Received : 22 Mar 2024
Tested : 25 Mar 2024
Diagnosed : 26 Mar 2024 - Bill Quesnel

Test Package : IND 2 (Additional Tests: KV40)
 To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

Ainsworth Electric
 131 Bermondsey Road
 Toronto, ON
 CA M4A 1X4
 Contact: Service Manager
 invoices@ainsworth.com
 T: (905)694-6302
 F: