

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
[6100268526]
Machine Id
1661001834
Component
Diesel Engine
Fluid
PETRO CANADA DURON HP 15W40 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
Metal levels are typical for a new component breaking in.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WA0021297	---	---
Sample Date	Client Info		19 Mar 2024	---	---
Machine Age	hrs	Client Info	296	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			NORMAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	---	---
Water	WC Method	>0.2	NEG	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >100	<1	---	---
Chromium	ppm	ASTM D5185(m) >20	0	---	---
Nickel	ppm	ASTM D5185(m) >4	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >3	0	---	---
Aluminum	ppm	ASTM D5185(m) >20	<1	---	---
Lead	ppm	ASTM D5185(m) >40	0	---	---
Copper	ppm	ASTM D5185(m) >330	<1	---	---
Tin	ppm	ASTM D5185(m) >15	0	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	29	---	---
Barium	ppm	ASTM D5185(m) 0	0	---	---
Molybdenum	ppm	ASTM D5185(m) 60	48	---	---
Manganese	ppm	ASTM D5185(m) 0	0	---	---
Magnesium	ppm	ASTM D5185(m) 1010	808	---	---
Calcium	ppm	ASTM D5185(m) 1070	1175	---	---
Phosphorus	ppm	ASTM D5185(m) 1150	977	---	---
Zinc	ppm	ASTM D5185(m) 1270	1137	---	---
Sulfur	ppm	ASTM D5185(m) 2060	2592	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---


CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	2	---	---
Sodium	ppm	ASTM D5185(m)	1	---	---
Potassium	ppm	ASTM D5185(m) >20	1	---	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	0	---	---
Nitration	Abs/cm	ASTM D7624* >20	4.6	---	---
Sulfation	Abs./1mm	ASTM D7415* >30	17.9	---	---

OIL ANALYSIS REPORT

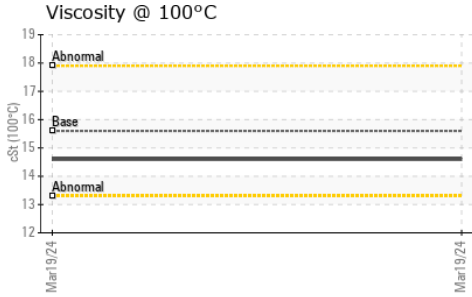

FLUID DEGRADATION

Method	Limit/Base	Current	History1	History2
Oxidation	Abs./1mm ASTM D7414*	13.3	---	---


VISUAL

Method	Limit/Base	Current	History1	History2
Emulsified Water	scalar Visual*	NEG	---	---
Free Water	scalar Visual*	NEG	---	---

FLUID PROPERTIES

Method	Limit/Base	Current	History1	History2
Visc @ 100°C	cSt ASTM D7279(m)	14.6	---	---

GRAPHS

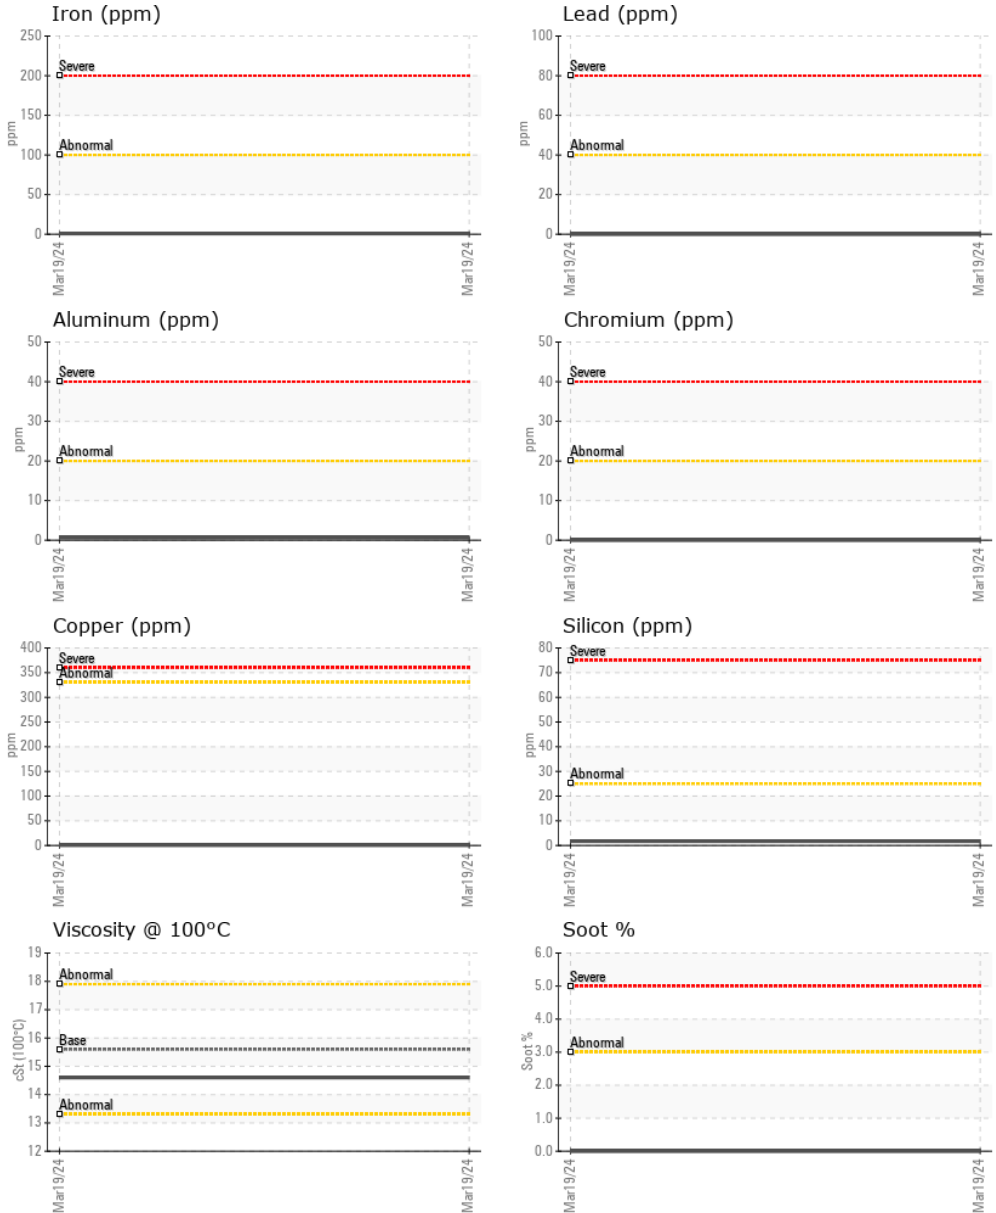

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021297
Lab Number : 02624610
Unique Number : 5749729
Test Package : MOB 1
Received : 26 Mar 2024
Tested : 26 Mar 2024
Diagnosed : 26 Mar 2024 - Wes Davis

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Holly Hinton
 hhinton@wajax.com
 T:
 F: (902)468-3325

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.