




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

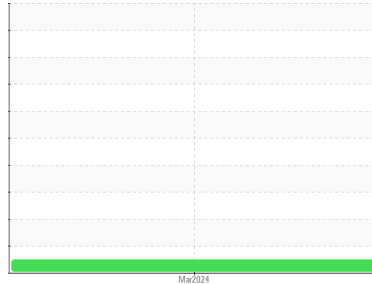

Area  
**York University - Y00300**  
 Machine Id  
**A2403158**

Component  
**Unknown Component**  
 Fluid  
**PETRO CANADA TURBOFLO XL32 (--- GAL)**

## DIAGNOSIS

### Recommendation

We certify that this oil is clean, that the additives are at acceptable levels, and that it is suitable for use.


SAMPLE INFORMATION		method	limit/base	current	history1	history2
Batch #	Client Info			<b>Mobile</b>	---	---
Department	Client Info			<b>Production</b>	---	---
Sample From	Client Info			<b>Machine</b>	---	---
Production Stage	Client Info			<b>Final</b>	---	---
Sent to WC	Client Info			<b>03/22/2024</b>	---	---
Sample Number	Client Info			<b>E30001749</b>	---	---
Sample Date	Client Info			<b>21 Mar 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)		<b>0</b>	---	---
Chromium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)		<b>0</b>	---	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m)		<b>0</b>	---	---
Lead	ppm	ASTM D5185(m)		<b>0</b>	---	---
Copper	ppm	ASTM D5185(m)		<b>2</b>	---	---
Tin	ppm	ASTM D5185(m)		<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m)		<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<b>0</b>	---	---
Barium	ppm	ASTM D5185(m)	0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)	0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m)	0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)	0	<b>0</b>	---	---
Calcium	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185(m)	5	<b>17</b>	---	---
Zinc	ppm	ASTM D5185(m)	0	<b>11</b>	---	---
Sulfur	ppm	ASTM D5185(m)	750	<b>412</b>	---	---
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)		<b>0</b>	---	---
Sodium	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	---	---
Water	%	ASTM D6304*		<b>0.002</b>	---	---
ppm Water	ppm	ASTM D6304*		<b>16</b>	---	---

# OIL ANALYSIS REPORT

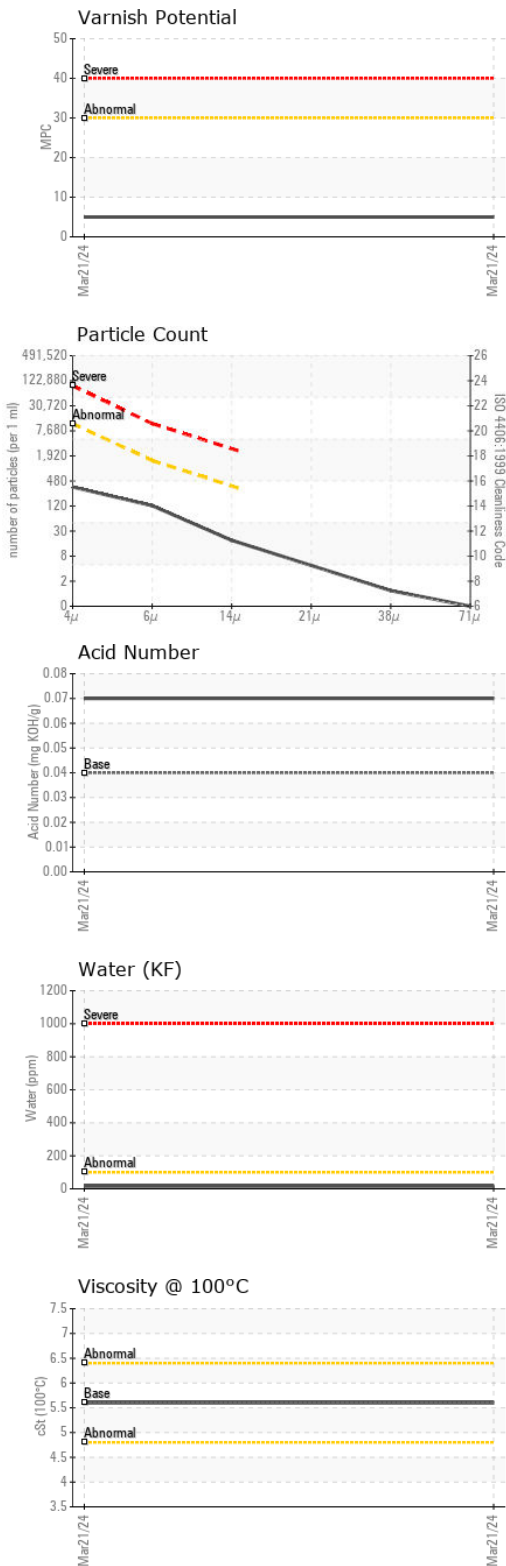

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>303</b>	---	---
Particles >6µm	ASTM D7647	>1300	<b>108</b>	---	---
Particles >14µm	ASTM D7647	>320	<b>16</b>	---	---
Particles >21µm	ASTM D7647	>80	<b>4</b>	---	---
Particles >38µm	ASTM D7647	>20	<b>1</b>	---	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/17/15	<b>15/14/11</b>	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.04	<b>0.07</b>	---
MPC Varnish Potential	Scale	ASTM D7843(m)*	>15	<b>5</b>	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---
Emulsified Water	scalar	Visual*		<b>NEG</b>	---
Free Water	scalar	Visual*		<b>NEG</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	33.86	<b>34.0</b>	---
Visc @ 100°C	cSt	ASTM D7279(m)	5.60	<b>5.6</b>	---
Viscosity Index (VI)	Scale	ASTM D2270*	101	<b>101</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image
MPC				no image	no image



**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : E30001749 **Received** : 26 Mar 2024  
**Lab Number** : **02624683** **Tested** : 27 Mar 2024  
**Unique Number** : 5749802 **Diagnosed** : 28 Mar 2024 - Tatiana Sorkina  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, MPC, PrtCount, VI )


**Environmental 360 Solutions Ltd.**  
 640 Victoria Street  
 Cobourg, ON  
 CA K9A 5H5  
 Contact: Tatiana Sorkina  
 tsorkina@e360s.ca  
 T: (800)263-3939  
 F: (905)373-4950

To discuss this sample report, contact Customer Service at 1-905-372-2251.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

MPC (Varnish Test)



Sample Color & Clarity

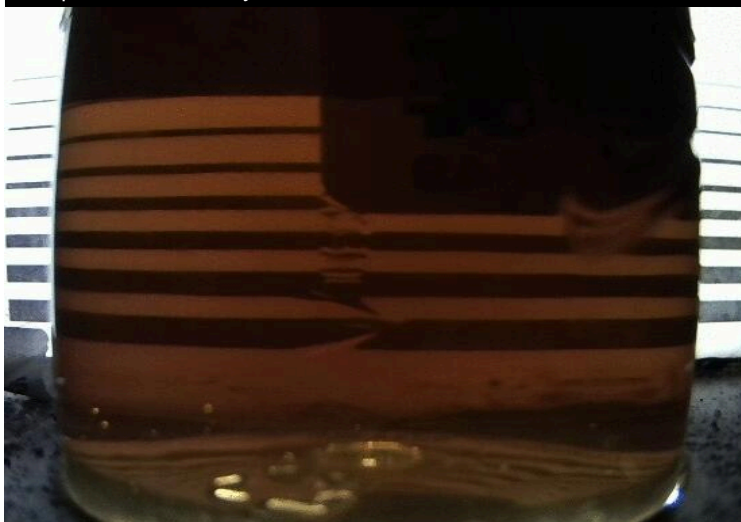

*This page left intentionally blank*