




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
{UNASSIGNED} [5290155]
 Machine Id
INGERSOLL RAND AIR COMPRESSOR UP6-50PE-125 (S/N PG4538U08277)
 Component
Air Compressor
 Fluid
SUMMIT Ultima 32 (21 LTR)

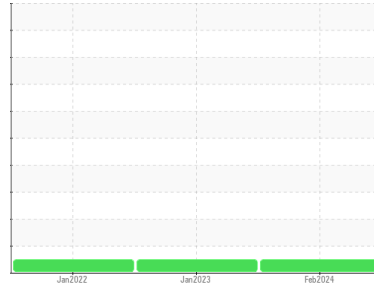

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor. (Customer Sample Comment: Fluid option not available. Running Ultima 32 in this compressor.)

Wear
 All component wear rates are normal.

Contamination
 The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0771804	WC0771797	WC0566249
Sample Date	Client Info			07 Feb 2024	30 Jan 2023	21 Jan 2022
Machine Age	hrs	Client Info		11192	10349	9282
Oil Age	hrs	Client Info		843	1694	627
Oil Changed	Client Info			Not Chngd	N/A	Not Chngd
Sample Status				NORMAL	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>70	<1	<1	1
Chromium	ppm	ASTM D5185(m)	>15	0	0	0
Nickel	ppm	ASTM D5185(m)	>6	<1	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	0
Aluminum	ppm	ASTM D5185(m)	>10	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>20	0	0	0
Copper	ppm	ASTM D5185(m)	>80	0	0	<1
Tin	ppm	ASTM D5185(m)	>15	0	0	<1
Antimony	ppm	ASTM D5185(m)		0	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	<1	<1
Barium	ppm	ASTM D5185(m)		1	<1	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		0	<1	<1
Calcium	ppm	ASTM D5185(m)		0	0	<1
Phosphorus	ppm	ASTM D5185(m)		10	18	17
Zinc	ppm	ASTM D5185(m)		3	5	4
Sulfur	ppm	ASTM D5185(m)		74	58	51
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>12	2	1	2
Sodium	ppm	ASTM D5185(m)		2	2	2
Potassium	ppm	ASTM D5185(m)	>20	0	0	<1
Water	%	ASTM D6304*	>0.1	0.016	0.026	---
ppm Water	ppm	ASTM D6304*	>1000	162	269.9	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.17	0.18	0.17




OIL ANALYSIS REPORT

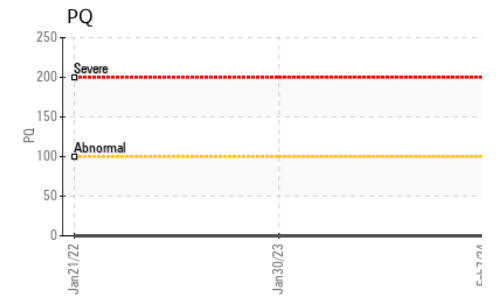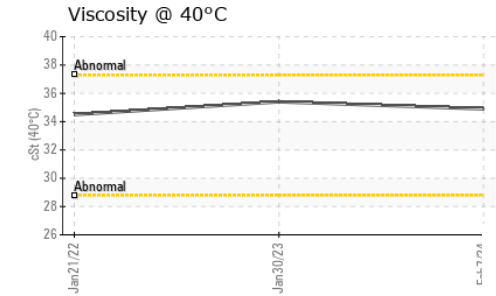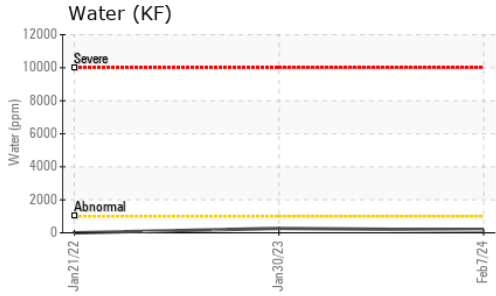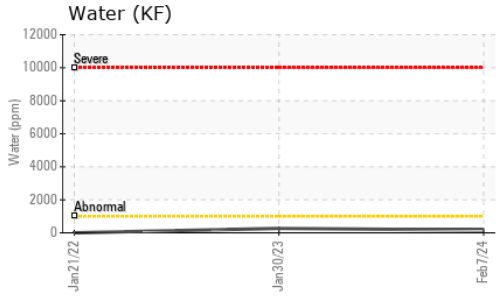






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	34.9	35.4	34.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

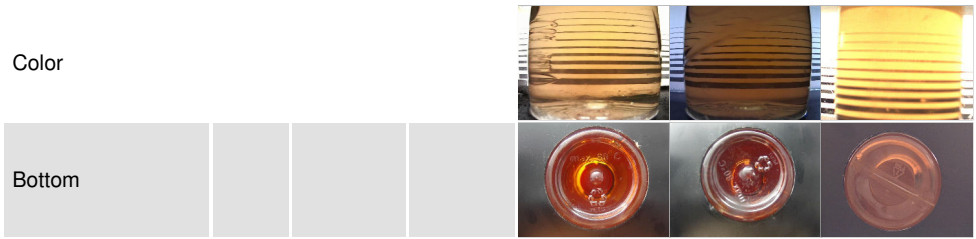

GRAPHS

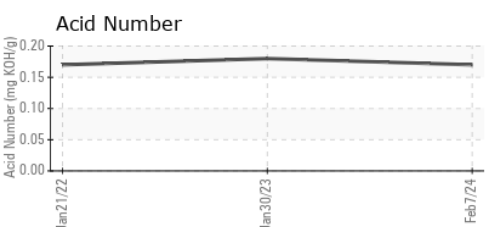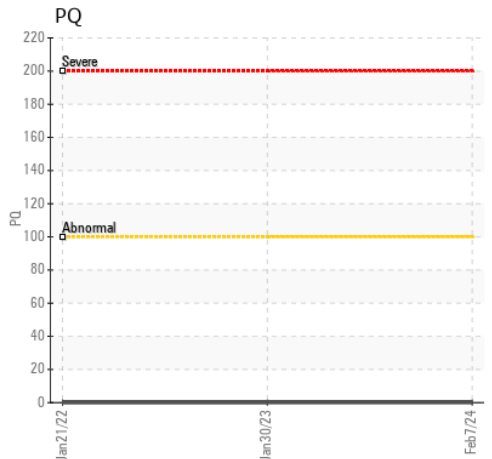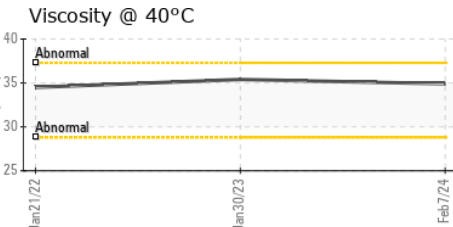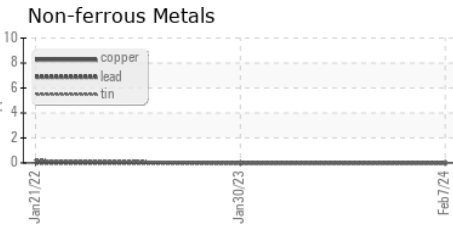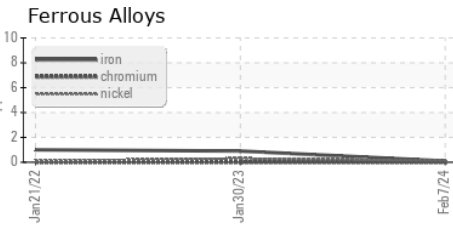

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0771804 **Received** : 26 Mar 2024
Lab Number : **02624706** **Tested** : 27 Mar 2024
Unique Number : 5749825 **Diagnosed** : 27 Mar 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: KF)

Source Atlantic
 401 Willow Street
 Truro, NS
 CA B2N 6X6
 Contact: Cory Hines
 hines.cory@sourceatlantic.ca
 T: (902)897-0787
 F: (902)897-9896

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.