

## FUEL REPORT

#### Area **PAYEUR LAURIER STATION [603897]** Machine Id **XHH300182** Component

Diesel Fuel

### No.1 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

#### DIAGNOSIS

#### A Recommendation

We recommend an early resample to monitor this condition.

#### Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. There is no indication of any contamination in the diesel fuel.

#### Fuel Condition

90% Distill Point results are abnormally high. Final Boiling Point results are abnormally high. Laboratory tests indicate that this sample does NOT meet specifications for No.1 diesel fuel, ultra-low sulfur.

Sample Date Machine Age Sample Status PHYSICAL PROP Specific Gravity Fuel Color Visc @ 40°C Pensky-Martens Flash Point SULFUR CONTER	hrs	Client Info Client Info Client Info Client Info method ASTM D1298*	limit/base	current KT0000814 21 Mar 2024 0 ABNORMAL	history1  	history2  
Machine Age Sample Status PHYSICAL PROP Specific Gravity Fuel Color Visc @ 40°C Pensky-Martens Flash Point SULFUR CONTER	ERTIES	Client Info Client Info method	limit/base	21 Mar 2024 0		
Sample Status PHYSICAL PROP Specific Gravity Fuel Color Visc @ 40°C Pensky-Martens Flash Point SULFUR CONTEI	ERTIES	Client Info	limit/base	0		
Specific Gravity Fuel Color Visc @ 40°C Pensky-Martens Flash Point	ERTIES	method	limit/base	-		
PHYSICAL PROP Specific Gravity Fuel Color Visc @ 40°C Pensky-Martens Flash Point SULFUR CONTER	text		limit/base	ABNORMAL		
Specific Gravity Fuel Color Visc @ 40°C Pensky-Martens Flash Point SULFUR CONTEI	text		limit/base			
Fuel Color Visc @ 40°C Pensky-Martens Flash Point SULFUR CONTEI		ASTM D1298*		current	history1	history2
Visc @ 40°C Pensky-Martens Flash Point SULFUR CONTEI			0.825	0.825		
Pensky-Martens Flash Point	cSt	Visual Screen*	Clear	Yllow		
SULFUR CONTEN		ASTM D7279(m)	1.8	1.9		
	°C	ASTM D7215*	38	43		
Sulfur	NT	method	limit/base	current	history1	history2
	ppm	ASTM D5185(m)	10	10		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	159	152		
5% Distillation Point	°C	ASTM D2887*		171		
10% Distill Point	°C	ASTM D2887*	184	178		
15% Distillation Point	°C	ASTM D2887*		185		
20% Distill Point	°C	ASTM D2887*	196	192		
30% Distill Point	°C	ASTM D2887*	205	204		
40% Distill Point	°C	ASTM D2887*	216	218		
50% Distill Point	°C	ASTM D2887*	227	232		
60% Distill Point	°C	ASTM D2887*	238	246		
70% Distill Point	°C	ASTM D2887*	251	260		
80% Distill Point	°C	ASTM D2887*	264	277		
85% Distillation Point	°C	ASTM D2887*	201	289		
90% Distill Point	°C	ASTM D2887*	288	▲ 300		
95% Distillation Point		ASTM D2887*	200	319		
Final Boiling Point	°C	ASTM D2887*	309	▲ 334		
	-					
	IĬ		limit/base	current	history1	history2
API Gravity		ASTM D1298* ASTM D4737*		40		
Cetane Index			<40.0	46		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	0		
Sodium	ppm	ASTM D5185(m)	<0.1	<1		
Potassium	ppm	ASTM D5185(m)	<0.1	0		
Water	%	ASTM D6304*	<0.05	0.003		
ppm Water	ppm	ASTM D6304*	<500	34		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	1602		
Particles >6µm		ASTM D7647	>640	352		
Particles >14µm		ASTM D7647	>80	26		
		ASTM D7647	>20	7		
Particles >21µm						
Particles >21μm Particles >38μm		ASTM D7647	>4	1		
		ASTM D7647 ASTM D7647		1 0		


Sample Rating Trend

**OFF SPEC** 

Contact/Location: Rick Dawson - KIOMIS



# FUEL REPORT

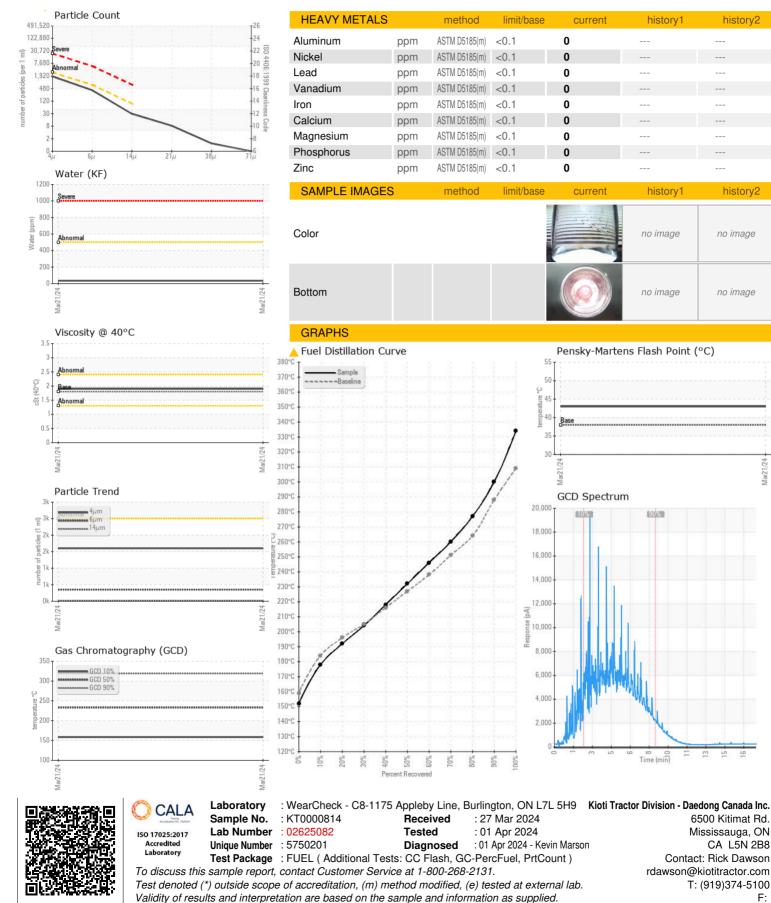

6500 Kitimat Rd. Mississauga, ON CA L5N 2B8 Contact: Rick Dawson rdawson@kiotitractor.com T: (919)374-5100 F:

Report Id: KIOMIS [WCAMIS] 02625082 (Generated: 04/01/2024 16:17:03) Rev: 1

Contact/Location: Rick Dawson - KIOMIS

Time (min)

history1

history1

no image

no image

history2

history2

no image

no image

Mar21/24