FUEL REPORT

Sample Rating Trend

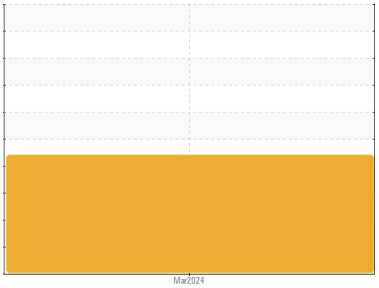

ISO

Area
[6100273825]
Machine Id
WQP-500-S7
Component
Diesel Fuel
Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

▲ Recommendation

Vérifier les scelles et/ou les filters pour des points d'entrée des contaminants. Les tests de laboratoire indiquent que ce carburant peut être utilisé et qu`il répond à toutes les exigences. Le reniflard d`air doit être réparé. S`il n`est pas classé, nous vous recommandons de le remplacer par un reniflard à air adapté au micron et / ou au dessicant. Si évalué, nous vous recommandons de réparer / remplacer le reniflard. Nous vous recommandons de filtrer ce fluide avant de l`utiliser. Nous recommandons le remplacement des filtres de ce composant. Échantillonner de nouveau dans 30 à 45 jours afin de contrôler la situation.

▲ Contaminants

Il y a une grande quantité de limon (particules de 4 à 14 microns) dans le carburant. La teneur en eau est négligeable. Le code de propreté du système est beaucoup plus haut que la limite acceptable pour votre objectif de propreté ISO 4406.

Fuel Condition

Tous les essais en laboratoire indiquent que cet échantillon satisfait aux spécifications pour le carburant diesel à ultra-faible teneur de soufre No.2 (US EPA/CGSB-3.517-3 type B). le carburant peut encore servir si la contamination peut être réduite à un niveau acceptable.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WA0020615**	---	---
Sample Date		Client Info		**22 Mar 2024**	---	---
Machine Age	hrs	Client Info		**0**	---	---
Sample Status				**SEVERE**	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*	0.839	**0.822**	---	---
Fuel Color	text	Visual Screen*	Yllow	**Red**	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	**2.1**	---	---
Pensky-Martens Flash Point	°C	ASTM D7215*	52	**51.3**	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	10	**10**	---	---

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	165	**160**	---	---
5% Distillation Point	°C	ASTM D2887*		**180**	---	---
10% Distill Point	°C	ASTM D2887*	201	**189**	---	---
15% Distillation Point	°C	ASTM D2887*		**196**	---	---
20% Distill Point	°C	ASTM D2887*	216	**203**	---	---
30% Distill Point	°C	ASTM D2887*	230	**216**	---	---
40% Distill Point	°C	ASTM D2887*	243	**230**	---	---
50% Distill Point	°C	ASTM D2887*	255	**243**	---	---
60% Distill Point	°C	ASTM D2887*	267	**257**	---	---
70% Distill Point	°C	ASTM D2887*	280	**272**	---	---
80% Distill Point	°C	ASTM D2887*	295	**287**	---	---
85% Distillation Point	°C	ASTM D2887*		**297**	---	---
90% Distill Point	°C	ASTM D2887*	310	**307**	---	---
95% Distillation Point	°C	ASTM D2887*		**325**	---	---
Final Boiling Point	°C	ASTM D2887*	341	**346**	---	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D1298*	37.7	**40**	---	---
Cetane Index		ASTM D4737*	<40.0	**51**	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	**0**	---	---
Sodium	ppm	ASTM D5185(m)	<0.1	**<1**	---	---
Potassium	ppm	ASTM D5185(m)	<0.1	**0**	---	---
Water	%	ASTM D6304*	<0.05	**0.003**	---	---
ppm Water	ppm	ASTM D6304*	<500	**34**	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	▲ **29338**	---	---
Particles >6µm		ASTM D7647	>1300	▲ **10705**	---	---
Particles >14µm		ASTM D7647	>160	▲ **454**	---	---
Particles >21µm		ASTM D7647	>40	● **69**	---	---
Particles >38µm		ASTM D7647	>10	**2**	---	---
Particles >71µm		ASTM D7647	>3	**0**	---	---
Oil Cleanliness		ISO 4406 (c)	>18/17/14	▲ **22/21/16**	---	---

FUEL REPORT

Particle Count

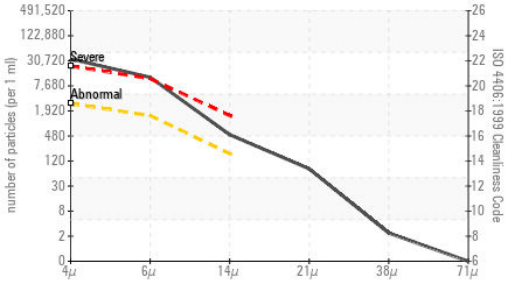

Particle Trend

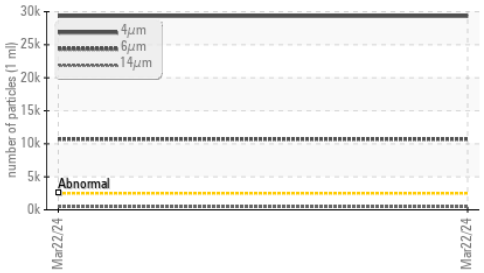

Water (KF)

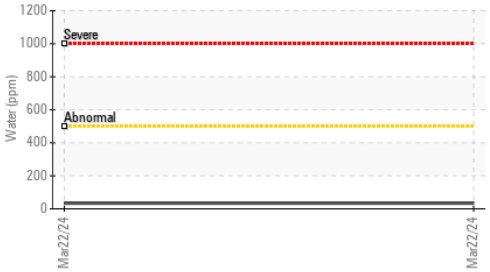

Viscosity @ 40°C

Gas Chromatography (GCD)

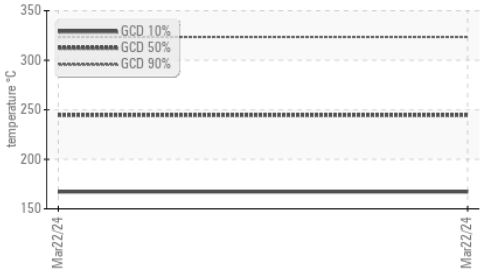

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	**0**	---	---
Nickel	ppm	ASTM D5185(m)	<0.1	**0**	---	---
Lead	ppm	ASTM D5185(m)	<0.1	**0**	---	---
Vanadium	ppm	ASTM D5185(m)	<0.1	**0**	---	---
Iron	ppm	ASTM D5185(m)	<0.1	**<1**	---	---
Calcium	ppm	ASTM D5185(m)	<0.1	**0**	---	---
Magnesium	ppm	ASTM D5185(m)	<0.1	**0**	---	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	**<1**	---	---
Zinc	ppm	ASTM D5185(m)	<0.1	**0**	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				*no image*	*no image*
Bottom				*no image*	*no image*

GRAPHS

Fuel Distillation Curve

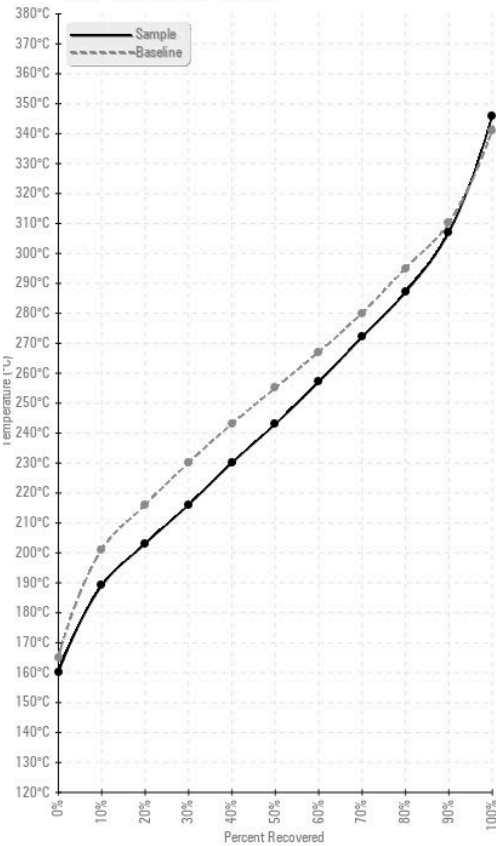

Pensky-Martens Flash Point (°C)

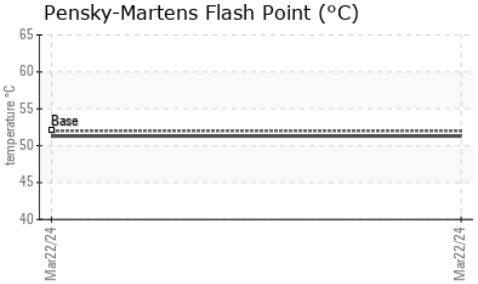

GCD Spectrum

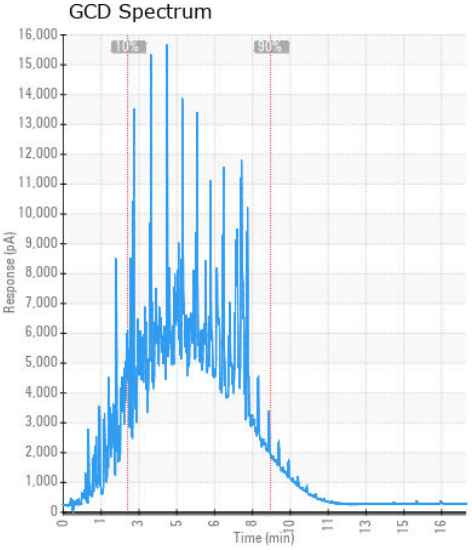

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020615 **Received** : 27 Mar 2024
Lab Number : 02625084 **Tested** : 01 Apr 2024
Unique Number : 5750203 **Diagnosed** : 01 Apr 2024 - Kevin Marson
Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

Generatrice Drummond
243 rue des ARTISANS
SAINT-GERMAIN-DE-GRANTHAM, QC
CA J0C 1K0
Contact: Valerie Poirier
poiriervalerie@generatricedrummond.com
T: (819)398-6811
F: (819)398-7022