




OIL ANALYSIS REPORT

Sample Rating Trend

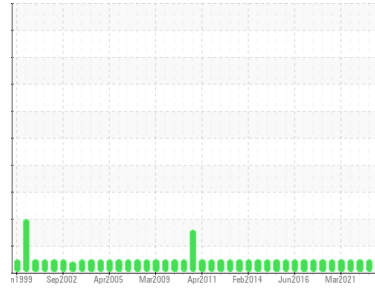

NORMAL



Machine Id
BDE - UNIT 3 GOVERNOR (S/N 59120)

Component
Hydraulic System

Fluid
PETRO CANADA TURBOFLO R&O 46 (1000 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0863077	WC0682564	WC0524863
Sample Date	Client Info		29 Feb 2024	04 Apr 2023	27 Dec 2022
Machine Age	hrs	Client Info	95208	0	0
Oil Age	hrs	Client Info	50369	0	0
Oil Changed	Client Info		N/A	Not Changd	N/A
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >20	<1	<1	<1
Chromium	ppm	ASTM D5185(m) >20	0	0	0
Nickel	ppm	ASTM D5185(m) >20	0	0	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >20	0	<1	0
Lead	ppm	ASTM D5185(m) >20	<1	<1	1
Copper	ppm	ASTM D5185(m) >20	0	0	0
Tin	ppm	ASTM D5185(m) >20	0	0	0
Antimony	ppm	ASTM D5185(m)	0	<1	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1	<1
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	0
Calcium	ppm	ASTM D5185(m) 0	0	0	0
Phosphorus	ppm	ASTM D5185(m) 3	5	5	9
Zinc	ppm	ASTM D5185(m) 0	2	3	2
Sulfur	ppm	ASTM D5185(m)	397	425	402
Lithium	ppm	ASTM D5185(m)	<1	<1	<1





CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	0	0	0
Sodium	ppm	ASTM D5185(m)	0	0	<1
Potassium	ppm	ASTM D5185(m) >20	<1	<1	<1

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	865	724	223
Particles >6µm	ASTM D7647	>1300	294	275	79
Particles >14µm	ASTM D7647	>160	39	31	11
Particles >21µm	ASTM D7647	>40	10	8	4
Particles >38µm	ASTM D7647	>10	2	0	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	17/15/12	17/15/12	15/13/11

OIL ANALYSIS REPORT

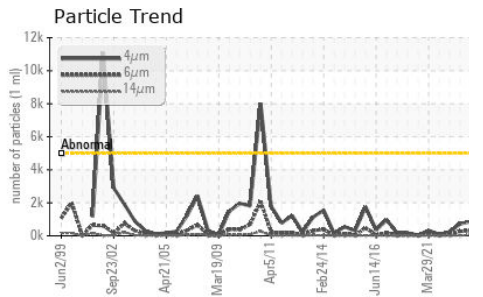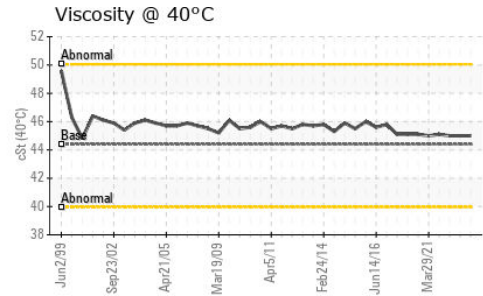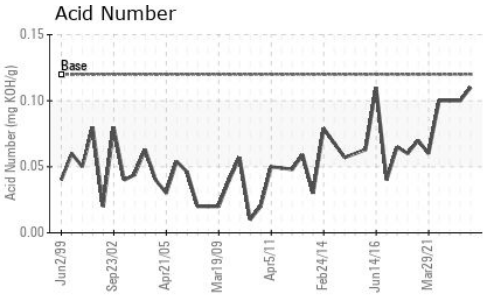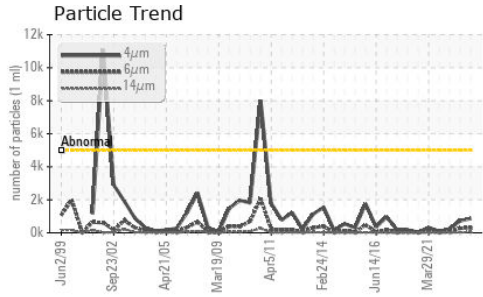


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.12	0.11	0.10	0.10






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	44.4	45.0	45.0	45.0

SAMPLE IMAGES

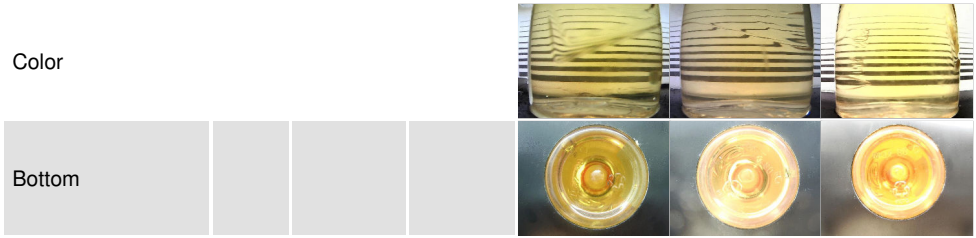

GRAPHS

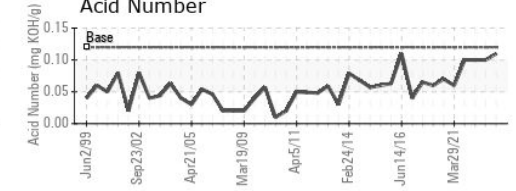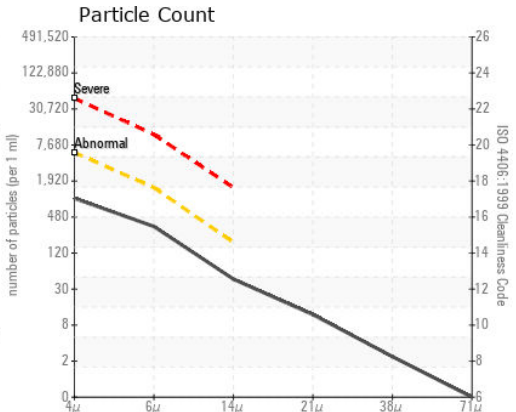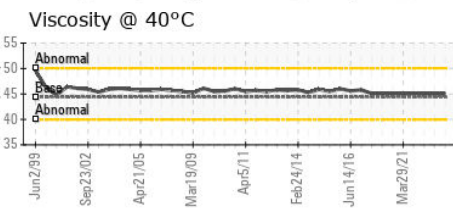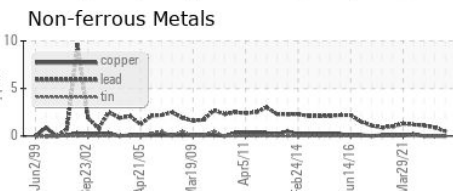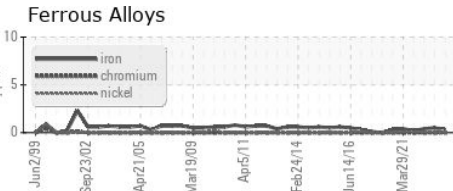

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0863077
Lab Number : **02625233**
Unique Number : 5750352
Test Package : IND 2 (Additional Tests: TAN Man)
Received : 28 Mar 2024
Tested : 01 Apr 2024
Diagnosed : 01 Apr 2024 - Wes Davis

NEWFOUNDLAND & LABRADOR HYDRO
 BAY D'ESPOIR WHSE., 1 CAMP BOGGY RD., PO BOX 100
 MILLTOWN, BAY D'ESPOIR, NL
 CA A0H 1W0
 Contact: Matthew Lambert
 matthewlambert@nlh.nl.ca
 T: (709)882-3126
 F: (709)882-3161

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.