




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

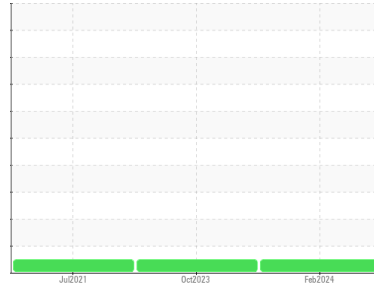

Machine Id  
**BDE PH#1 UNIT #1 GOVERNOR (S/N 371752)**

Component  
**Governor System**

Fluid  
**R&O OIL ISO 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0762266</b>	WC0762279	WC762254
Sample Date	Client Info			<b>29 Feb 2024</b>	16 Oct 2023	16 Jul 2021
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m)	>50	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>10	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185(m)	>3	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185(m)	>75	<b>2</b>	2	2
Copper	ppm	ASTM D5185(m)	>15	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>55	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185(m)	>5	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	<b>0</b>	<1	<1
Barium	ppm	ASTM D5185(m)	5	<b>&lt;1</b>	<1	<1
Molybdenum	ppm	ASTM D5185(m)	5	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	5	<b>0</b>	0	0
Calcium	ppm	ASTM D5185(m)	5	<b>0</b>	<1	<1
Phosphorus	ppm	ASTM D5185(m)	100	<b>6</b>	6	8
Zinc	ppm	ASTM D5185(m)	25	<b>1</b>	1	1
Sulfur	ppm	ASTM D5185(m)	1500	<b>942</b>	926	1144
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>8	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	<1



# OIL ANALYSIS REPORT

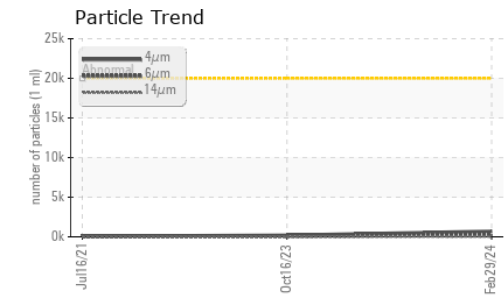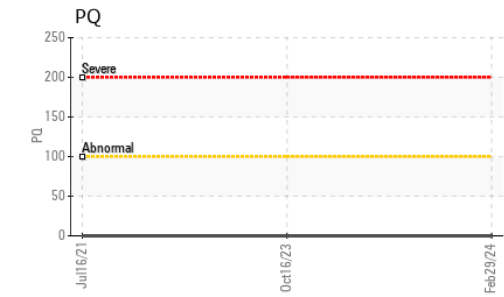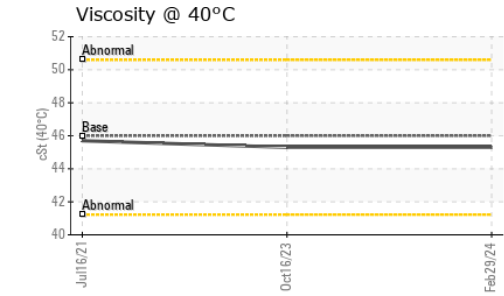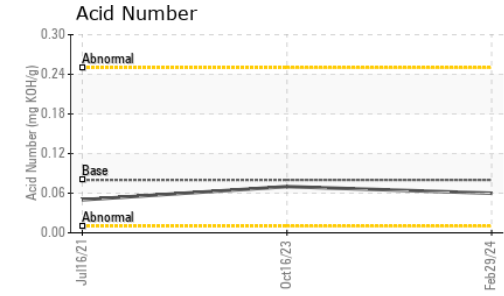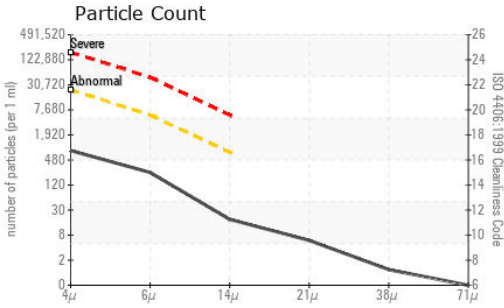

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0762266 **Received** : 28 Mar 2024  
**Lab Number** : 02625236 **Tested** : 02 Apr 2024  
**Unique Number** : 5750355 **Diagnosed** : 02 Apr 2024 - Wes Davis  
**Test Package** : IND 2 ( Additional Tests: PQ, PrtCount, TAN Man )

**NEWFOUNDLAND & LABRADOR HYDRO**  
 BAY D'ESPOIR WHSE., 1 CAMP BOGGY RD., PO BOX 100  
 MILLTOWN, BAY D'ESPOIR, NL  
 CA A0H 1W0  
 Contact: Matthew Lambert  
 matthewlambert@nlh.nl.ca  
 T: (709)882-3126  
 F: (709)882-3161

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>708</b>	201	79
Particles >6µm	ASTM D7647	>5000	<b>212</b>	65	17
Particles >14µm	ASTM D7647	>640	<b>16</b>	6	2
Particles >21µm	ASTM D7647	>160	<b>5</b>	2	0
Particles >38µm	ASTM D7647	>40	<b>1</b>	1	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	1	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>17/15/11</b>	15/13/10	13/11/9

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	0.08	<b>0.06</b>	0.07	0.05

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar Visual*	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	46	<b>45.3</b>	45.3	45.7

## SAMPLE IMAGES

