




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

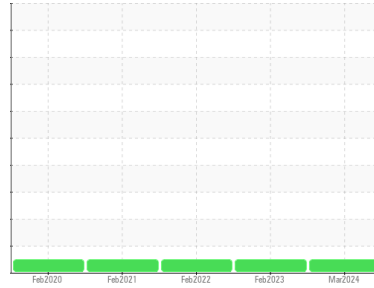

Machine Id
5795 YONGE

Component
Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0910609	WC0783836	WC0647858
Sample Date	Client Info			18 Mar 2024	22 Feb 2023	28 Feb 2022
Machine Age	hrs	Client Info		0	0	250
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<1.0	<1.0	<1.0
Water	WC Method	>0.2		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	6	8	1
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>4	<1	<1	<1
Titanium	ppm	ASTM D5185(m)		0	<1	0
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	2	<1
Lead	ppm	ASTM D5185(m)	>40	0	<1	<1
Copper	ppm	ASTM D5185(m)	>330	8	19	5
Tin	ppm	ASTM D5185(m)	>15	0	<1	1
Antimony	ppm	ASTM D5185(m)		0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	8	16	<1
Barium	ppm	ASTM D5185(m)	10	2	5	0
Molybdenum	ppm	ASTM D5185(m)	100	56	51	56
Manganese	ppm	ASTM D5185(m)		<1	5	<1
Magnesium	ppm	ASTM D5185(m)	450	931	857	984
Calcium	ppm	ASTM D5185(m)	3000	1082	1283	1014
Phosphorus	ppm	ASTM D5185(m)	1150	977	1024	1049
Zinc	ppm	ASTM D5185(m)	1350	1120	1099	1207
Sulfur	ppm	ASTM D5185(m)	4250	2677	2709	2776
Lithium	ppm	ASTM D5185(m)		<1	<1	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	8	13	4
Sodium	ppm	ASTM D5185(m)	>158	3	5	1
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	4.5	4.5	4.7
Sulfation	Abs.1mm	ASTM D7415*	>30	18.1	19.7	20.1



OIL ANALYSIS REPORT

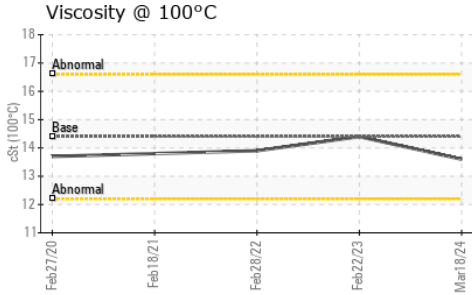

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	13.4	11.7

VISUAL


	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES


	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.6	14.4

GRAPHS


Iron (ppm)

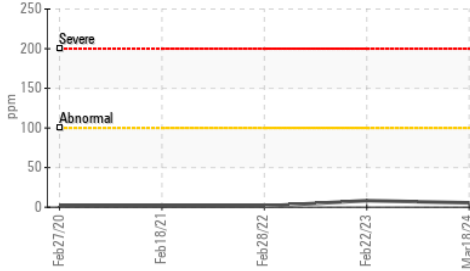


Lead (ppm)

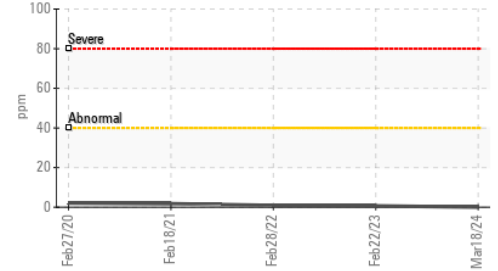


Aluminum (ppm)

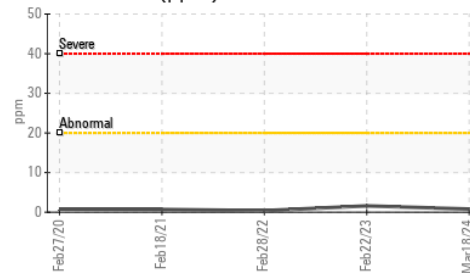


Chromium (ppm)

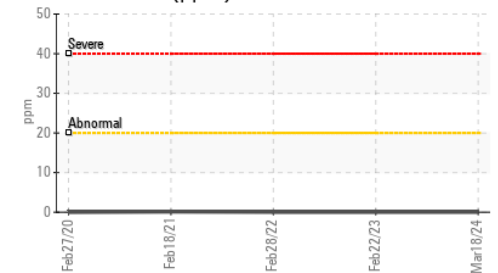


Copper (ppm)

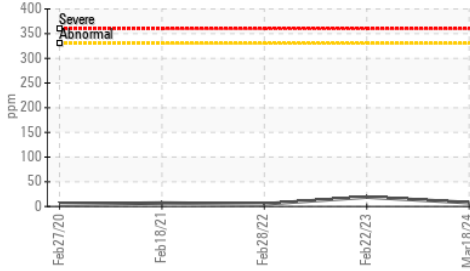


Silicon (ppm)

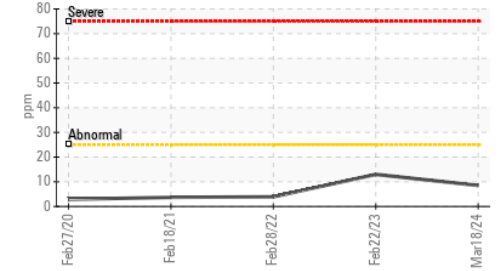

Viscosity @ 100°C

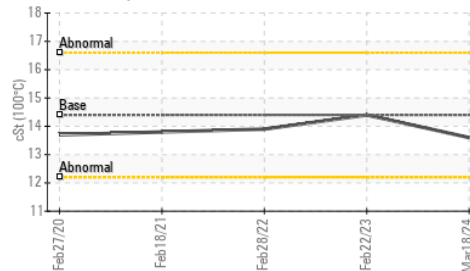

Soot %

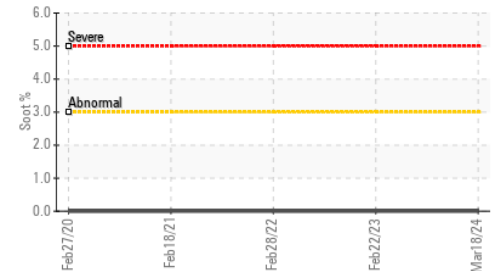

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0910609
Lab Number : 02625630
Unique Number : 5750749
Test Package : MOB 1

Received : 01 Apr 2024
Tested : 01 Apr 2024
Diagnosed : 01 Apr 2024 - Wes Davis

NORTHERN GENERATOR CO. LTD.
 80 ASHBRIDGE CIRCLE., UNIT #1 & 2
 WOODBRIDGE, ON
 CA L4L 3R5

Contact: Selome Afework
 selome@northerngenerator.com
 T: (905)264-9744
 F: (905)264-9714

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.