




OIL ANALYSIS REPORT

Sample Rating Trend

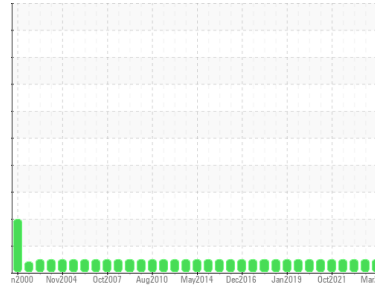

NORMAL



Area
WQR [1000000152259]
 Machine Id
RAWDHPUINTGATE (S/N H-93006S)
 Component
Hydraulic System
 Fluid
MOBIL UNIVIS N-C 32 (200 LTR)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0906686	WC0312892	WC0429606
Sample Date	Client Info			26 Mar 2024	26 Sep 2023	25 Oct 2022
Machine Age	mths	Client Info		360	348	342
Oil Age	mths	Client Info		101	95	83
Oil Changed	Client Info			Not Chngd	Not Chngd	Not Chngd
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	0	0	<1
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>20	0	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	0	<1	<1
Lead	ppm	ASTM D5185(m)	>20	0	<1	<1
Copper	ppm	ASTM D5185(m)	>20	1	1	<1
Tin	ppm	ASTM D5185(m)	>20	0	0	<1
Antimony	ppm	ASTM D5185(m)		0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		0	<1	<1
Barium	ppm	ASTM D5185(m)		0	<1	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		<1	0	0
Calcium	ppm	ASTM D5185(m)		40	40	42
Phosphorus	ppm	ASTM D5185(m)		336	329	359
Zinc	ppm	ASTM D5185(m)		433	441	426
Sulfur	ppm	ASTM D5185(m)		930	940	974
Lithium	ppm	ASTM D5185(m)		<1	<1	<1


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	0	<1	<1
Sodium	ppm	ASTM D5185(m)		0	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	<1	0	<1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	395	212	438
Particles >6µm		ASTM D7647	>1300	130	54	101
Particles >14µm		ASTM D7647	>160	17	6	17
Particles >21µm		ASTM D7647	>40	6	2	5
Particles >38µm		ASTM D7647	>10	2	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	16/14/11	15/13/10	16/14/11




OIL ANALYSIS REPORT


Particle Trend

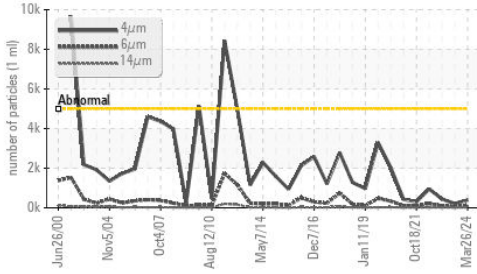


Acid Number

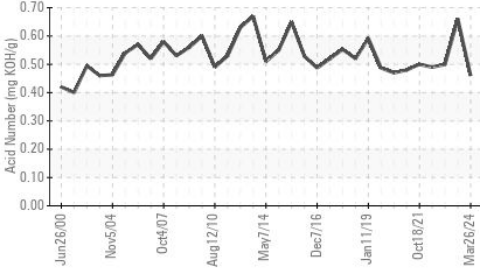

Viscosity @ 40°C

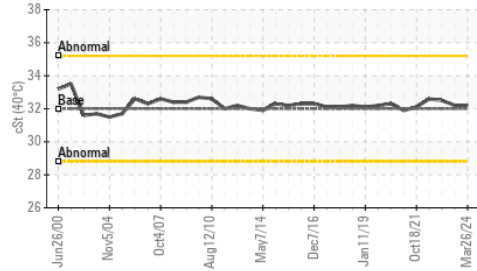

Particle Trend

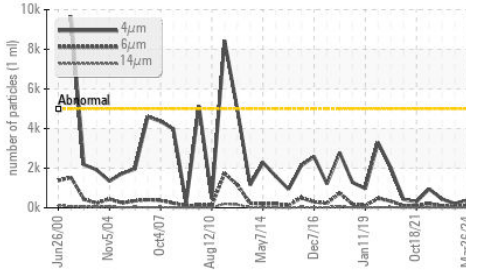

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN) mg KOH/g ASTM D974* **0.46** 0.66 0.50


VISUAL method limit/base current history1 history2

White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES method limit/base current history1 history2


Visc @ 40°C cSt ASTM D7279(m) 32 **32.2** 32.2 32.5

SAMPLE IMAGES method limit/base current history1 history2

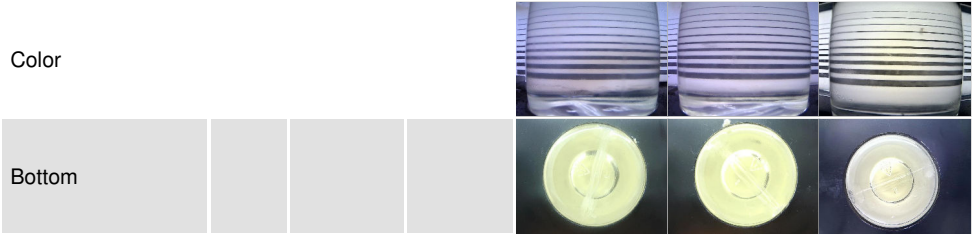


GRAPHS


Ferrous Alloys

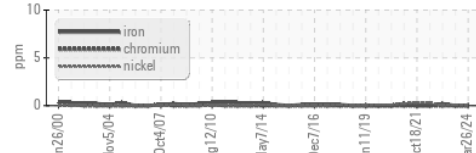


Non-ferrous Metals

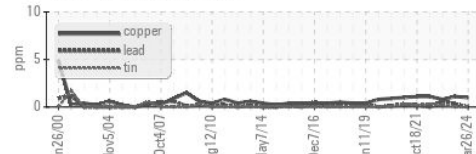


Viscosity @ 40°C

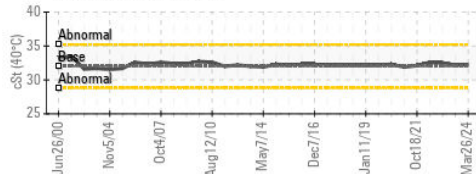

Particle Count

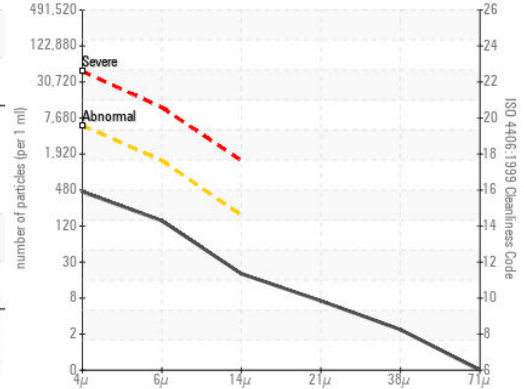

Acid Number

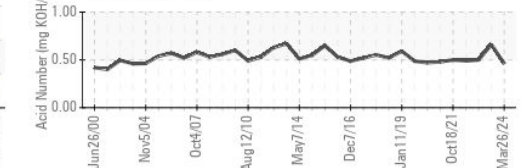

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
 Sample No. : WC0906686 Received : 01 Apr 2024
 Lab Number : **02625685** Tested : 02 Apr 2024
 Unique Number : 5750804 Diagnosed : 02 Apr 2024 - Wes Davis
 Test Package : IND 2

ALGONQUIN POWER SYSTEMS INC.
 354 DAVIS ROAD
 OAKVILLE, ON
 CA L6J 2X1
 Contact: Antonino Champ Fernando
 antoninoChamp.fernando@algonquinpower.com
 T: (905)465-7065
 F: x:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.