



OIL ANALYSIS REPORT

Sample Rating Trend

ADDITIVES



Area
63 STEAM GENERATING & DISTRIBUTION
 Machine Id
PB ID Fan Cleaning Compressor (S/N 632902)
 Component
Air Compressor
 Fluid
SULLAIR SULLUBE (15 LTR)



DIAGNOSIS

Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC	---	---
Sample Date	Client Info		21 Mar 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ATTENTION	---	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	---	---
Iron	ppm	ASTM D5185(m) >50	5	---	---
Chromium	ppm	ASTM D5185(m) >4	0	---	---
Nickel	ppm	ASTM D5185(m) >4	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m)	0	---	---
Aluminum	ppm	ASTM D5185(m) >10	2	---	---
Lead	ppm	ASTM D5185(m) >20	0	---	---
Copper	ppm	ASTM D5185(m) >40	4	---	---
Tin	ppm	ASTM D5185(m) >5	0	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 12	<1	---	---
Barium	ppm	ASTM D5185(m) 500	168	---	---
Molybdenum	ppm	ASTM D5185(m) 0.0	0	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m) 0.0	3	---	---
Calcium	ppm	ASTM D5185(m) 8.2	2	---	---
Phosphorus	ppm	ASTM D5185(m) 4.0	0	---	---
Zinc	ppm	ASTM D5185(m) 0.1	50	---	---
Sulfur	ppm	ASTM D5185(m) 240	288	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	<1	---	---
Sodium	ppm	ASTM D5185(m)	179	---	---
Potassium	ppm	ASTM D5185(m) >20	37	---	---
Water	%	ASTM D6304* >0.6	0.097	---	---
ppm Water	ppm	ASTM D6304* >6000	980	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.06	0.64	---	---



OIL ANALYSIS REPORT

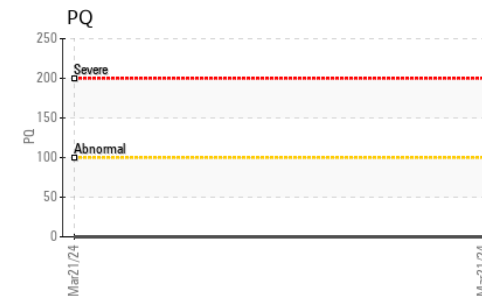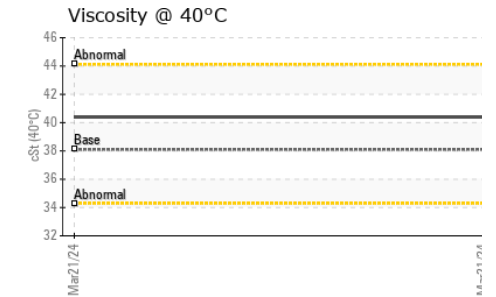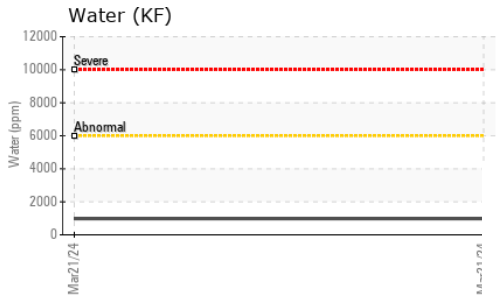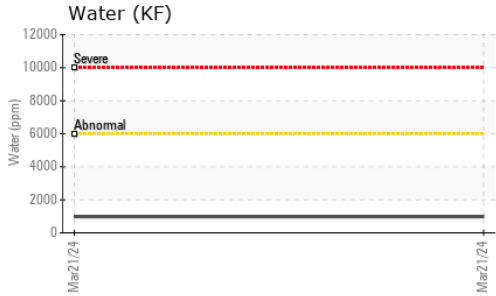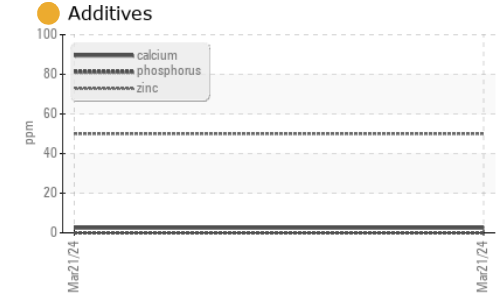






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	VLITE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.6	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	38.1	40.4	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

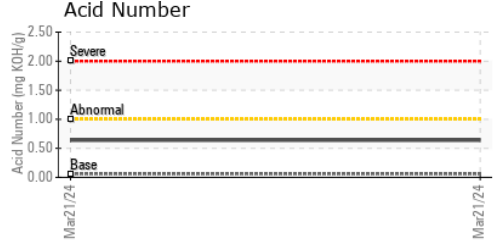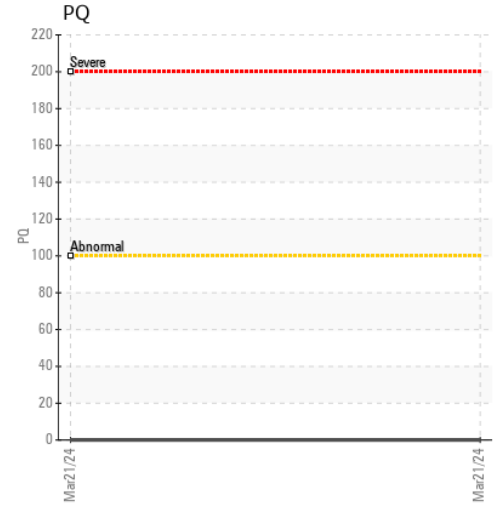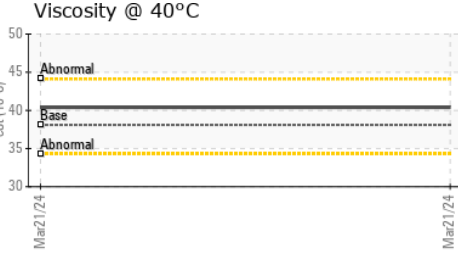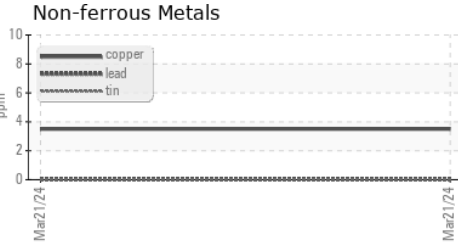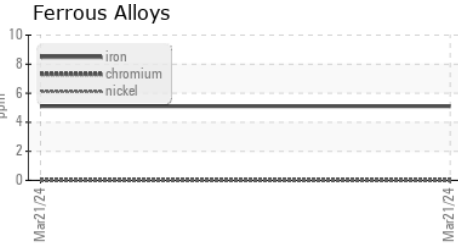

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC **Received** : 01 Apr 2024
Lab Number : 02625721 **Tested** : 03 Apr 2024
Unique Number : 5750840 **Diagnosed** : 03 Apr 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: KF, TAN Man)

AV GROUP NB INC.
 103 PINDER ROAD,, NACKAWIC MILL
 NACKAWIC, NB
 CA E6G 1W4
 Contact: Jeremy Sharp
 Jeremy.Sharp@adityabirla.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.