




OIL ANALYSIS REPORT

Sample Rating Trend

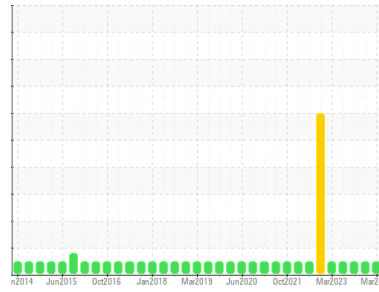

NORMAL



Machine Id
LLBHPU LONG LAKE
 Component
Hydraulic System
 Fluid
SHELL TELLUS S2 M 32 (150 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0843677	WC0843676	WC0843698
Sample Date	Client Info	25 Mar 2024	21 Dec 2023	26 Sep 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.05	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m) >20	0	<1	<1
Chromium	ppm	ASTM D5185(m) >20	0	0	0
Nickel	ppm	ASTM D5185(m) >20	2	2	3
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	<1	<1
Aluminum	ppm	ASTM D5185(m) >20	0	<1	<1
Lead	ppm	ASTM D5185(m) >20	<1	<1	1
Copper	ppm	ASTM D5185(m) >20	20	20	21
Tin	ppm	ASTM D5185(m) >20	0	0	0
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	<1	0	<1
Barium	ppm	ASTM D5185(m)	0	0	<1
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	5	4	4
Calcium	ppm	ASTM D5185(m)	65	67	66
Phosphorus	ppm	ASTM D5185(m)	259	266	269
Zinc	ppm	ASTM D5185(m)	307	310	317
Sulfur	ppm	ASTM D5185(m)	1718	1873	1801
Lithium	ppm	ASTM D5185(m)	<1	<1	<1


CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >15	0	<1	<1
Sodium	ppm	ASTM D5185(m)	<1	0	0
Potassium	ppm	ASTM D5185(m) >20	<1	11	0


FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	987	437	1232
Particles >6µm	ASTM D7647	>1300	311	109	270
Particles >14µm	ASTM D7647	>160	28	13	18
Particles >21µm	ASTM D7647	>40	8	4	4
Particles >38µm	ASTM D7647	>10	1	1	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	17/15/12	16/14/11	17/15/11


Particle Trend

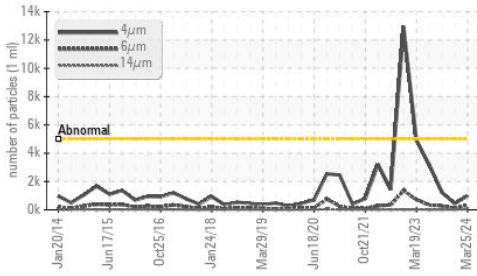


Acid Number

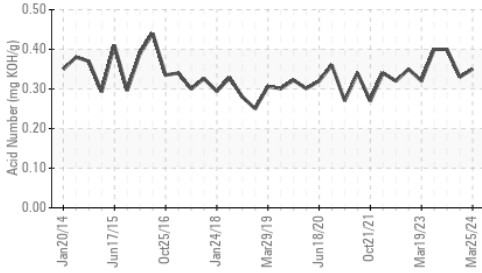


Viscosity @ 40°C

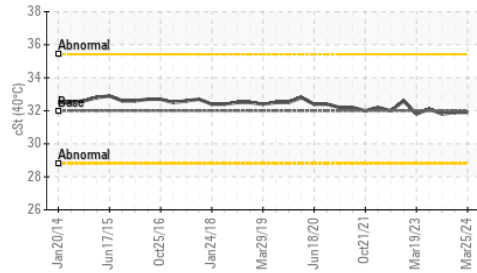

Particle Trend

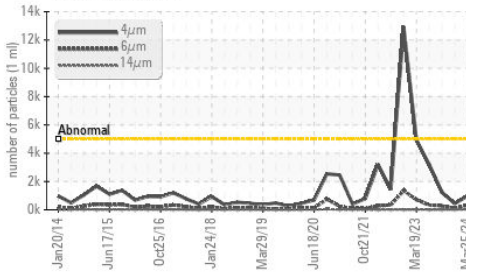

Non-ferrous Metals

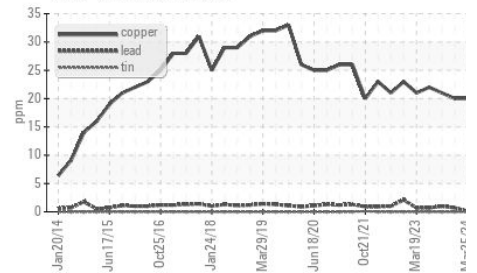


FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D974*	0.35	0.33	0.40
White Metal	scalar Visual*	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	NONE
Sand/Dirt	scalar Visual*	VLITE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML
Emulsified Water	scalar Visual*	NEG	NEG	NEG
Free Water	scalar Visual*	NEG	NEG	NEG

FLUID PROPERTIES


method	limit/base	current	history1	history2
Visc @ 40°C cSt	ASTM D7279(m)	31.9	31.9	31.8

SAMPLE IMAGES

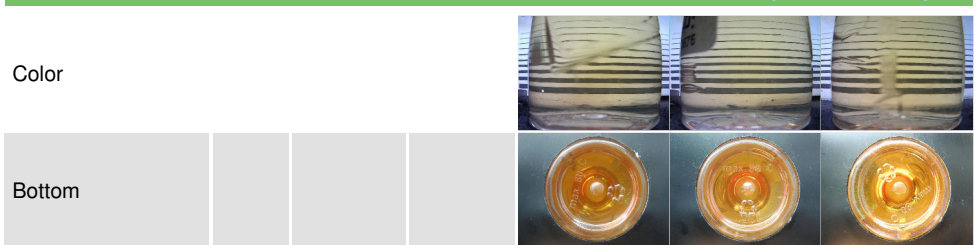


GRAPHS


Ferrous Alloys

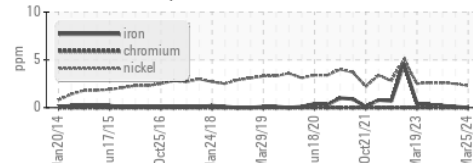


Non-ferrous Metals

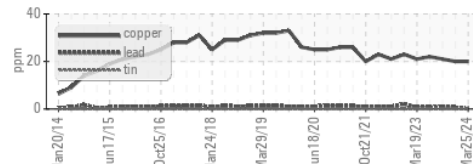


Viscosity @ 40°C

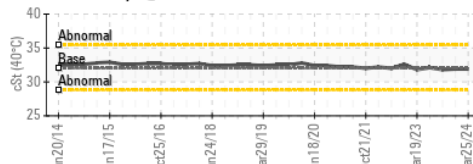

Particle Count

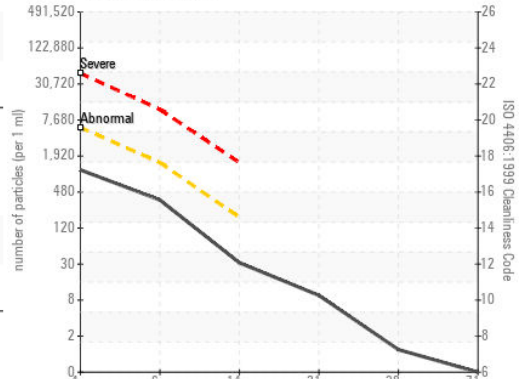

Acid Number

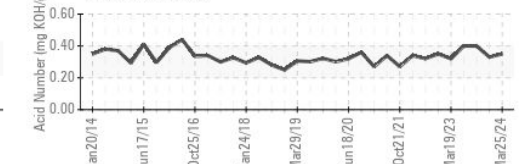

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0843677
Lab Number : 02626426
Unique Number : 5759558
Test Package : IND 2
Received : 03 Apr 2024
Tested : 04 Apr 2024
Diagnosed : 05 Apr 2024 - Kevin Marson

Long Lake Hydro Inc. (Regional Power)
 1104 Railway St.
 Stewart, BC
 CA V0T 1W0
 Contact: Jonathan Zappitelli
 jzappitelli@cclinfrastucture.com
 T: (778)794-0385
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.