




OIL ANALYSIS REPORT

Sample Rating Trend

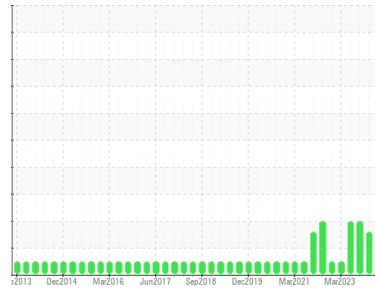

NORMAL



Area

3 Calender Line

Machine Id

3 Calender Menzel East Hydraulic Pump (S/N 42-0356B)

Component

Hydraulic System

Fluid

SUNOCO SUNVIS 846 ISO 46 (24 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0892251	WC0837272	WC0837257
Sample Date	Client Info	20 Mar 2024	03 Jan 2024	03 Oct 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	ATTENTION	ATTENTION

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method	>0.05	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>30	0	0
Chromium	ppm	ASTM D5185(m)	>2	0	0
Nickel	ppm	ASTM D5185(m)	>2	0	<1
Titanium	ppm	ASTM D5185(m)		0	0
Silver	ppm	ASTM D5185(m)		0	<1
Aluminum	ppm	ASTM D5185(m)	>2	0	<1
Lead	ppm	ASTM D5185(m)	>10	0	0
Copper	ppm	ASTM D5185(m)	>25	<1	<1
Tin	ppm	ASTM D5185(m)	>20	0	0
Antimony	ppm	ASTM D5185(m)		0	0
Vanadium	ppm	ASTM D5185(m)		0	0
Beryllium	ppm	ASTM D5185(m)		0	0
Cadmium	ppm	ASTM D5185(m)		0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		0	0
Barium	ppm	ASTM D5185(m)		0	<1
Molybdenum	ppm	ASTM D5185(m)		0	0
Manganese	ppm	ASTM D5185(m)		0	0
Magnesium	ppm	ASTM D5185(m)		<1	<1
Calcium	ppm	ASTM D5185(m)		38	39
Phosphorus	ppm	ASTM D5185(m)		246	246
Zinc	ppm	ASTM D5185(m)		310	302
Sulfur	ppm	ASTM D5185(m)		5272	5492
Lithium	ppm	ASTM D5185(m)		<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>25	0	0
Sodium	ppm	ASTM D5185(m)		0	0
Potassium	ppm	ASTM D5185(m)	>20	<1	4

FLUID CLEANLINESS


method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	633	4127	5065
Particles >6µm	ASTM D7647	>1300	209	1592	2003
Particles >14µm	ASTM D7647	>160	25	184	231
Particles >21µm	ASTM D7647	>40	9	57	57
Particles >38µm	ASTM D7647	>10	2	2	4
Particles >71µm	ASTM D7647	>3	0	0	1

Oil Cleanliness	ISO 4406 (c)	>19/17/14	16/15/12	19/18/15	20/18/15
-----------------	--------------	-----------	-----------------	----------	----------




OIL ANALYSIS REPORT


Particle Trend

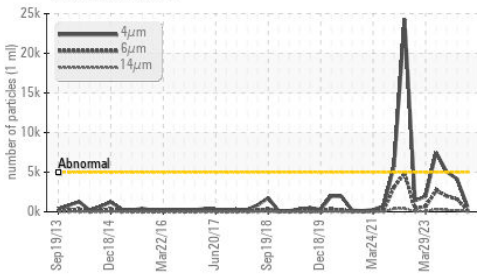


Acid Number

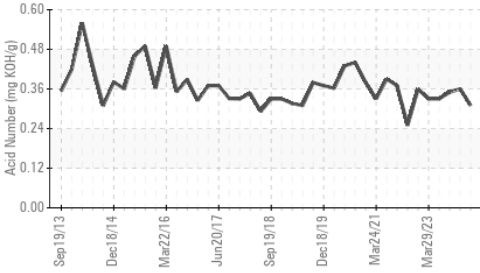

Viscosity @ 40°C

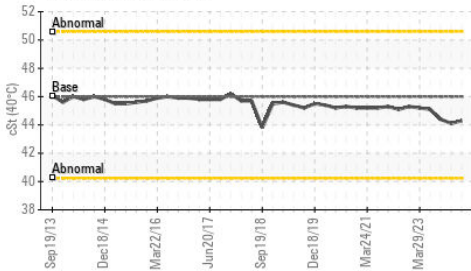

Particle Trend

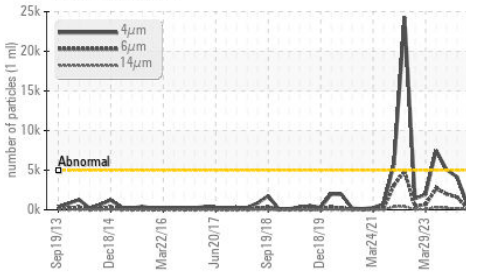


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.31	0.36	0.35

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	46.0	44.3	44.1	44.4

SAMPLE IMAGES

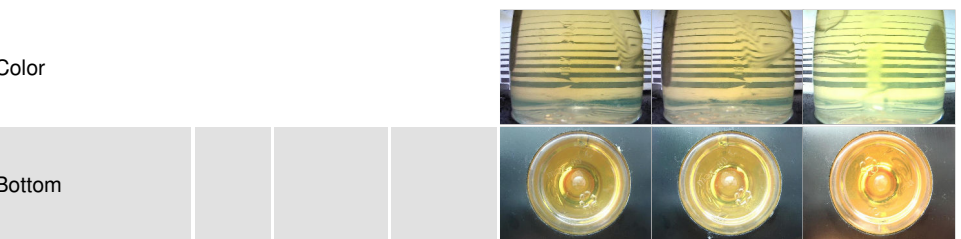


GRAPHS


Ferrous Alloys

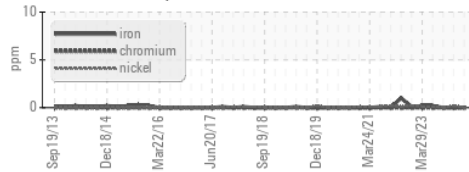


Non-ferrous Metals

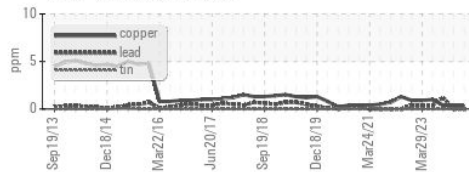


Viscosity @ 40°C

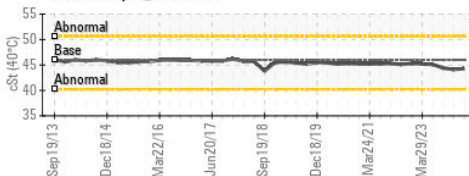

Particle Count

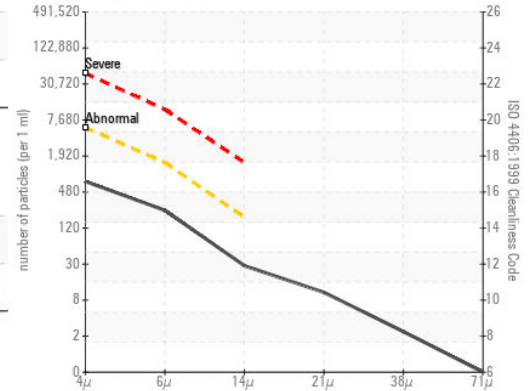

Acid Number

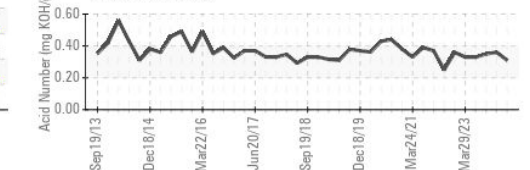

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
 Sample No. : WC0892251
 Lab Number : 02626617
 Unique Number : 5759749
 Test Package : IND 2

CANADIAN GENERAL TOWER LTD.
 52 MIDDLETON STREET, P.O. BOX 160
 CAMBRIDGE, ON
 CA N1S 2R4
 Contact: Bob Abell
 bob.abell@cgtower.com
 T: (519)623-1630
 F: (519)623-7018

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.