



OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Area

Manutention

Machine Id

convoyeur 2013

Component

Reduction Gear

Fluid

MOBIL MOBILGEAR SHC 220 (--- GAL)

DIAGNOSIS

Recommendation

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition. À NOTER: S.V.P. inclure, avec le prochain échantillon, des détails de la capacité du réservoir et le type et le degré de filtration.

Wear

Les taux d'usure de tous les composants sont normaux.

Contamination

La teneur en eau est négligeable. Il n'y a aucun indice de contamination dans l'huile.

Fluid Condition

Le AN est acceptable pour ce fluide. L'état de l'huile permet d'en prolonger l'utilisation.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0915596	---	---
Sample Date	Client Info		29 Mar 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		10	---	---
Iron	ppm	ASTM D5185(m) >117	29	---	---
Chromium	ppm	ASTM D5185(m) >2	<1	---	---
Nickel	ppm	ASTM D5185(m) >2	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m)	0	---	---
Aluminum	ppm	ASTM D5185(m) >11	0	---	---
Lead	ppm	ASTM D5185(m) >10	0	---	---
Copper	ppm	ASTM D5185(m) >55	2	---	---
Tin	ppm	ASTM D5185(m) >15	0	---	---
Antimony	ppm	ASTM D5185(m) >5	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	1	---	---
Barium	ppm	ASTM D5185(m)	0	---	---
Molybdenum	ppm	ASTM D5185(m)	0	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m)	<1	---	---
Calcium	ppm	ASTM D5185(m)	13	---	---
Phosphorus	ppm	ASTM D5185(m)	402	---	---
Zinc	ppm	ASTM D5185(m)	12	---	---
Sulfur	ppm	ASTM D5185(m)	1796	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	16	---	---
Sodium	ppm	ASTM D5185(m)	<1	---	---
Potassium	ppm	ASTM D5185(m) >20	<1	---	---
Water	%	ASTM D6304* >0.1	0.003	---	---
ppm Water	ppm	ASTM D6304* >1000	39	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.80	---	---



OIL ANALYSIS REPORT

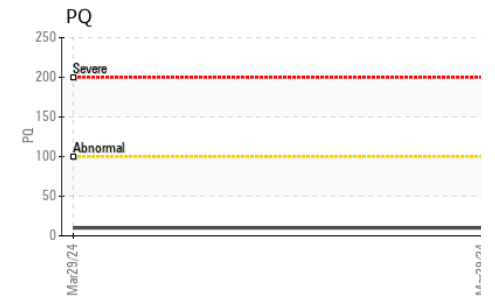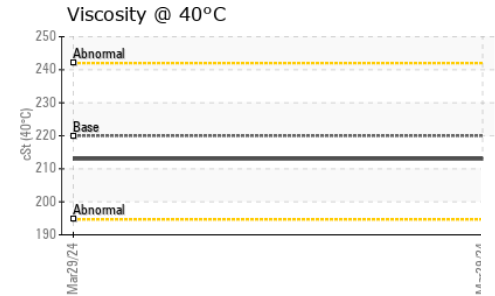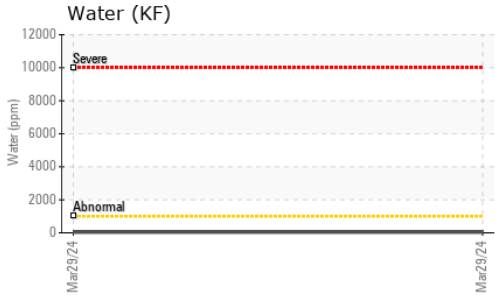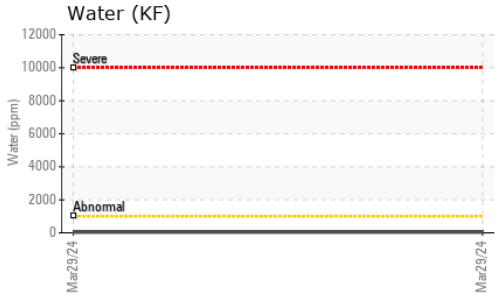






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.1	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	220	213	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

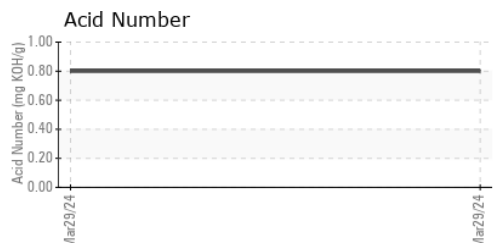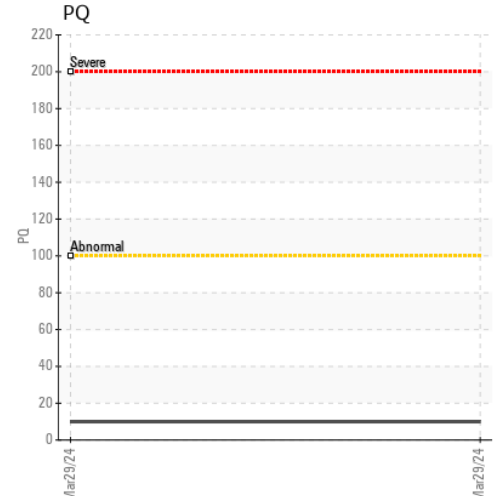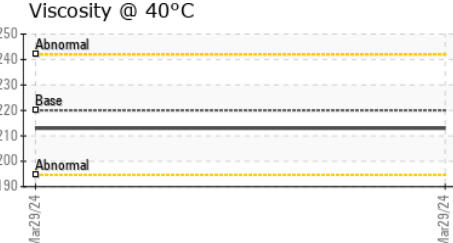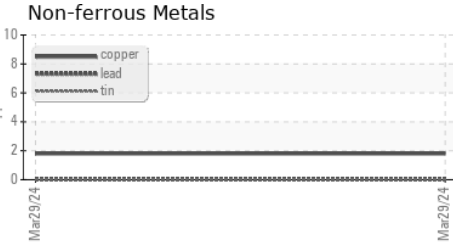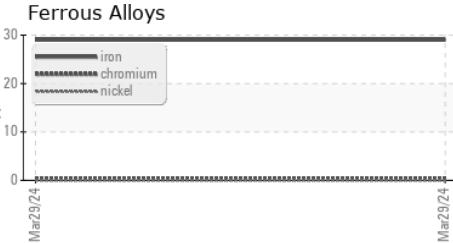

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0915596 **Received** : 04 Apr 2024
Lab Number : **02626769** **Tested** : 05 Apr 2024
Unique Number : 5759901 **Diagnosed** : 05 Apr 2024 - Wes Davis
Test Package : IND 2 (Additional Tests: KF, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

RTA - UGB
 C.P. 900
 Ville de la Baie, QC
 CA G7B 4G9
 Contact: Alcan Epc
 mathieu.tremblay2@riotinto.com
 T: (418)697-9568
 F: (418)697-9550