



# OIL ANALYSIS REPORT

Sample Rating Trend



DIRT



Machine Id  
**121-10024**

Component  
**Blower**

Fluid  
**PETRO CANADA SYNDURO SHB ISO150 (--- GAL)**

## DIAGNOSIS

### Recommendation

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

Elemental level of silicon (Si) above normal indicating ingress of seal material.

### Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0892489</b>	---	---
Sample Date	Client Info		<b>28 Mar 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method		<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	---	---
Iron	ppm	ASTM D5185(m) >20	<b>2</b>	---	---
Chromium	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
Lead	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m)	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>2</b>	---	---
Barium	ppm	ASTM D5185(m) 5.0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m)	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m) 5.0	<b>0</b>	---	---
Calcium	ppm	ASTM D5185(m) 5.0	<b>5</b>	---	---
Phosphorus	ppm	ASTM D5185(m) 100	<b>228</b>	---	---
Zinc	ppm	ASTM D5185(m) 5.0	<b>3</b>	---	---
Sulfur	ppm	ASTM D5185(m) 1900	<b>840</b>	---	---
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>▲ 29</b>	---	---
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.3	<b>0.23</b>	---	---



# OIL ANALYSIS REPORT

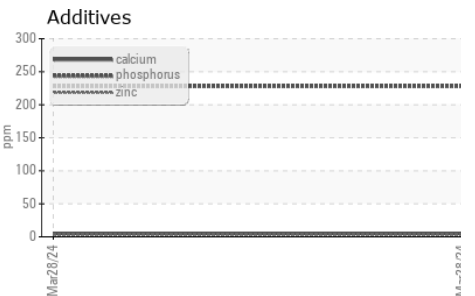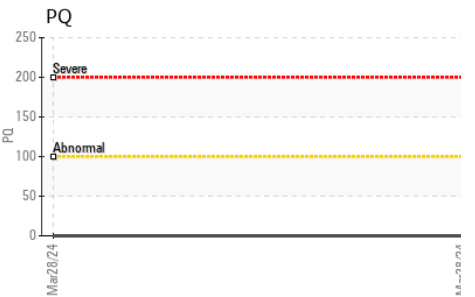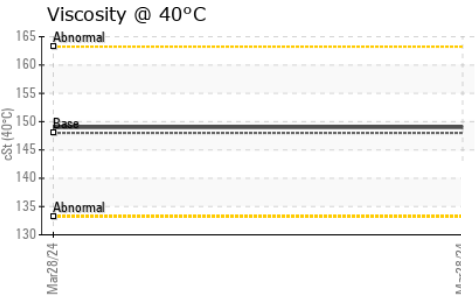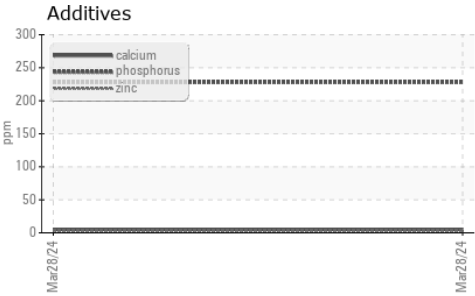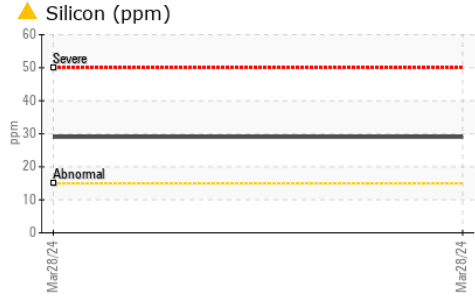





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	VLITE	---
Sand/Dirt	scalar	Visual*	NONE	VLITE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	NEG	---	---
Free Water	scalar	Visual*	NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	148	149	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

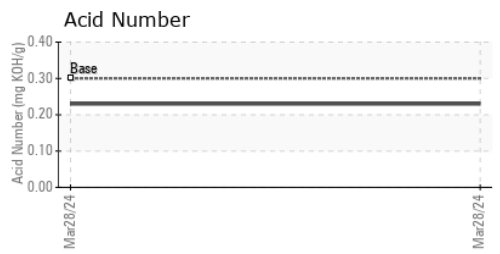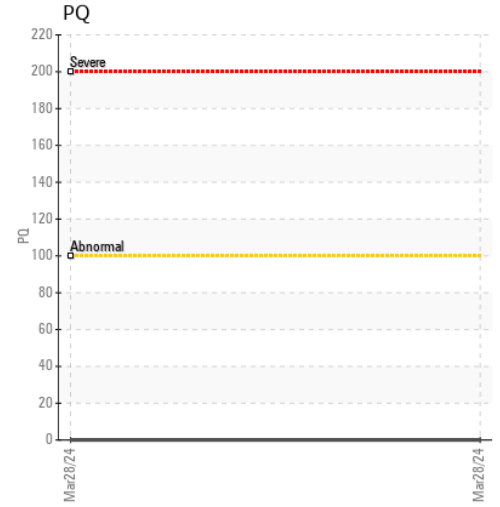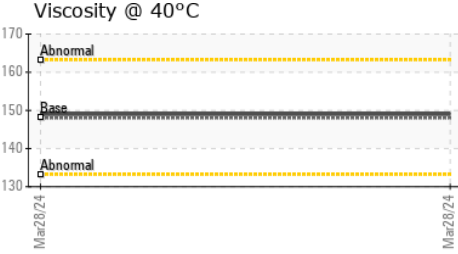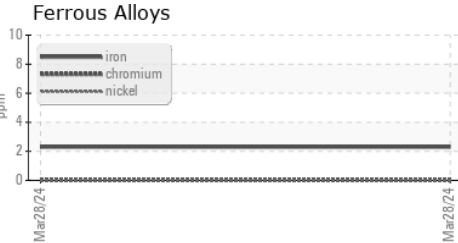

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0892489  
**Lab Number** : 02626796  
**Unique Number** : 5759928  
**Test Package** : IND 2  
**Received** : 04 Apr 2024  
**Tested** : 05 Apr 2024  
**Diagnosed** : 05 Apr 2024 - Kevin Marson

**DXP - SCS - Sabic IP Cobourg**  
 44 Normar Road  
 Cobourg, ON  
 CA K9A 4L7  
 Contact: George DiFrancesco  
 george.difrancesco@sabic.com  
 T: (905)373-3988  
 F: (905)373-3844

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.