OIL ANALYSIS REPORT

Sample Rating Trend

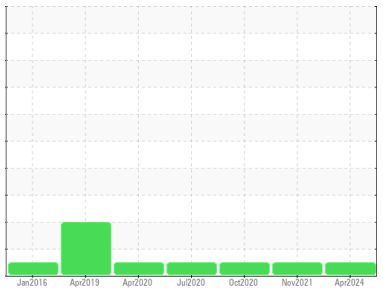

NORMAL

Machine Id
D-3309A GAS COMPRESSOR LUBE OIL TANK- M15
Component
Compressor
Fluid
IRVING D & E ISO 32 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**PP**	PP	WC
Sample Date		Client Info		**04 Apr 2024**	09 Nov 2021	06 Oct 2020
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**NORMAL**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		**0**	0	0
Iron	ppm	ASTM D5185(m)	>50	**0**	0	0
Chromium	ppm	ASTM D5185(m)	>5	**0**	0	0
Nickel	ppm	ASTM D5185(m)		**0**	0	<1
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**0**	0	0
Aluminum	ppm	ASTM D5185(m)	>15	**0**	0	<1
Lead	ppm	ASTM D5185(m)	>65	**0**	<1	0
Copper	ppm	ASTM D5185(m)	>65	**0**	<1	<1
Tin	ppm	ASTM D5185(m)	>10	**0**	<1	<1
Antimony	ppm	ASTM D5185(m)		**0**	0	0
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0.0	**<1**	<1	<1
Barium	ppm	ASTM D5185(m)	0.2	**0**	0	0
Molybdenum	ppm	ASTM D5185(m)	0.0	**0**	0	0
Manganese	ppm	ASTM D5185(m)		**0**	0	0
Magnesium	ppm	ASTM D5185(m)	0.3	**<1**	<1	<1
Calcium	ppm	ASTM D5185(m)	2.0	**0**	1	2
Phosphorus	ppm	ASTM D5185(m)	4.6	**<1**	1	2
Zinc	ppm	ASTM D5185(m)	7.4	**2**	3	3
Sulfur	ppm	ASTM D5185(m)		**3336**	3581	3602
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>35	**0**	<1	<1
Sodium	ppm	ASTM D5185(m)		**<1**	3	3
Potassium	ppm	ASTM D5185(m)	>20	**0**	<1	<1
Water	%	ASTM D6304*	>0.1	**0.001**	0.001	0.002
ppm Water	ppm	ASTM D6304*	>1000	**6**	3.5	24.5

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	**1271**	2262	634
Particles >6µm	ASTM D7647	>2500	**245**	512	172
Particles >14µm	ASTM D7647	>320	**11**	25	19
Particles >21µm	ASTM D7647	>80	**3**	5	6
Particles >38µm	ASTM D7647	>20	**0**	0	0
Particles >71µm	ASTM D7647	>4	**0**	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	**17/15/11**	18/16/12	16/15/11

OIL ANALYSIS REPORT

Particle Count

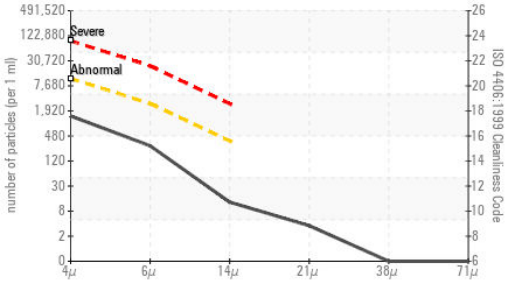

Acid Number

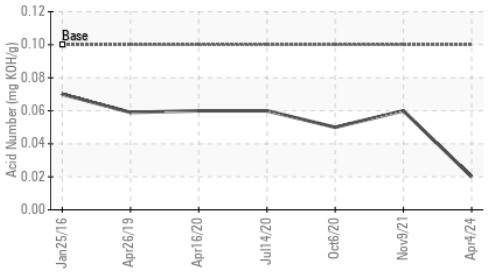

Water (KF)

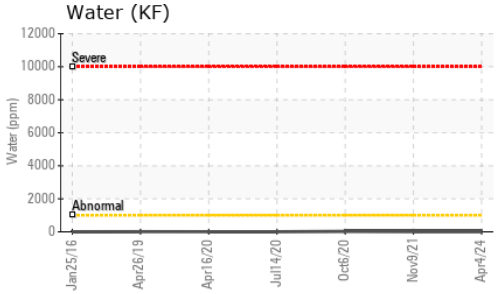

Viscosity @ 40°C

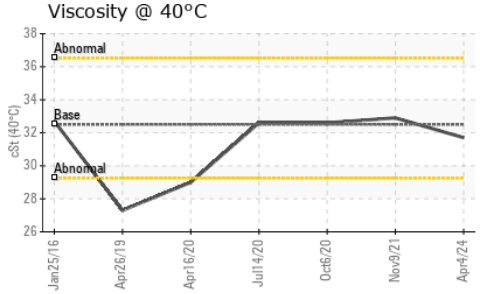

PQ

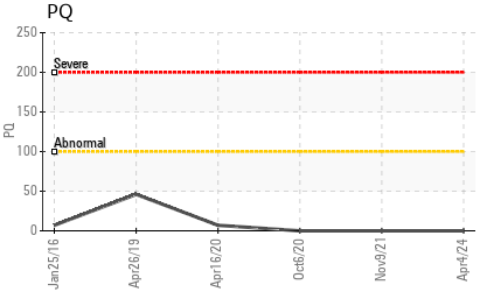

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.10	**0.02**	0.06	0.05

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**NONE**	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	**VLITE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**NORML**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	**NEG**	NEG	NEG
Free Water	scalar	Visual*		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	32.5	**31.7**	32.9	32.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					
MPC			*no image*		

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP
Lab Number : 02626986
Unique Number : 5760118
Test Package : MAR 2 (Additional Tests: KF, PQ, PRTCOUNT, TAN Man)

Received : 05 Apr 2024
Tested : 09 Apr 2024
Diagnosed : 09 Apr 2024 - Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

HIBERNIA MGMT & DEVELOPMENT CO. LTD
SUITE 1000,, 100 NEW GOWER STREET
ST.JOHNS, NL
CA A1C 6K3
Contact: Christopher Michelau
christopher.j.michelau@exxonmobil.com
T:
F: (709)722-3766