




OIL ANALYSIS REPORT

Sample Rating Trend

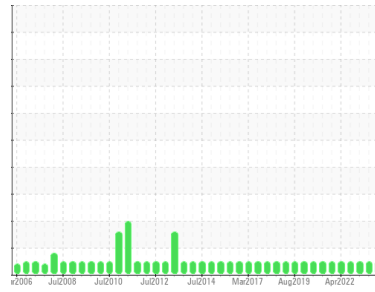

NORMAL



Area
WCR [100000107833]
 Machine Id
DIXNGEN2BRGMAIN
 Component
Main Bearing
 Fluid
MOBIL DTE OIL HVY MEDIUM (75 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0908345	WC0794339	WC0794329
Sample Date	Client Info			12 Mar 2024	17 Oct 2023	03 Apr 2023
Machine Age	hrs	Client Info		160143	157318	153431
Oil Age	hrs	Client Info		14881	12056	8169
Oil Changed	Client Info			Filtered	Filtered	Filtered
Sample Status				NORMAL	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>20	0	0	0
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>20	0	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	0	0	<1
Lead	ppm	ASTM D5185(m)	>20	0	<1	<1
Copper	ppm	ASTM D5185(m)	>20	<1	1	1
Tin	ppm	ASTM D5185(m)	>20	0	0	<1
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		0	<1	<1
Barium	ppm	ASTM D5185(m)		0	<1	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		<1	<1	0
Calcium	ppm	ASTM D5185(m)		1	2	2
Phosphorus	ppm	ASTM D5185(m)		133	135	146
Zinc	ppm	ASTM D5185(m)		88	90	91
Sulfur	ppm	ASTM D5185(m)		1000	994	981
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	3	4	3
Sodium	ppm	ASTM D5185(m)		<1	<1	0
Potassium	ppm	ASTM D5185(m)	>20	<1	0	0
Water	%	ASTM D6304*	>2	0.001	0.00	0.00
ppm Water	ppm	ASTM D6304*		5	0.00	0.00

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	1446	1167	829
Particles >6µm		ASTM D7647	>2500	204	288	89
Particles >14µm		ASTM D7647	>160	9	25	8
Particles >21µm		ASTM D7647	>40	2	6	4
Particles >38µm		ASTM D7647	>10	1	1	1
Particles >71µm		ASTM D7647	>3	1	1	0

Oil Cleanliness	ISO 4406 (c)	>20/18/14	18/15/10	17/15/12	17/14/10
-----------------	--------------	-----------	-----------------	----------	----------

OIL ANALYSIS REPORT

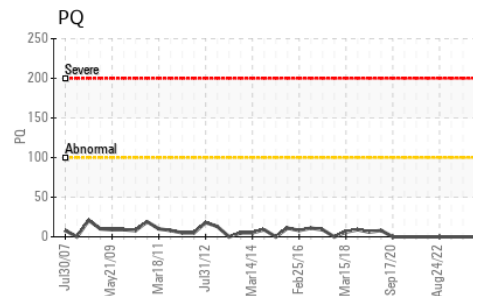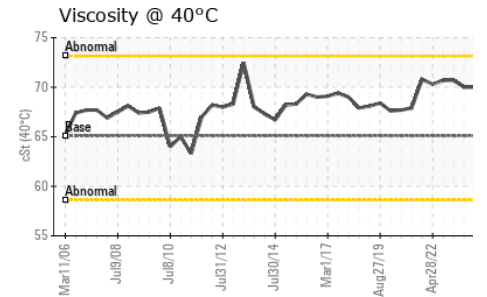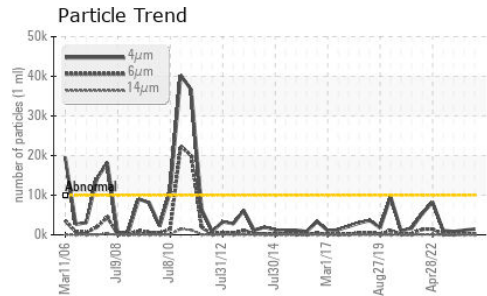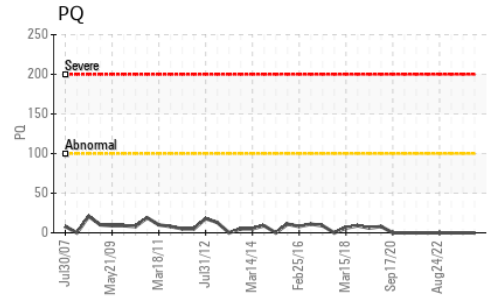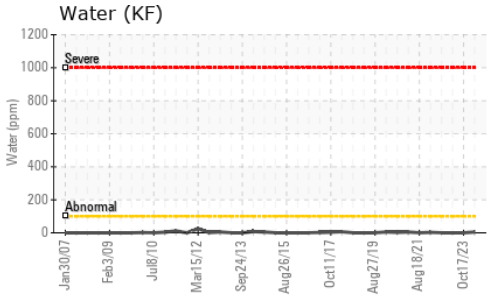


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.11	0.14	0.13






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	VLITE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	65.1	70.0	70.0	70.7

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

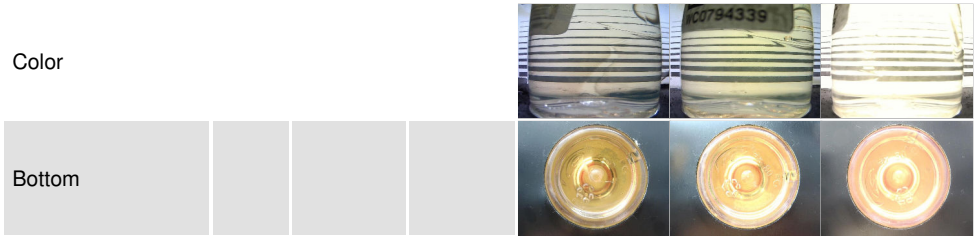

GRAPHS

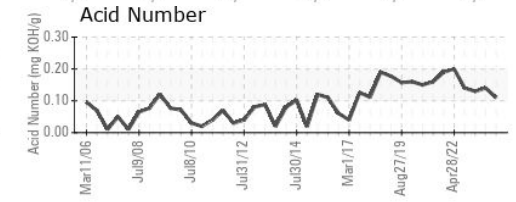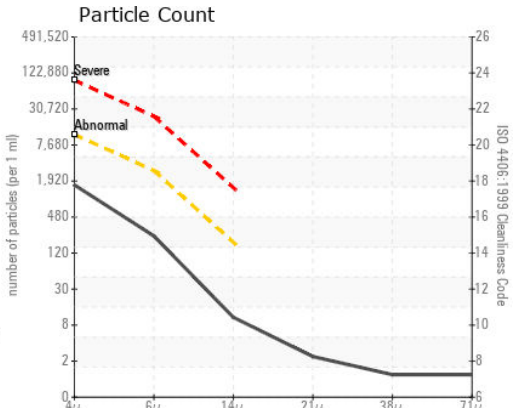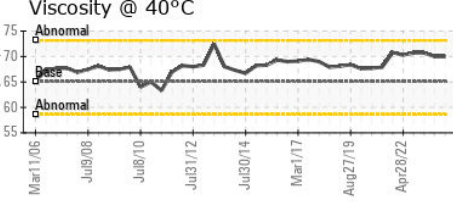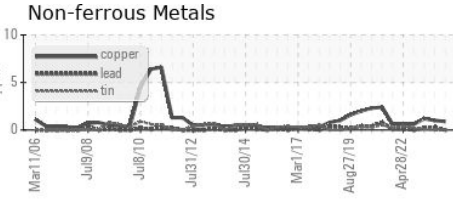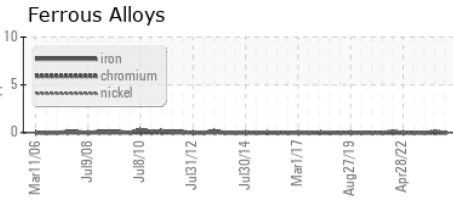

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0908345
Lab Number : 02627018
Unique Number : 5760150
Test Package : IND 2 (Additional Tests: KF, PQ, Prcount, TAN Man)

ALGONQUIN POWER SYSTEMS INC.
 354 DAVIS ROAD
 OAKVILLE, ON
 CA L6J 2X1

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Contact: Antonino Champ Fernando
 antoninoChamp.fernando@algonquinpower.com
 T: (905)465-7065
 F: x: