




OIL ANALYSIS REPORT

Sample Rating Trend

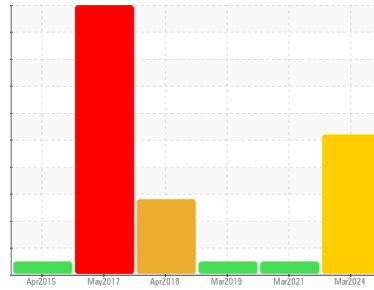

WEAR PARTICLES



Machine Id
E-COAT OVEN DRIVE
 Component
Gearbox
 Fluid
SHELL OMALA 150 (--- GAL)

DIAGNOSIS

Recommendation

We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

Wear particle analysis indicates that the ferrous rolling, ferrous rubbing and ferrous corrosive particles are abnormal.

Contaminants

There is no indication of any contamination in the oil.

Oil Condition

The AN level is above the recommended limit. Viscosity of sample indicates oil is within ISO 320 range, advise investigate. This plus the additive levels indicates that this is not the same brand, or type of oil as reported. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC	CB0029722	CB0028682
Sample Date	Client Info	23 Mar 2024	24 Mar 2021	11 Mar 2019
Machine Age	days	0	0	0
Oil Age	days	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	34	0	22
Iron	ppm ASTM D5185(m) >200	81	9	10
Chromium	ppm ASTM D5185(m) >15	<1	0	0
Nickel	ppm ASTM D5185(m) >15	0	<1	<1
Titanium	ppm ASTM D5185(m)	0	0	0
Silver	ppm ASTM D5185(m)	0	<1	0
Aluminum	ppm ASTM D5185(m) >25	1	<1	<1
Lead	ppm ASTM D5185(m) >100	<1	<1	1
Copper	ppm ASTM D5185(m) >200	24	18	19
Tin	ppm ASTM D5185(m) >25	0	0	0
Antimony	ppm ASTM D5185(m) >5	0	0	0
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	0	<1

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 6.2	2	2	2
Barium	ppm ASTM D5185(m) 0.0	3	<1	<1
Molybdenum	ppm ASTM D5185(m) 0	0	0	<1
Manganese	ppm ASTM D5185(m)	<1	<1	1
Magnesium	ppm ASTM D5185(m) 0	<1	<1	<1
Calcium	ppm ASTM D5185(m) 0.0	2	1	2
Phosphorus	ppm ASTM D5185(m) 512	341	300	302
Zinc	ppm ASTM D5185(m) 3.8	16	14	21
Sulfur	ppm ASTM D5185(m) 8167	4789	7040	7426
Lithium	ppm ASTM D5185(m)	3	2	<1





CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >50	14	9	12
Sodium	ppm ASTM D5185(m)	4	<1	0
Potassium	ppm ASTM D5185(m) >20	2	<1	0

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	2.09	0.52	0.468

OIL ANALYSIS REPORT

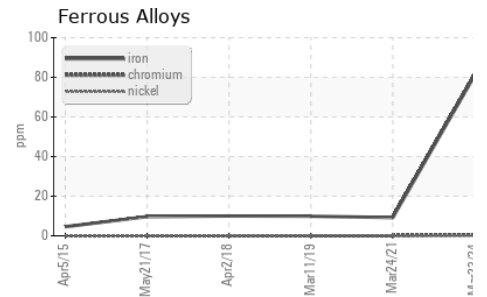
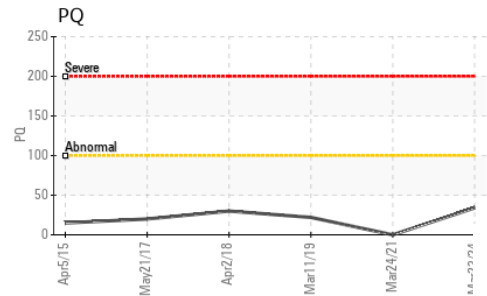
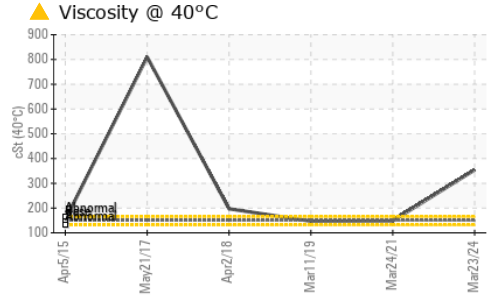
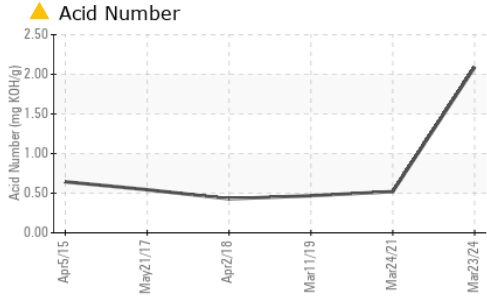


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	LIGHT	NONE
Debris	scalar	Visual*	NONE	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	VLITE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	150 ▲ 354	148	147

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	
Bottom				no image	

GRAPHS

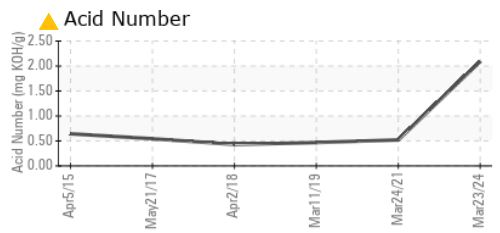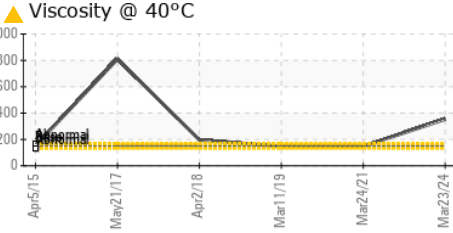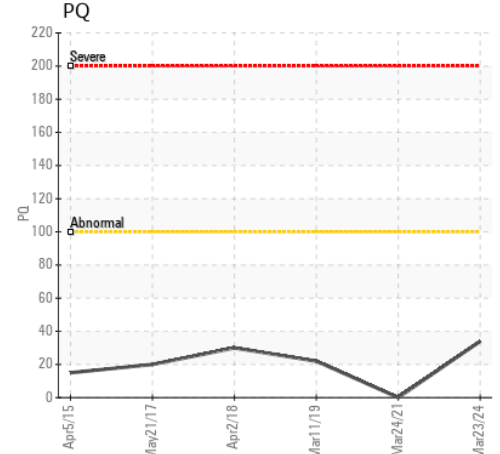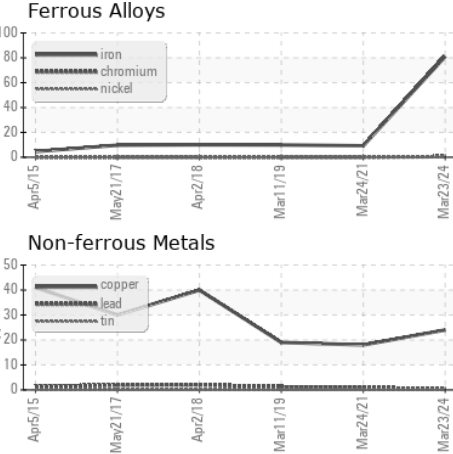




Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC
Lab Number : 02627130
Unique Number : 5760262
Test Package : IND 3 (Additional Tests: TAN Man)
Received : 05 Apr 2024
Tested : 11 Apr 2024
Diagnosed : 11 Apr 2024 - Kevin Marson

TOYOTA MOTOR MANUFACT.
 1055 FOUNTAIN STREET N.
 CAMBRIDGE, ON
 CA N3H 5K2
 Contact: mike clappison
 mike.clappison@toyota.com
 T: (519)212-5023
 F: (519)653-9638

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FERROGRAPHY REPORT

Machine Id
E-COAT OVEN DRIVE
 Component
Gearbox
 Fluid
SHELL OMALA 150 (--- GAL)

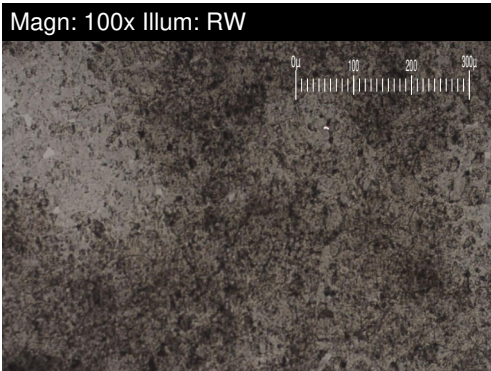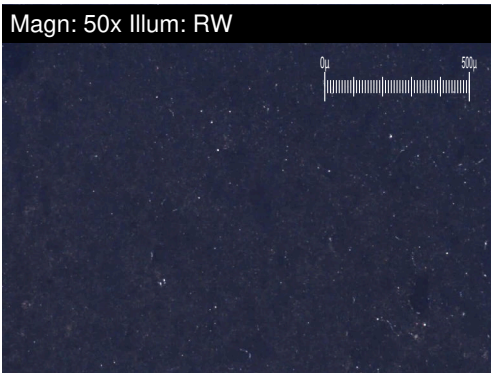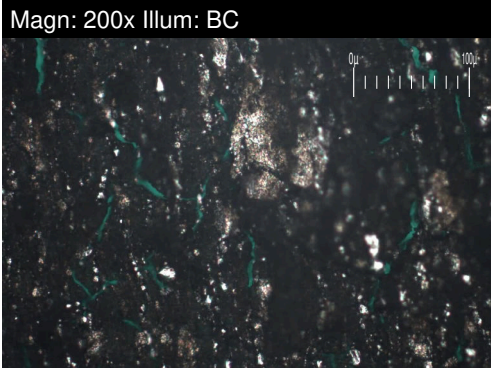


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		24.8	102.9	57.3
Small Particles		DR-Ferr*		12.2	57.3	36.6
Total Particles		DR-Ferr*	>---	37	160.2	93.9
Large Particles Percentage	%	DR-Ferr*		34.1	28.5	22
Severity Index		DR-Ferr*		312	4692	1186

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		▲ 1	■ 1	■ 2
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		▲ 4		■ 1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		■ 1		
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*		▲ 3		
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		■ 1	■ 1	■ 1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		■ 2		■ 2

WEAR

Wear particle analysis indicates that the ferrous rolling, ferrous rubbing and ferrous corrosive particles are abnormal.

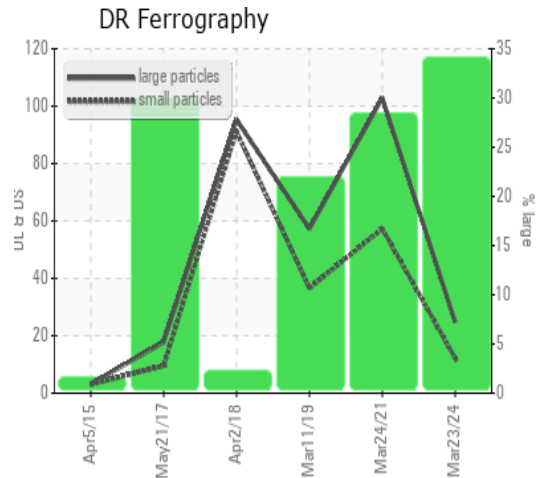

This page left intentionally blank