




OIL ANALYSIS REPORT

Sample Rating Trend

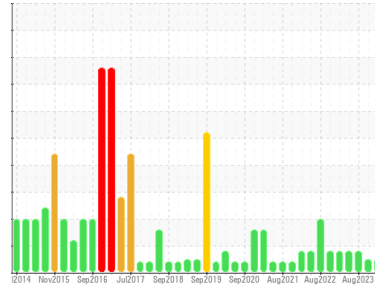

NORMAL



Area
T.M.B.
 Machine Id
5502-CWC-200 (S/N 17)

Component
2 Gearbox
 Fluid
CHEVRON CYLINDER OIL W ISO 680 (20 LTR)

DIAGNOSIS

Recommendation

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

Wear

Les taux d'usure de tous les composants sont normaux.

Contamination

La teneur en eau est négligeable. Il n'y a aucun indice de contamination dans l'huile.

Fluid Condition

Le AN est acceptable pour ce fluide. L'état de l'huile permet d'en prolonger l'utilisation.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0902406	WC0884533	WC0818931
Sample Date	Client Info		14 Mar 2024	06 Dec 2023	23 Aug 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	8	43
Iron	ppm	ASTM D5185(m) >200	16	20	92
Chromium	ppm	ASTM D5185(m) >15	0	0	<1
Nickel	ppm	ASTM D5185(m) >15	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	<1	0
Aluminum	ppm	ASTM D5185(m) >25	1	2	11
Lead	ppm	ASTM D5185(m) >100	0	0	0
Copper	ppm	ASTM D5185(m) >200	1	2	3
Tin	ppm	ASTM D5185(m) >25	0	0	0
Antimony	ppm	ASTM D5185(m) >5	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<1	<1	6
Barium	ppm	ASTM D5185(m)	0	<1	0
Molybdenum	ppm	ASTM D5185(m)	0	0	<1
Manganese	ppm	ASTM D5185(m)	0	0	<1
Magnesium	ppm	ASTM D5185(m)	<1	0	<1
Calcium	ppm	ASTM D5185(m)	0	<1	2
Phosphorus	ppm	ASTM D5185(m)	2	2	76
Zinc	ppm	ASTM D5185(m)	3	3	17
Sulfur	ppm	ASTM D5185(m)	3958	4118	7049
Lithium	ppm	ASTM D5185(m)	3	4	▲ 20

CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	1	3	2
Sodium	ppm	ASTM D5185(m)	<1	<1	4
Potassium	ppm	ASTM D5185(m) >20	<1	0	<1
Water	%	ASTM D6304* >0.2	0.002	0.004	0.011
ppm Water	ppm	ASTM D6304* >2000	17	41	114.0

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.69	0.75	0.87




OIL ANALYSIS REPORT

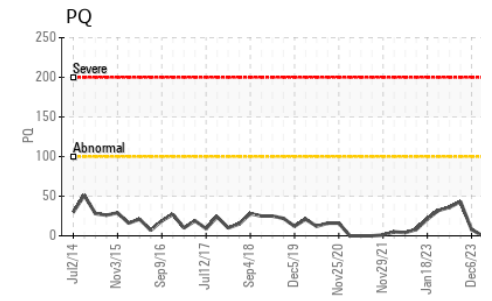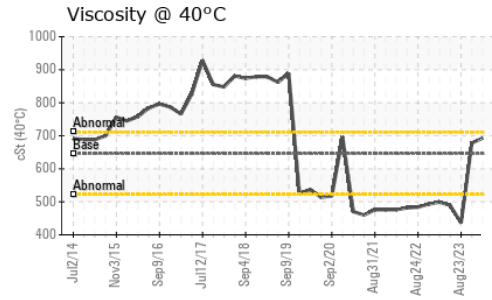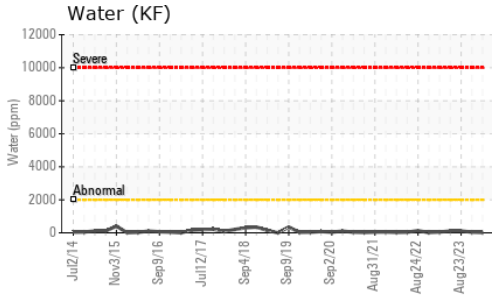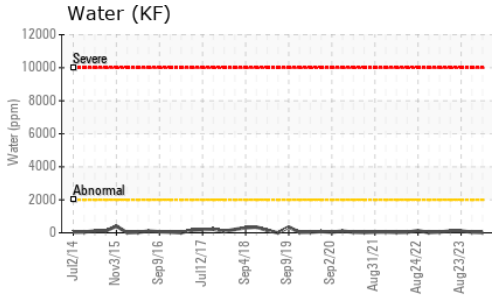






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m) 646	693	678	▲ 436

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

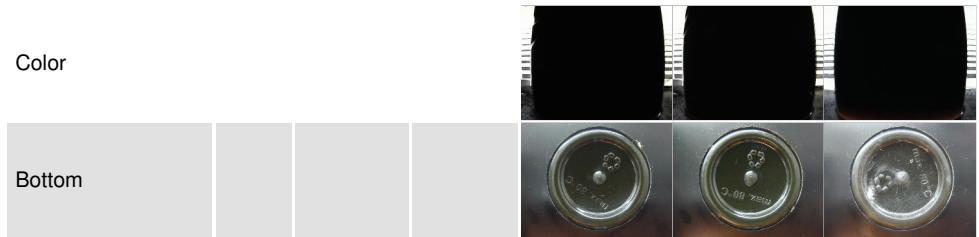

GRAPHS

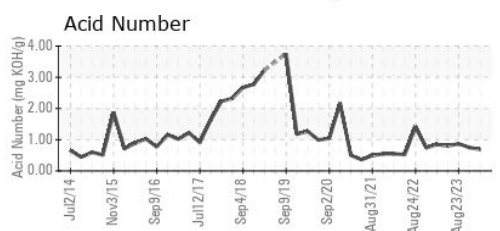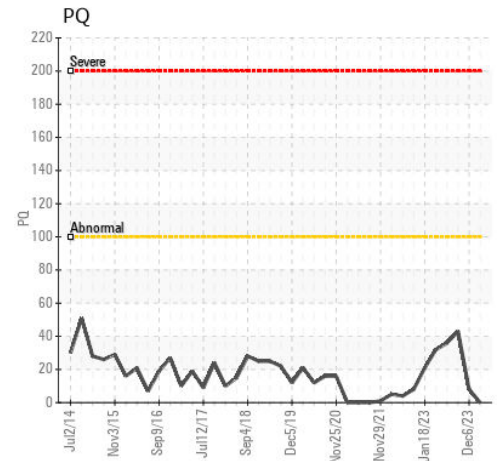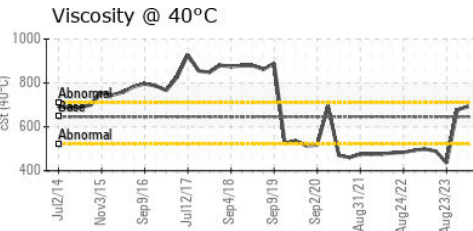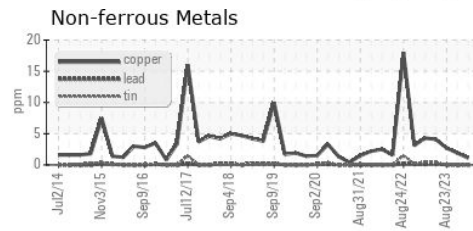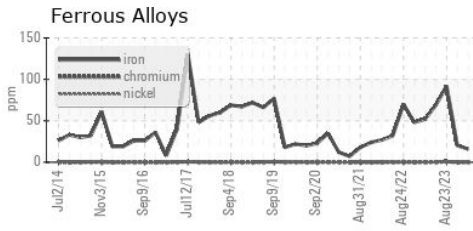

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0902406 **Received** : 08 Apr 2024
Lab Number : 02627526 **Tested** : 10 Apr 2024
Unique Number : 5760658 **Diagnosed** : 10 Apr 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: KF, TAN Man)

RTA - ALMA
 3000 RUE DES PINS OUEST, BATISSE 7103 MEZZALINE
 ALMA, QC
 CA G8B 6T3
 Contact: Guy Dufour
 guy.dufour-almacou@riotinto.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T:
 F: (418)480-6004