




OIL ANALYSIS REPORT

Area
Gary Steacy - G02900
 Machine ID
A2404017
 Component
Transformer Oil
 Fluid
{not provided} (--- GAL)

Sample Rating Trend

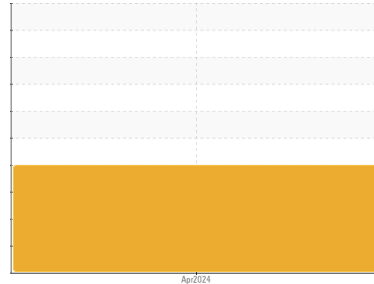

CONTAMINANT



DIAGNOSIS

▲ **Recommendation**
 The PCBs content is between 2.0 and 5.0 ppm.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Batch #	Client Info		2024 03 0700	---	---
Department	Client Info		Production	---	---
Sample From	Client Info		Machine	---	---
Production Stage	Client Info		Initial	---	---
Sent to WC	Client Info		04/04/2024	---	---
Sample Number	Client Info		E30001792	---	---
Sample Date	Client Info		03 Apr 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed		Client Info	N/A	---	---
Sample Status			ABNORMAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.0035	NEG	---	---



CONTAMINANTS

	method	limit/base	current	history1	history2
PCBs	ppm	EPA 8082(e)*	▲ 3.1	---	---

VISUAL



	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	VLITE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---

SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

OIL ANALYSIS REPORT

GRAPHS

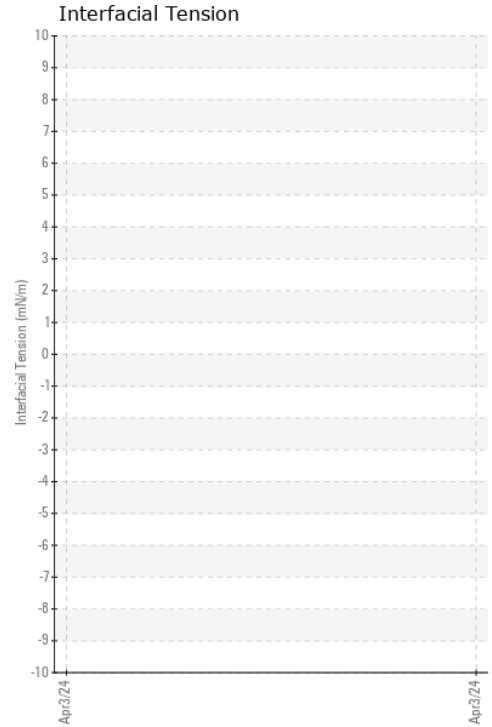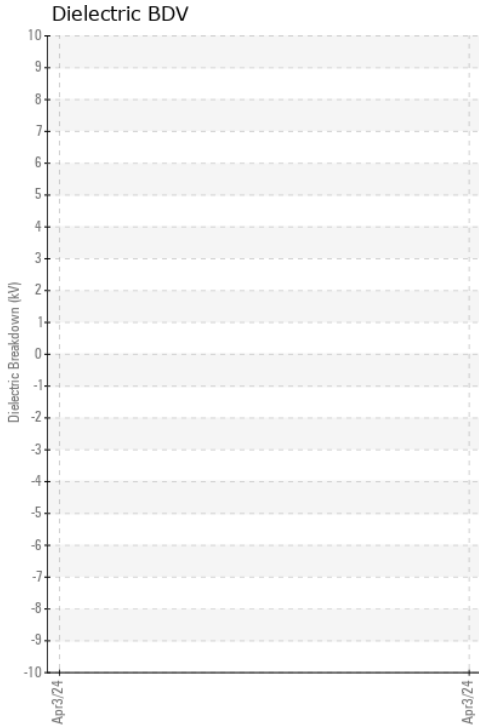

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : E30001792 **Received** : 08 Apr 2024
Lab Number : 02627548 **Tested** : 09 Apr 2024
Unique Number : 5760680 **Diagnosed** : 25 Apr 2024 - Tatiana Sorkina
Test Package : TEST (Additional Tests: PCBTransformer)

Environmental 360 Solutions Ltd.
 640 Victoria Street
 Cobourg, ON
 CA K9A 5H5
 Contact: Tatiana Sorkina
 tsorkina@e360s.ca
 T: (800)263-3939
 F: (905)373-4950

To discuss this sample report, contact Customer Service at 1-905-372-2251.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.