




OIL ANALYSIS REPORT

Sample Rating Trend

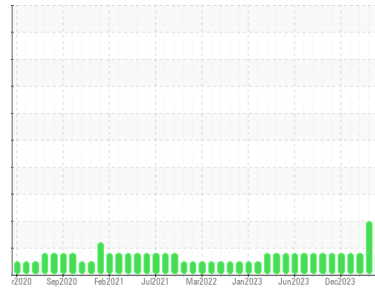

Machine Id
CO-GEN #1 (S/N KB5)
 Component
Turbine
 Fluid
MOBIL JET OIL II (130 GAL)

DIAGNOSIS

Recommendation
 We recommend an early resample to monitor this condition. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid.

Wear
 Copper ppm levels are abnormal.

Contamination
 The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0917344	WC0917342	WC0847665
Sample Date	Client Info			08 Apr 2024	21 Mar 2024	05 Feb 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>15	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>4	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	<1	0	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	0
Aluminum	ppm	ASTM D5185(m)	>10	0	0	<1
Lead	ppm	ASTM D5185(m)		0	0	<1
Copper	ppm	ASTM D5185(m)	>5	▲ 6	▲ 6	▲ 6
Tin	ppm	ASTM D5185(m)	>5	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0.5	1	<1	<1
Barium	ppm	ASTM D5185(m)	0.0	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0.0	0	0	0
Manganese	ppm	ASTM D5185(m)	0.0	0	0	0
Magnesium	ppm	ASTM D5185(m)	0.0	0	0	<1
Calcium	ppm	ASTM D5185(m)	0.0	0	0	7
Phosphorus	ppm	ASTM D5185(m)	3039	1522	1526	1661
Zinc	ppm	ASTM D5185(m)	0.3	3	3	5
Sulfur	ppm	ASTM D5185(m)	38	4	3	0
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	0	0	<1
Sodium	ppm	ASTM D5185(m)		<1	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	0	<1	<1
Water	%	ASTM D6304*	>.1	0.012	0.011	0.011
ppm Water	ppm	ASTM D6304*	>1000	124	113	112

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	241	▲ 6303	492
Particles >6µm		ASTM D7647	>640	77	▲ 1369	151
Particles >14µm		ASTM D7647	>80	11	77	12
Particles >21µm		ASTM D7647	>20	3	18	4
Particles >38µm		ASTM D7647	>4	1	1	0
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>18/16/13	15/13/11	▲ 20/18/13	16/14/11



OIL ANALYSIS REPORT

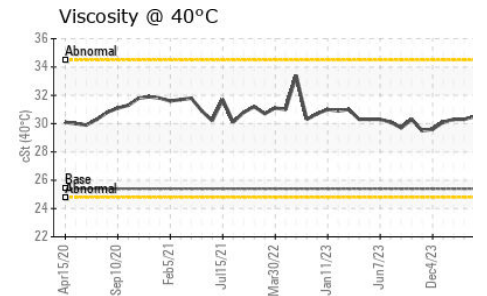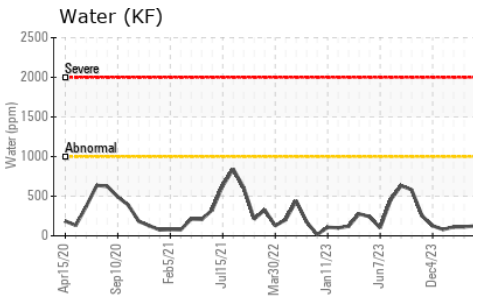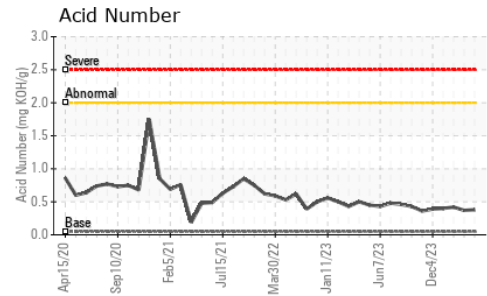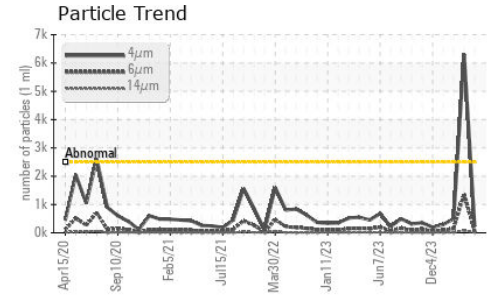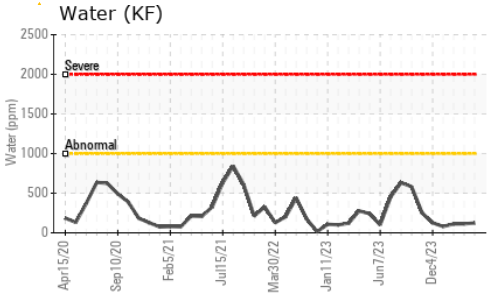


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.05	0.38	0.37	0.42






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	25.4	30.5	30.3	30.3

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

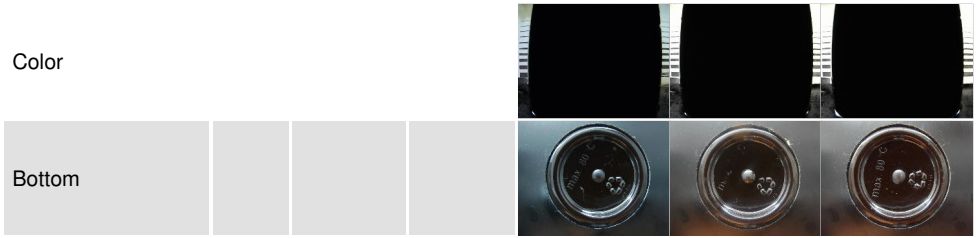

GRAPHS

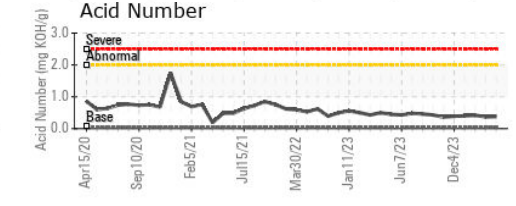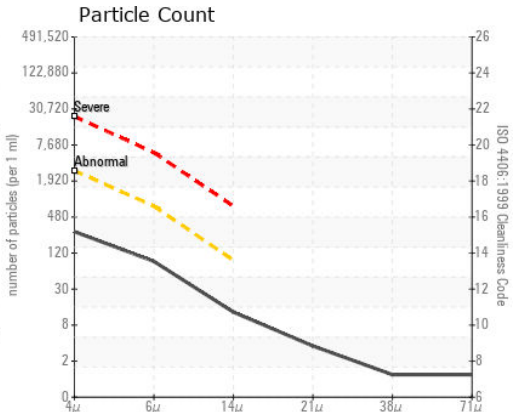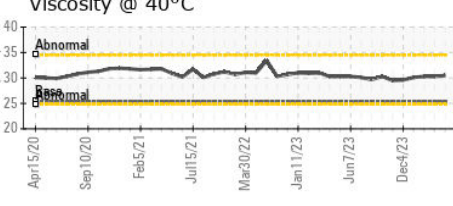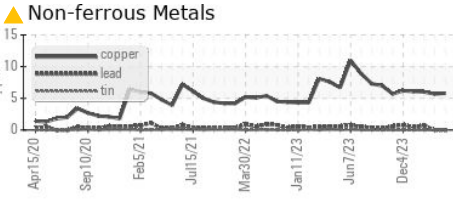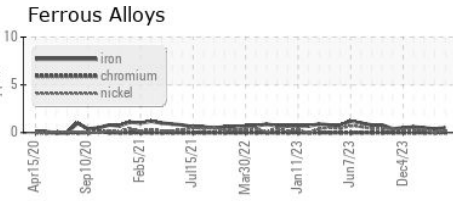

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0917344 **Received** : 11 Apr 2024
Lab Number : **02628158** **Tested** : 12 Apr 2024
Unique Number : 5761290 **Diagnosed** : 12 Apr 2024 - Kevin Marson
Test Package : IND 2

SANOI PASTEUR LIMITED
 1755 STEELES AVENUE WEST
 TORONTO, ON
 CA M2R 3T4
 Contact: Steven Joki
 steven.joki@sanofi.com
 T: (416)667-2701
 F: (416)667-2720

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.