




OIL ANALYSIS REPORT

Sample Rating Trend

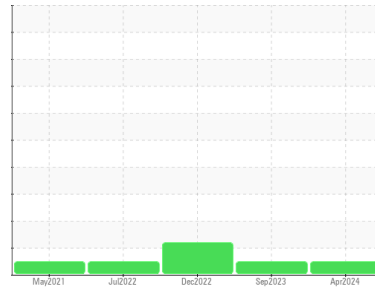

NORMAL



Machine Id
FRICK ER3-C3
 Component
Screw Compressor
 Fluid
FRICK COMPRESSOR OIL #3 (250 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0525884	WC0592159	WC0592165
Sample Date	Client Info			10 Apr 2024	26 Sep 2023	08 Dec 2022
Machine Age	hrs	Client Info		48092	24357	17990
Oil Age	hrs	Client Info		8596	0	17990
Oil Changed	Client Info			N/A	N/A	Filtered
Sample Status				NORMAL	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>60	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>4	0	0	0
Nickel	ppm	ASTM D5185(m)		0	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	<1	0
Aluminum	ppm	ASTM D5185(m)	>5	0	0	0
Lead	ppm	ASTM D5185(m)	>10	0	<1	0
Copper	ppm	ASTM D5185(m)	>30	<1	<1	0
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		0	<1	<1
Barium	ppm	ASTM D5185(m)		6	5	4
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		0	0	0
Calcium	ppm	ASTM D5185(m)		0	0	0
Phosphorus	ppm	ASTM D5185(m)		<1	0	0
Zinc	ppm	ASTM D5185(m)		3	2	1
Sulfur	ppm	ASTM D5185(m)		18	19	22
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>50	0	<1	<1
Sodium	ppm	ASTM D5185(m)		<1	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	0	0	<1
Water	%	ASTM D6304*	>0.1	0.001	0.001	0.001
ppm Water	ppm	ASTM D6304*	>1000	4	1.4	2.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	2408	3721	17950
Particles >6µm		ASTM D7647	>2500	813	1250	4803
Particles >14µm		ASTM D7647	>320	85	128	209
Particles >21µm		ASTM D7647	>80	19	35	43
Particles >38µm		ASTM D7647	>20	2	1	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/17/14	19/17/14	21/19/15



OIL ANALYSIS REPORT

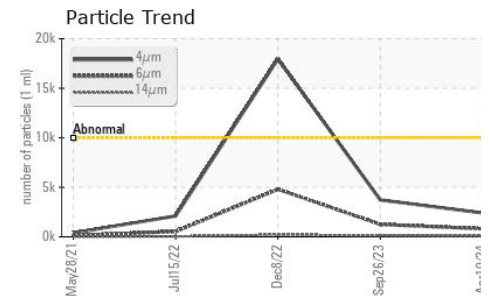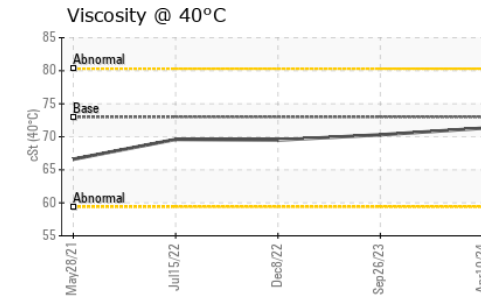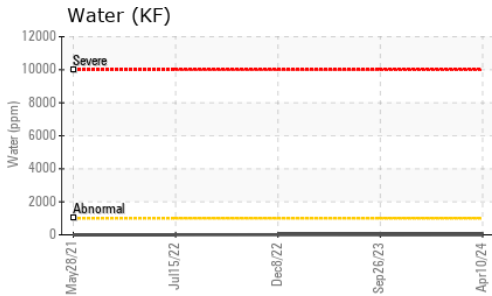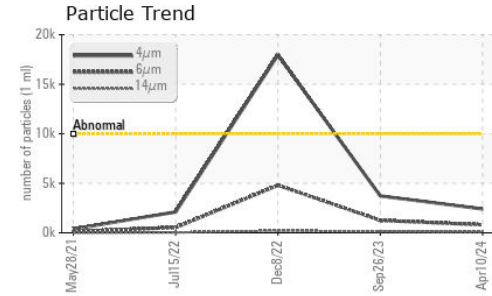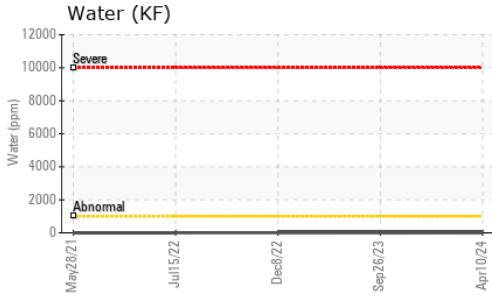


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.00	0.00	0.01






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	73	71.3	70.3	69.5

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

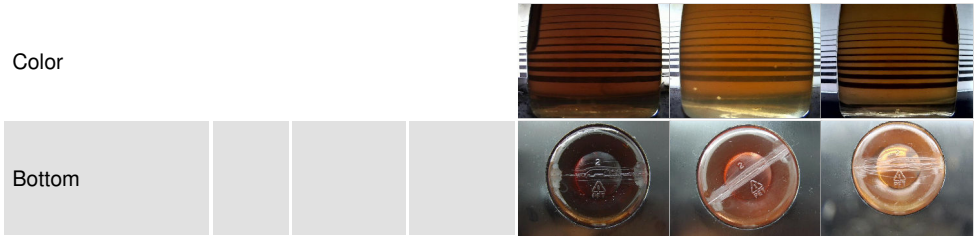

GRAPHS

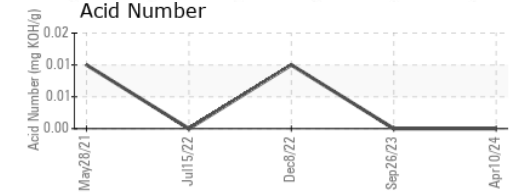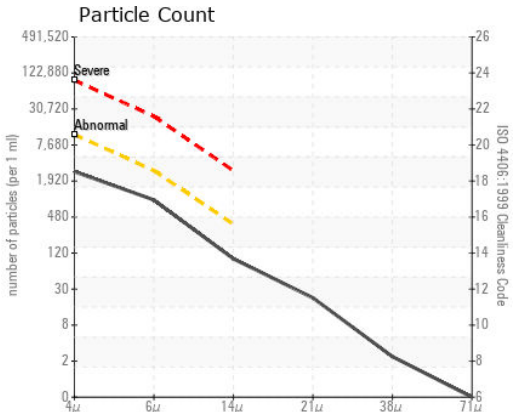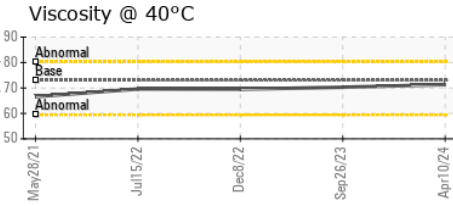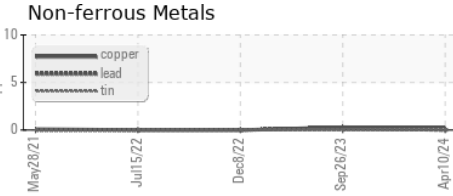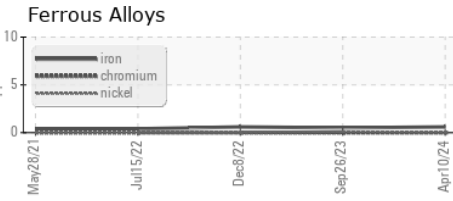

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0525884 **Received** : 12 Apr 2024
Lab Number : **02628474** **Tested** : 15 Apr 2024
Unique Number : 5761606 **Diagnosed** : 15 Apr 2024 - Wes Davis
Test Package : IND 2 (Additional Tests: KF)

CONESTOGA COLD STORAGE
 299 TRILLIUM DR.
 KITCHENER, ON
 CA N2E 1W9
 Contact: Geoff Ditner
 gditner@coldstorage.com
 T: (519)748-5892
 F: (519)748-5208

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.