




OIL ANALYSIS REPORT

Sample Rating Trend

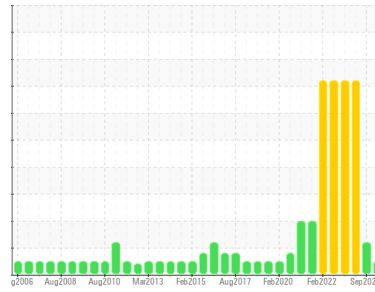

NORMAL



Area
Kingsbridge SP-13584
 Machine ID
T8
 Component
Wind Turbine Gearbox
 Fluid
CHEVRON PINNACLE WM 320 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.
 NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC	WC0546236	WC0783146
Sample Date	Client Info		07 Feb 2024	21 Sep 2023	31 Jul 2023
Machine Age	yrs	Client Info	0	0	0
Oil Age	yrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	ABNORMAL	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*	>50	0	0	0
Iron	ppm	ASTM D5185(m) >75	51	41	▲ 114
Chromium	ppm	ASTM D5185(m) >5	<1	<1	1
Nickel	ppm	ASTM D5185(m) >10	<1	<1	<1
Titanium	ppm	ASTM D5185(m) >10	0	0	0
Silver	ppm	ASTM D5185(m)	0	<1	0
Aluminum	ppm	ASTM D5185(m) >10	0	0	0
Lead	ppm	ASTM D5185(m) >15	0	<1	<1
Copper	ppm	ASTM D5185(m) >10	2	3	2
Tin	ppm	ASTM D5185(m) >10	0	0	0
Antimony	ppm	ASTM D5185(m) >5	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<1	<1	<1
Barium	ppm	ASTM D5185(m) 0	0	0	0
Molybdenum	ppm	ASTM D5185(m) 0	0	0	0
Manganese	ppm	ASTM D5185(m)	<1	0	1
Magnesium	ppm	ASTM D5185(m) 0	0	0	<1
Calcium	ppm	ASTM D5185(m) 0	<1	<1	1
Phosphorus	ppm	ASTM D5185(m) 300	261	262	273
Zinc	ppm	ASTM D5185(m) 0	7	8	19
Sulfur	ppm	ASTM D5185(m) 8000	7107	7239	7310
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >10	0	<1	2
Sodium	ppm	ASTM D5185(m) >10	2	3	7
Potassium	ppm	ASTM D5185(m) >20	0	0	<1
Water	%	ASTM D6304* >0.02	0.004	0.004	0.007
ppm Water	ppm	ASTM D6304* >200	46	42	79.0

INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	0	0	0
Nitration	Abs/cm	ASTM D7624*	2.0	1.9	2.2
Sulfation	Abs/.1mm	ASTM D7415*	28.0	28.0	28.7

OIL ANALYSIS REPORT


FT-IR (Direct Trend)

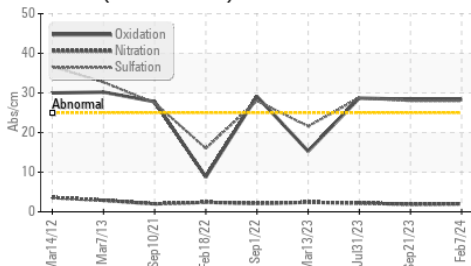


Particle Count

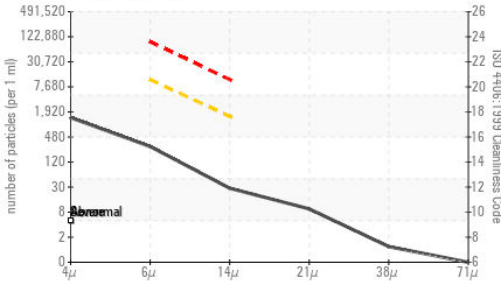


Acid Number

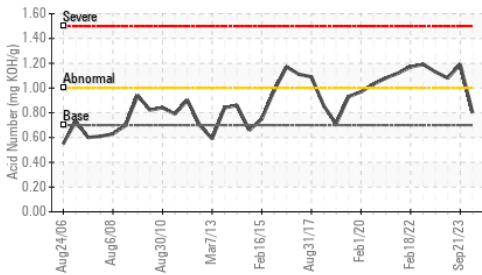

Water (KF)

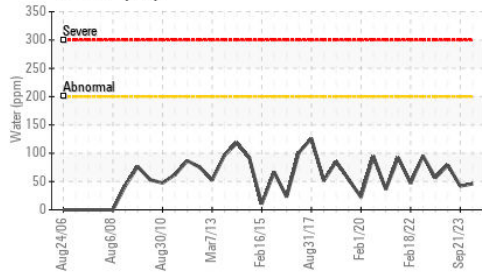

Viscosity @ 100°C

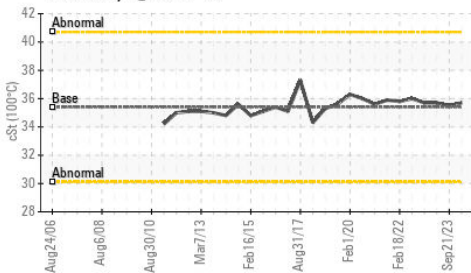


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		1228	3095	304
Particles >6µm	ASTM D7647	>10000	249	829	89
Particles >14µm	ASTM D7647	>1300	25	57	12
Particles >21µm	ASTM D7647	>320	8	14	6
Particles >38µm	ASTM D7647	>80	1	0	3
Particles >71µm	ASTM D7647	>20	0	0	2
Oil Cleanliness	ISO 4406 (c)	>--/20/17	17/15/12	19/17/13	15/14/11

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414*		28.3	28.4	28.7
Acid Number (AN)	mg KOH/g ASTM D974*	0.7	0.80	▲ 1.19	▲ 1.08

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	VLITE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	VLITE	NONE
Sand/Dirt	scalar Visual*	NONE	VLITE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>0.02	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	319	323	323	325
Visc @ 100°C	cSt ASTM D7279(m)	35.4	35.7	35.5	35.7
Viscosity Index (VI)	Scale ASTM D2270*	156	156	155	156

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

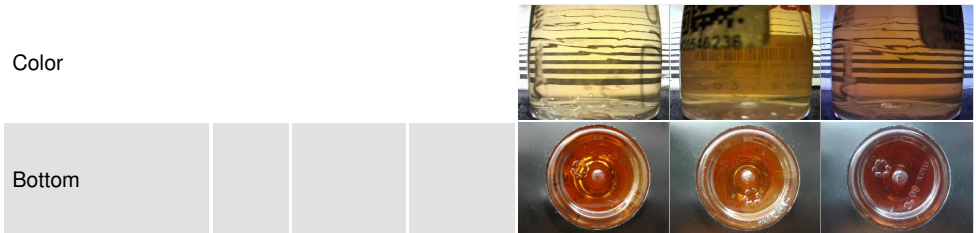

Color

Bottom

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **Vestas American Wind Technology Inc.**
Sample No. : WC **Received** : 15 Apr 2024 1417 NW Everett Street
Lab Number : 02628994 **Tested** : 17 Apr 2024 Portland, OR
Unique Number : 5762126 **Diagnosed** : 17 Apr 2024 - Kevin Marson US 97209
Test Package : IND 2 (Additional Tests: FT-IR, KF, KV100, PQ, PrtCount, TAN Man, VI) **Contact:** Nicole Philippi
NiPhi@vestas.com
T: (503)327-7683
F: (503)327-0247

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

