OIL ANALYSIS REPORT

Sample Rating Trend

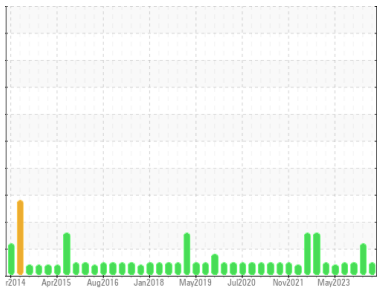

NORMAL

Area
1
Machine Id
1-3-2030
Component
Air Compressor
Fluid
GARDNER DENVER AEON 4000 (200 LTR)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0925305**	WC0901995	WC0869848
Sample Date		Client Info		**02 Apr 2024**	13 Feb 2024	23 Oct 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**NORMAL**	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		**0**	0	0
Iron	ppm	ASTM D5185(m)	>50	**<1**	5	0
Chromium	ppm	ASTM D5185(m)	>4	**0**	0	0
Nickel	ppm	ASTM D5185(m)	>4	**0**	0	<1
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**0**	0	<1
Aluminum	ppm	ASTM D5185(m)	>10	**0**	1	0
Lead	ppm	ASTM D5185(m)	>20	**0**	4	0
Copper	ppm	ASTM D5185(m)	>40	**2**	3	1
Tin	ppm	ASTM D5185(m)	>5	**0**	0	0
Antimony	ppm	ASTM D5185(m)		**2**	▲ 30	0
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0.2	**0**	0	<1
Barium	ppm	ASTM D5185(m)	0.0	**0**	0	<1
Molybdenum	ppm	ASTM D5185(m)	0.0	**0**	0	0
Manganese	ppm	ASTM D5185(m)	0.0	**0**	0	0
Magnesium	ppm	ASTM D5185(m)	0.0	**0**	<1	0
Calcium	ppm	ASTM D5185(m)	0.0	**<1**	● 10	2
Phosphorus	ppm	ASTM D5185(m)	312	**3**	1	<1
Zinc	ppm	ASTM D5185(m)	0.0	**1**	● 16	<1
Sulfur	ppm	ASTM D5185(m)	1629	**2504**	1985	2152
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	**0**	9	1
Sodium	ppm	ASTM D5185(m)		**0**	3	<1
Potassium	ppm	ASTM D5185(m)	>20	**<1**	12	0
Water	%	ASTM D6304*	>0.6	**0.002**	0.287	0.002
ppm Water	ppm	ASTM D6304*	>6000	**16**	2873	18
Glycol	%	ASTM D7922*		**0.0**	0.0	0.0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.03	**0.05**	0.18	0.10

OIL ANALYSIS REPORT

Glycol Contamination

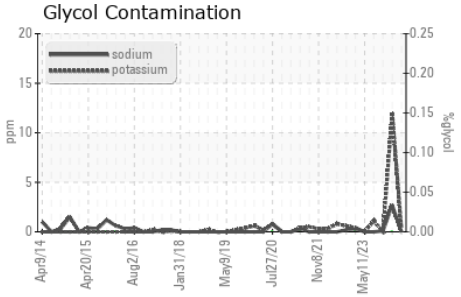

Water (KF)

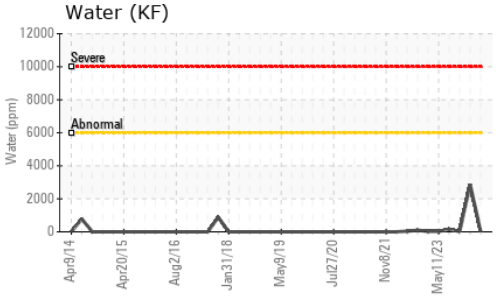

Acid Number

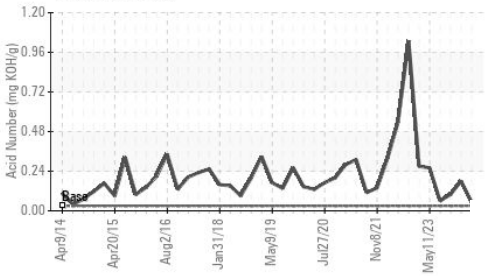

Viscosity @ 40°C

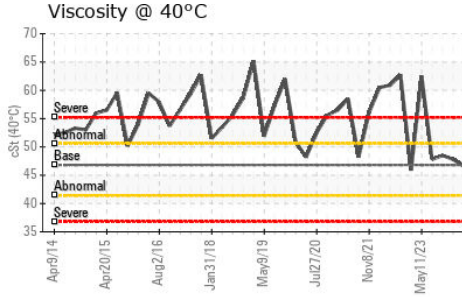

PQ

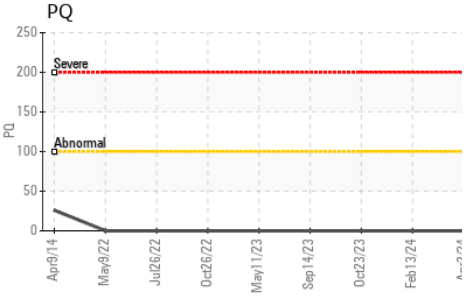

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**VLITE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**NORML**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>0.6	**NEG**	.2%	NEG
Free Water	scalar	Visual*		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	46.8	**46.6**	47.8	48.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

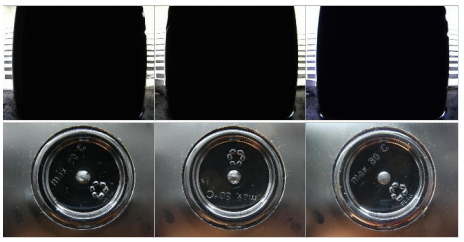

GRAPHS

Ferrous Alloys

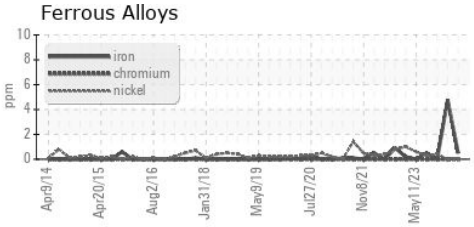

Non-ferrous Metals

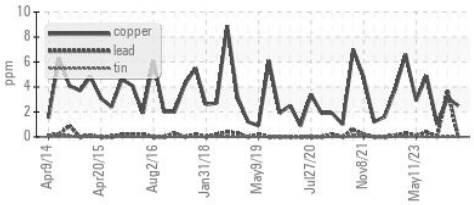

Viscosity @ 40°C

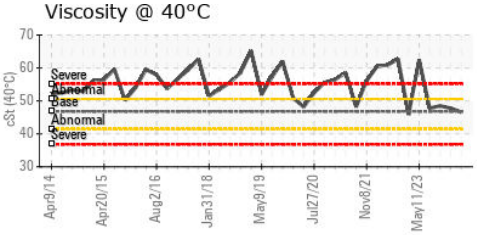

PQ

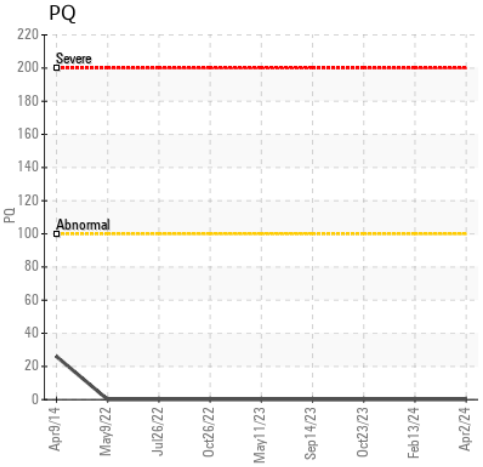

Acid Number

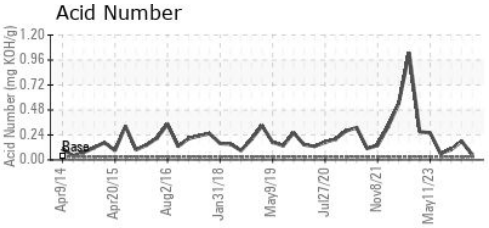

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0925305 **Received** : 16 Apr 2024
Lab Number : 02629230 **Tested** : 17 Apr 2024
Unique Number : 5762362 **Diagnosed** : 17 Apr 2024 - Wes Davis
Test Package : IND 2 (Additional Tests: Glycol, KF, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

ST. MARYS CEMENT CO.
400 BOWMANVILLE AVENUE
BOWMANVILLE, ON
CA L1C 7B5
Contact: Lou Traiforos
lou.traiforos@vcimentos.com
T: (905)440-5874
F: (905)623-4695