OIL ANALYSIS REPORT

Sample Rating Trend

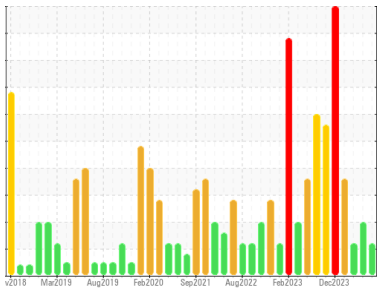

ISO

Area
BOF/OG SYSTEM
Machine Id
D - O.G. Fan Lube System # 8
Component
Lube System
Fluid
PETRO CANADA HYDREX AW 100 (135 GAL)

DIAGNOSIS

Recommendation
We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear
All component wear rates are normal.

Contamination
There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0934084**	WC0926484	WC0910450
Sample Date		Client Info		**15 Apr 2024**	22 Mar 2024	16 Feb 2024
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.05	**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*	>99999	**0**	0	0
Iron	ppm	ASTM D5185(m)	>20	**3**	1	1
Chromium	ppm	ASTM D5185(m)	>20	**0**	0	0
Nickel	ppm	ASTM D5185(m)	>20	**0**	0	0
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**0**	0	0
Aluminum	ppm	ASTM D5185(m)	>20	**0**	0	<1
Lead	ppm	ASTM D5185(m)	>20	**0**	0	<1
Copper	ppm	ASTM D5185(m)	>20	**<1**	<1	<1
Tin	ppm	ASTM D5185(m)	>20	**0**	0	0
Antimony	ppm	ASTM D5185(m)		**0**	0	0
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	**<1**	0	0
Barium	ppm	ASTM D5185(m)	0	**0**	0	0
Molybdenum	ppm	ASTM D5185(m)	0	**0**	0	0
Manganese	ppm	ASTM D5185(m)	0	**0**	0	0
Magnesium	ppm	ASTM D5185(m)	0	**<1**	<1	<1
Calcium	ppm	ASTM D5185(m)	50	**46**	48	49
Phosphorus	ppm	ASTM D5185(m)	330	**327**	324	340
Zinc	ppm	ASTM D5185(m)	430	**418**	423	425
Sulfur	ppm	ASTM D5185(m)	760	**2808**	2574	2935
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	**3**	2	4
Sodium	ppm	ASTM D5185(m)		**0**	0	0
Potassium	ppm	ASTM D5185(m)	>20	**0**	0	<1

OIL ANALYSIS REPORT

Particle Count

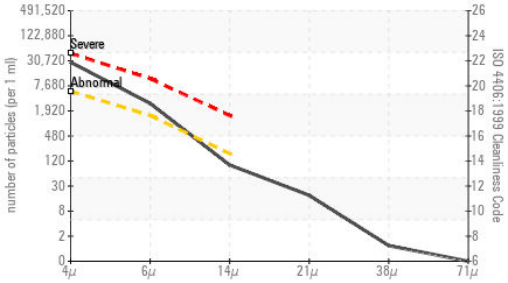

Particle Trend

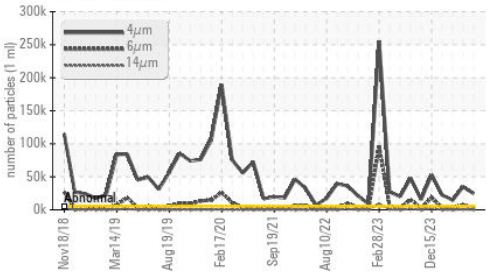

Acid Number

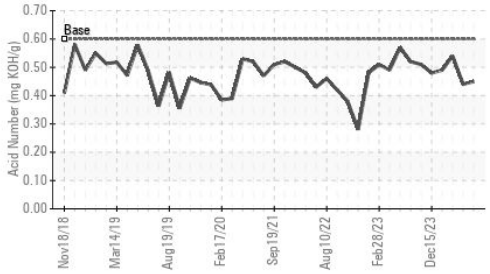

Viscosity @ 40°C

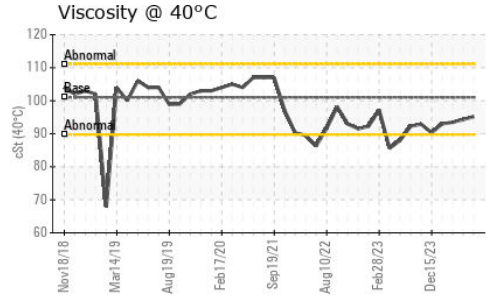

PQ

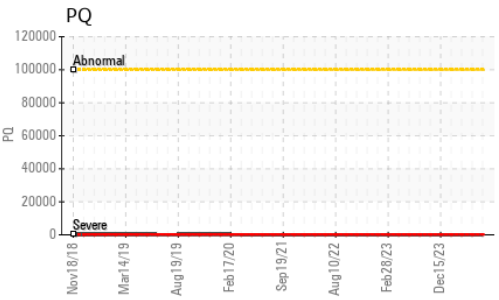

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	▲ **24541**	▲ 34936	▲ 14564
Particles >6µm		ASTM D7647	>1300	▲ **2541**	▲ 7678	● 1777
Particles >14µm		ASTM D7647	>160	**85**	▲ 683	123
Particles >21µm		ASTM D7647	>40	**16**	▲ 181	36
Particles >38µm		ASTM D7647	>10	**1**	8	5
Particles >71µm		ASTM D7647	>3	**0**	1	1
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ **22/19/14**	▲ 22/20/17	▲ 21/18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.60	**0.45**	0.44	0.54

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**VLITE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**VLITE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**NORML**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	**NEG**	NEG	NEG
Free Water	scalar	Visual*		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	101	**95.2**	94.3	93.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			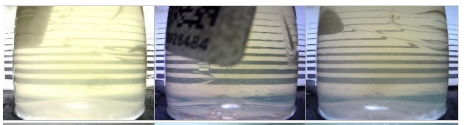		
Bottom			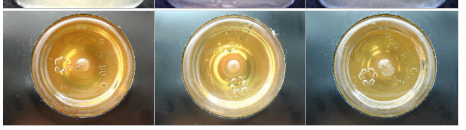		

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0934084
Lab Number : 02629319
Unique Number : 5762451
Test Package : IND 2 (Additional Tests: PQ, TAN Man)

Received : 16 Apr 2024
Tested : 17 Apr 2024
Diagnosed : 17 Apr 2024 - Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

STELCO - BOSC - Basic Oxygen Slab Caster
2330 Regional Road #3, Door: BOSC8
NANTICOKE, ON
CA N0A 1L0
Contact: Tom Walden
Thomas.Walden@stelco.com
T: (519)587-4541
F: (519)587-7702

Report Id: LEWBOSC [WCAMIS] 02629319 (Generated: 04/17/2024 14:58:38) Rev: 1

Submitted By: Bob Melanson