




OIL ANALYSIS REPORT

Sample Rating Trend

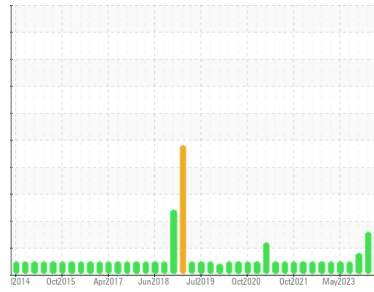

WEAR



Area

8

Machine Id

8-301-MC FM#1 Trunion - Discharge End

Component

Journal Bearing

Fluid

MOBIL MOBILGEAR SHC 460 (350 LTR)

DIAGNOSIS

Recommendation

We recommend an early resample to monitor this condition.

Wear

Aluminum ppm levels are marginal. All other component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0925386	WC0902118	WC0869929
Sample Date	Client Info		04 Apr 2024	21 Feb 2024	29 Nov 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			MARGINAL	ABNORMAL	MARGINAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>2	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >60	10	13	11
Chromium	ppm	ASTM D5185(m) >20	0	0	0
Nickel	ppm	ASTM D5185(m) >20	0	0	<1
Titanium	ppm	ASTM D5185(m)	<1	0	0
Silver	ppm	ASTM D5185(m)	0	0	<1
Aluminum	ppm	ASTM D5185(m) >4	5	6	5
Lead	ppm	ASTM D5185(m) >250	1	2	3
Copper	ppm	ASTM D5185(m) >125	2	3	3
Tin	ppm	ASTM D5185(m) >80	27	34	35
Antimony	ppm	ASTM D5185(m)	4	5	5
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 5.7	6	8	6
Barium	ppm	ASTM D5185(m) 0.0	0	0	<1
Molybdenum	ppm	ASTM D5185(m) 0.0	0	0	0
Manganese	ppm	ASTM D5185(m) 0.0	0	0	0
Magnesium	ppm	ASTM D5185(m) 0.0	4	4	3
Calcium	ppm	ASTM D5185(m) 0.0	95	92	94
Phosphorus	ppm	ASTM D5185(m) 180	323	334	319
Zinc	ppm	ASTM D5185(m) 0.8	1	1	1
Sulfur	ppm	ASTM D5185(m) 4270	4628	4876	5190
Lithium	ppm	ASTM D5185(m)	<1	<1	<1


CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	13	15	14
Sodium	ppm	ASTM D5185(m)	<1	<1	<1
Potassium	ppm	ASTM D5185(m) >20	5	5	4


FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		218736	1847520	183048
Particles >6µm	ASTM D7647	>320000	172145	743949	154334
Particles >14µm	ASTM D7647	>160000	19714	6987	37911
Particles >21µm	ASTM D7647	>40000	492	263	3840
Particles >38µm	ASTM D7647	>10000	2	0	3
Particles >71µm	ASTM D7647	>2500	1	0	1
Oil Cleanliness	ISO 4406 (c)	>--/25/24	25/25/21	28/27/20	25/24/22


Aluminum (ppm)

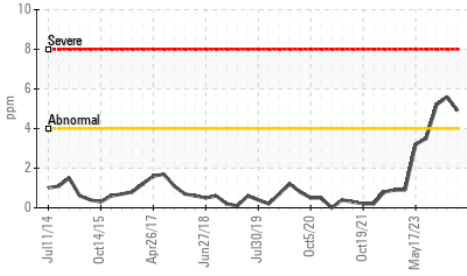


Particle Trend

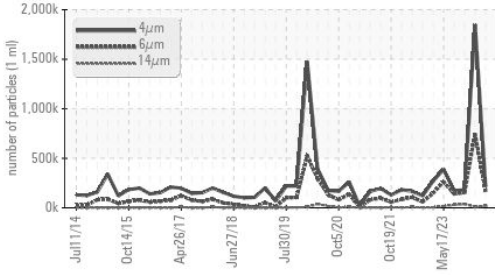


Acid Number

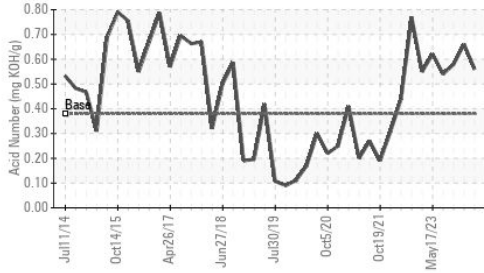

Viscosity @ 40°C

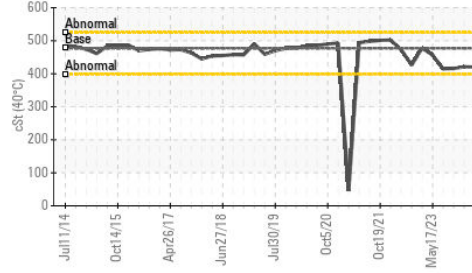

Particle Trend

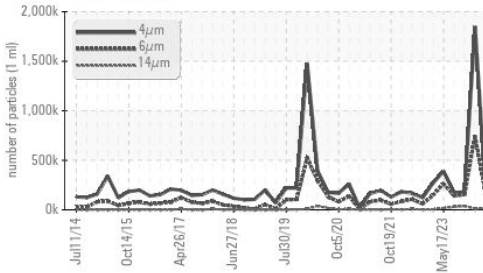

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN) mg KOH/g	ASTM D974*	0.38	0.56	0.66	0.58


VISUAL

method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	VLITE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	VLITE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES


method	limit/base	current	history1	history2		
Visc @ 40°C	cSt	ASTM D7279(m)	477	420	421	416

SAMPLE IMAGES

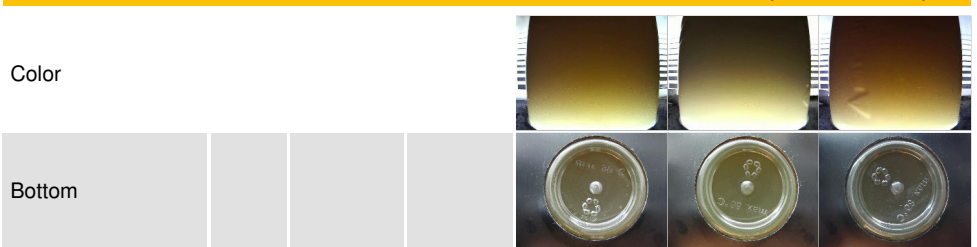


GRAPHS


Ferrous Alloys

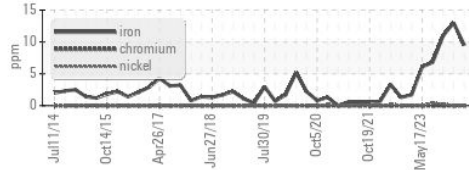


Non-ferrous Metals

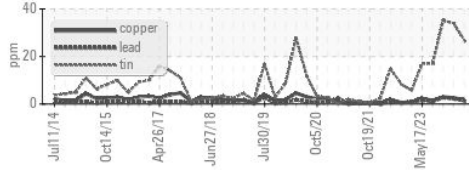


Viscosity @ 40°C

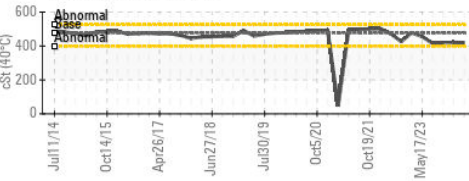

Particle Count

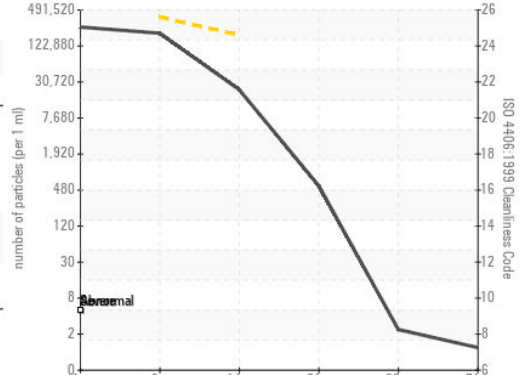

Acid Number

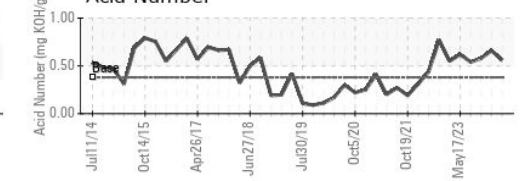

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0925386 **Received** : 16 Apr 2024
Lab Number : **02629341** **Tested** : 17 Apr 2024
Unique Number : 5762473 **Diagnosed** : 17 Apr 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

ST. MARYS CEMENT CO.
 400 BOWMANVILLE AVENUE
 BOWMANVILLE, ON
 CA L1C 7B5
 Contact: Lou Traiforos
 lou.traiforos@vcimentos.com
 T: (905)440-5874
 F: (905)623-4695