

# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**2155334**  
Component  
**Diesel Engine**  
Fluid  
**SAE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WA0020873</b>	---	---
Sample Date	Client Info			<b>13 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>21</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>Not Chngd</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	---	---
Water	WC Method	>0.2		<b>NEG</b>	---	---
Glycol	WC Method			<b>NEG</b>	---	---



WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	<b>1</b>	---	---
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)	>4	<b>0</b>	---	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185(m)	>40	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m)	>330	<b>1</b>	---	---
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m)		<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>9</b>	---	---
Barium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)		<b>54</b>	---	---
Manganese	ppm	ASTM D5185(m)		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)		<b>907</b>	---	---
Calcium	ppm	ASTM D5185(m)		<b>1057</b>	---	---
Phosphorus	ppm	ASTM D5185(m)		<b>961</b>	---	---
Zinc	ppm	ASTM D5185(m)		<b>1119</b>	---	---
Sulfur	ppm	ASTM D5185(m)		<b>2507</b>	---	---
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<b>2</b>	---	---
Sodium	ppm	ASTM D5185(m)	>57	<b>1</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	---	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>4.2</b>	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>16.8</b>	---	---

# OIL ANALYSIS REPORT

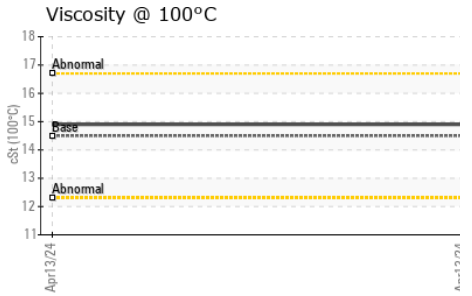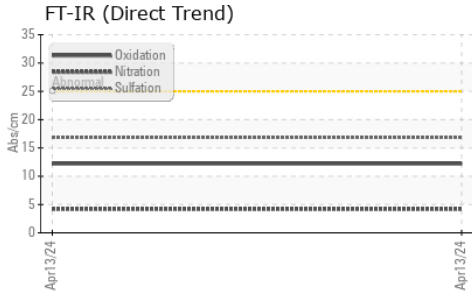

### FLUID DEGRADATION

method	limit/base	current	history1	history2	
Oxidation	Abs./1mm ASTM D7414*	>25	12.2	---	---









### VISUAL

method	limit/base	current	history1	history2	
Emulsified Water	scalar Visual*	>0.2	NEG	---	---
Free Water	scalar Visual*		NEG	---	---

### FLUID PROPERTIES

method	limit/base	current	history1	history2	
Visc @ 100°C	cSt ASTM D7279(m)	14.5	14.9	---	---

### GRAPHS

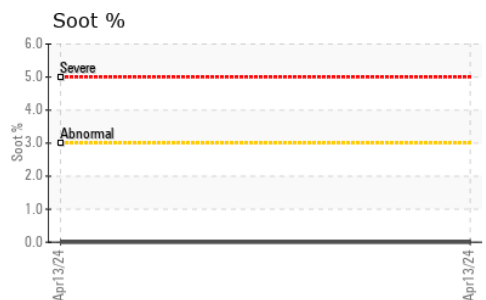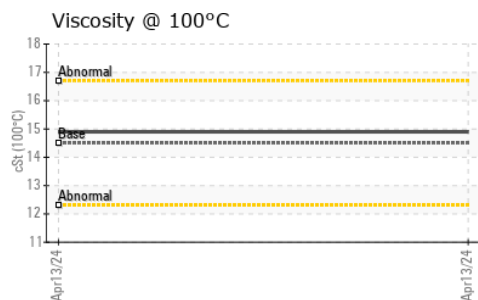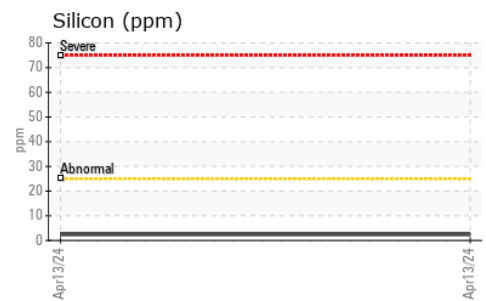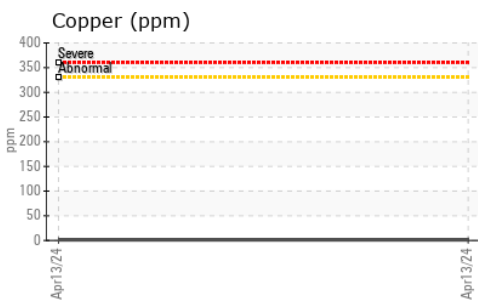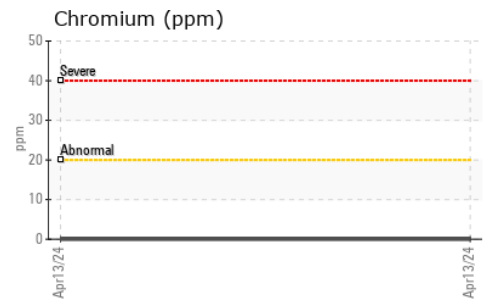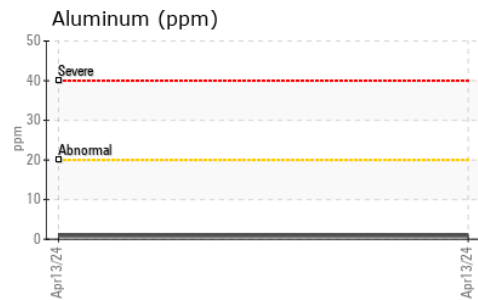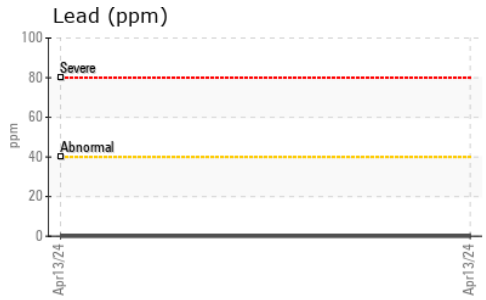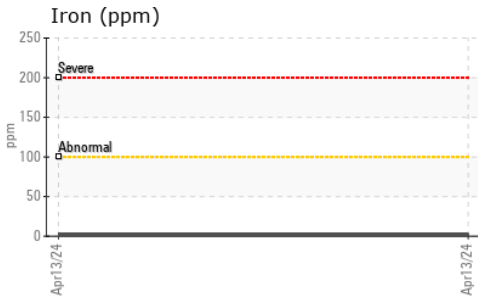

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0020873 **Received** : 22 Apr 2024  
**Lab Number** : 02630535 **Tested** : 22 Apr 2024  
**Unique Number** : 5763667 **Diagnosed** : 22 Apr 2024 - Kevin Marson  
**Test Package** : MOB 1

**Wajax Power Systems**  
 70 Raddall Avenue  
 Dartmouth, NS  
 CA B3B 1T7  
 Contact: Danelle Hoffman  
 dhoffman@wajax.com  
 T: (902)468-6200  
 F: (902)468-3325

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.