


## **COOLANT REPORT**

# **UNASSIGNED** [700017422]

208138

Coolant

**CATERPILLAR ELC (--- GAL)** 

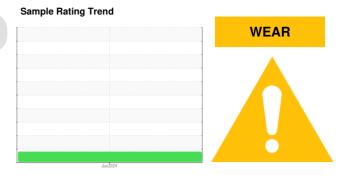

### **DIAGNOSIS**

#### Recommendation

We recommend drain system, and refill with 50/50 antifreeze water mixture. We advise that you replenish the supplemental coolant additives (SCAs) and add per manufacturer's specifications. We recommend an early resample to monitor this condition.

#### Corrosion

Copper ppm levels are abnormal. The high metal levels indicate corrosion in the system.

There is no indication of any contamination in the coolant.


#### **Coolant Condition**

The nitrite level is acceptable. The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0952373		
Sample Date		Client Info		07 Jun 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
PHYSICAL TEST F	RESULTS	method	limit/base	current	history1	history2
Glycol Type		FT-IR		UNK		
Specific Gravity		ASTM D1298*	1.070	1.077		
pH	Scale 0-14	ASTM D1287*	8.3	7.78		
Nitrites	ppm	Alcan Test Kit*	550	560		
Reserve Alkalinity	Scale 0-20	ASTM D1121*	5.5	3.9		
Percentage Glycol	%	ASTM D3321*	50	57.9		
Freezing Point	°C	ASTM D3321*	-37	-47		
Carboxylate						
CORROSION INH	IBITORS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	0	5		
Phosphorus	ppm	ASTM D5185(m)	0	24		
Boron	ppm	ASTM D5185(m)	0	79		
Molybdenum	ppm	ASTM D5185(m)	950	58		
CORROSION		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>15	0		
Aluminum	ppm	ASTM D5185(m)	>10	0		
Copper	ppm	ASTM D5185(m)	>10	<u> </u>		
Lead	ppm	ASTM D5185(m)	>10	0		
Tin	ppm	ASTM D5185(m)	>10	0		
Silver	ppm	ASTM D5185(m)	>10	<1		
Zinc	ppm	ASTM D5185(m)		<1		
CARRIER SALTS	;	method	limit/base	current	history1	history2
Sodium	ppm	ASTM D5185(m)		6157		
Potassium	ppm	ASTM D5185(m)		320		
SCALE POTENTI	AL	method	limit/base	current	history1	history2
SCALE POTENTI Calcium	AL ppm	method ASTM D5185(m)	limit/base >100	current 2	history1	history2
						history2



# **COOLANT REPORT**

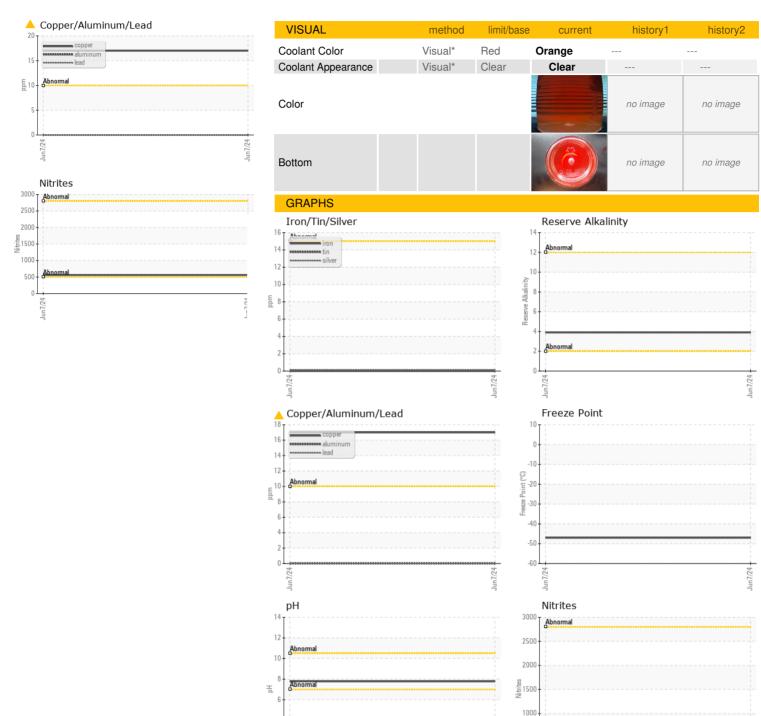



CALA ISO 17025:2017 Accredited Laboratory

Laboratory

Sample No. Lab Number : 02640878 Unique Number : 5798417

: WC0952373

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Received

**Tested** Diagnosed

: 10 Jun 2024 : 11 Jun 2024

500

: 12 Jun 2024 - Kevin Marson Test Package : COOL ( Additional Tests: GlycolType )

To discuss this sample report, contact Customer Service at 1-800-268-2131.

Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

**REGION OF HALTON** 1141 LAKESHORE ROAD

BURLINGTON, ON CA L7S 1A8 Contact: RICK BULLMANN rick.bullmann@halton.ca

T: (905)825-6000 F: (905)639-5990