

FUEL REPORT

Sample Rating Trend

NORMAL

Area [2016157] WAChime Id UNDERGROUND #3-A

Diesel Fuel Fluid DIESEL FUEL No. 2 (--- GAL)

DIAGNOSIS

Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. There is no indication of any contamination in the diesel fuel.

Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 diesel fuel, low sulfur (US EPA/CGSB-3.517-3 type B).

SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0950436		
Sample Date		Client Info		31 May 2024		
Machine Age	hrs	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*	0.850	0.827		
Fuel Color	text	Visual Screen*	YELLO	Pink		
Visc @ 40°C	cSt	ASTM D7279(m)	4.1	2.1		
SULFUR CONTER	NT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)		13		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	174	161		
5% Distillation Point	°C	ASTM D2887*		182		
10% Distill Point	°C	ASTM D2887*	186	192		
15% Distillation Point	°C	ASTM D2887*		199		
20% Distill Point	°C	ASTM D2887*	206	207		
30% Distill Point	°C	ASTM D2887*	226	221		
40% Distill Point	°C	ASTM D2887*	245	235		
50% Distill Point	°C	ASTM D2887*	260	249		
60% Distill Point	°C	ASTM D2887*	272	262		
70% Distill Point	°C	ASTM D2887*	285	276		
80% Distill Point	°C	ASTM D2887*	315	291		
85% Distillation Point	°C	ASTM D2887*		302		
90% Distill Point	°C	ASTM D2887*	360	313		
95% Distillation Point	°C	ASTM D2887*		332		
Final Boiling Point	°C	ASTM D2887*	>360	357		
IGNITION QUALI	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D1298*	35.0	39		
Cetane Index		ASTM D4737*	<40.0	50		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	0		
Sodium	ppm	ASTM D5185(m)	<0.1	<1		
Potassium	ppm	ASTM D5185(m)	<0.1	0		
Water	%	ASTM D6304*	<0.05	0.004		
ppm Water	ppm	ASTM D6304*	<500	46		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	1973		
Particles >6µm		ASTM D7647	>640	573		
Particles >14µm		ASTM D7647	>80	56		
Particles >21µm		ASTM D7647	>20	15		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>18/16/13	18/16/13		



FUEL REPORT

0

0

<1

0

<1

0

0

0

0

0

.5

10

16.00

(A)

%00

: 13 Jun 2024 - Kevin Marson

90%

80%

Validity of results and interpretation are based on the sample and information as supplied.

GCD Spectrum

<0.1

<0.1

< 0.1

<0.1

< 0.1


< 0.1

<0.1

< 0.1

<0.1

ASTM D5185(m)

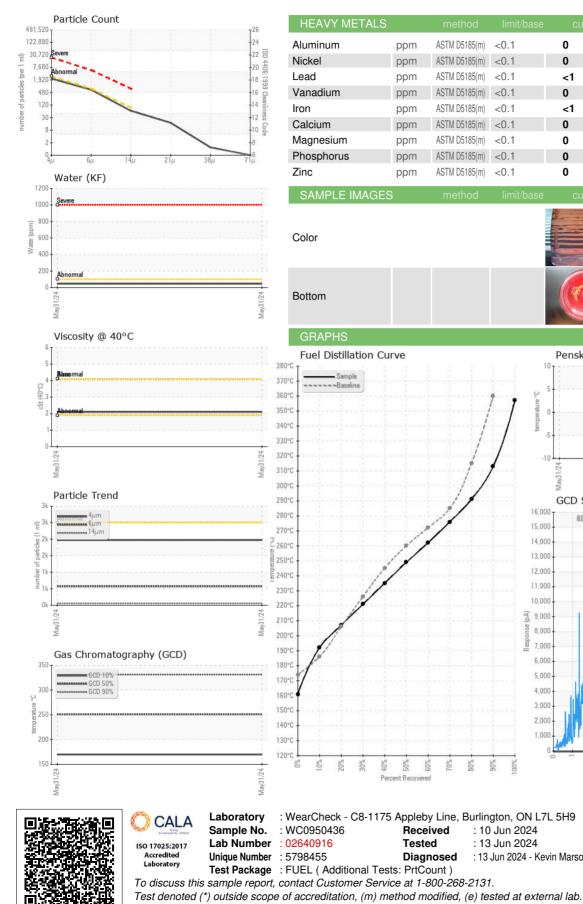

15,000 14.000 13,000 12,000 11,000 10 000 9,000 8,000 7 000 6.000 5.000 4,000 3,000 2 000 1.00 Time (min) HONEYWELL 1929 OGILVIE RD : 10 Jun 2024 : 13 Jun 2024

no image

no image

Pensky-Martens Flash Point (°C)

no image

no image

GLOUCESTER, ON CA K1J 0B9 Contact: Alain Guindon joseph.guindon@cse-cst.gc.ca T: (613)991-2659 E:

Report Id: HONGLO [WCAMIS] 02640916 (Generated: 06/13/2024 10:22:14) Rev: 1

Contact/Location: Alain Guindon - HONGLO Page 2 of 2