




# OIL ANALYSIS REPORT

## Sample Rating Trend

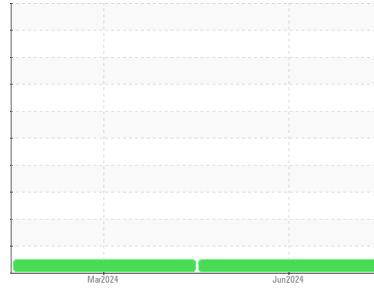

**NORMAL**



Machine Id  
**MTU C4-A**  
 Component  
**Diesel Engine**  
 Fluid  
 {not provided} (--- GAL)

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0940232</b>	WC0914027	---
Sample Date	Client Info			<b>08 Jun 2024</b>	29 Mar 2024	---
Machine Age	hrs	Client Info		<b>0</b>	2000	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	<1.0	---
Water	WC Method	>0.2		<b>NEG</b>	NEG	---
Glycol	WC Method			<b>NEG</b>	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	<b>5</b>	6	---
Chromium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	---
Nickel	ppm	ASTM D5185(m)	>4	<b>0</b>	0	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	2	---
Lead	ppm	ASTM D5185(m)	>40	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185(m)	>330	<b>29</b>	7	---
Tin	ppm	ASTM D5185(m)	>15	<b>&lt;1</b>	<1	---
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>102</b>	98	---
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185(m)		<b>46</b>	40	---
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185(m)		<b>905</b>	825	---
Calcium	ppm	ASTM D5185(m)		<b>1365</b>	1443	---
Phosphorus	ppm	ASTM D5185(m)		<b>738</b>	734	---
Zinc	ppm	ASTM D5185(m)		<b>855</b>	850	---
Sulfur	ppm	ASTM D5185(m)		<b>1930</b>	1917	---
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<b>1</b>	2	---
Sodium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	---
Potassium	ppm	ASTM D5185(m)	>20	<b>1</b>	2	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	<b>0</b>	0	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>8.5</b>	7.9	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>20.0</b>	18.5	---



# OIL ANALYSIS REPORT






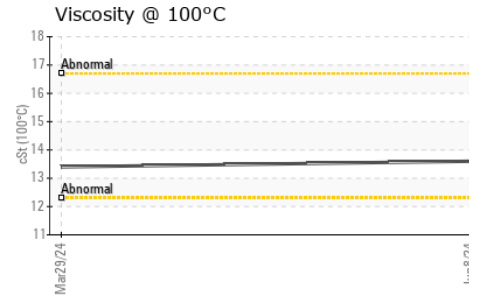
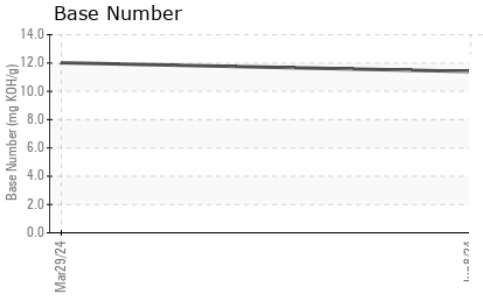
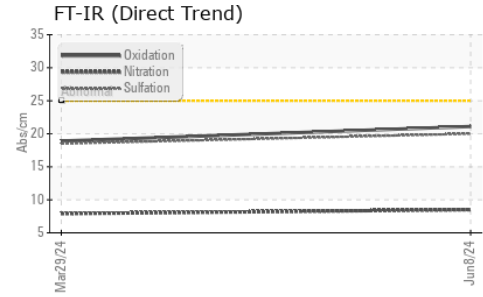


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>21.1</b>	18.9	---
Base Number (BN)	mg KOH/g	ASTM D2896*		<b>11.40</b>	12.02	---

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	---
Free Water	scalar	Visual*		<b>NEG</b>	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)		<b>13.6</b>	13.4	---

## GRAPHS

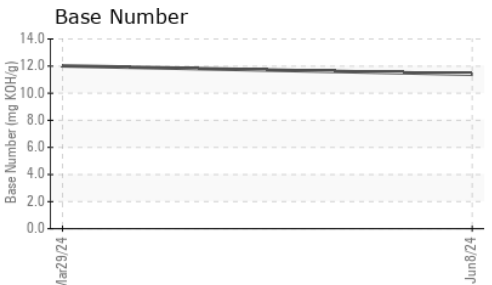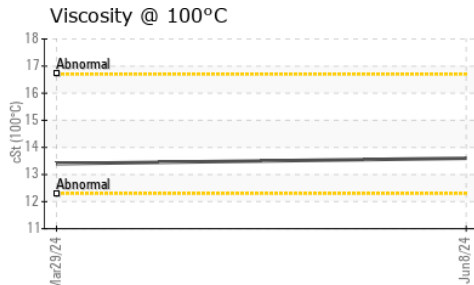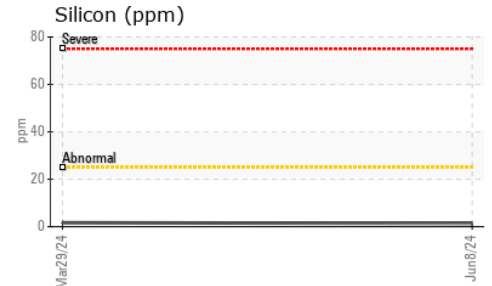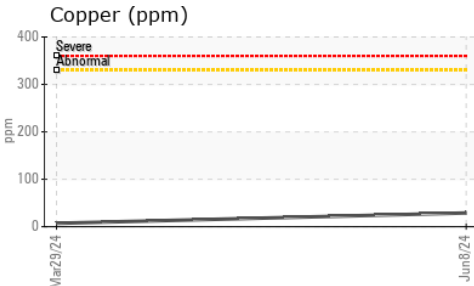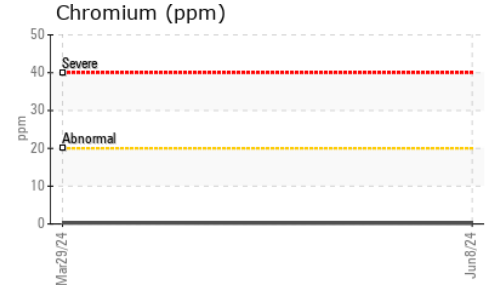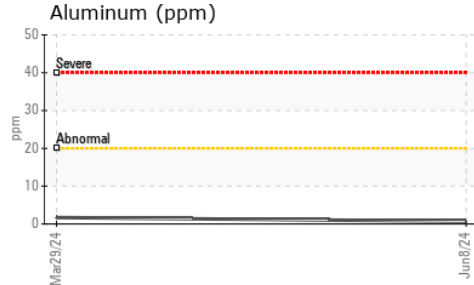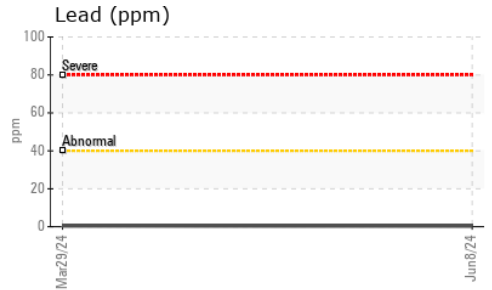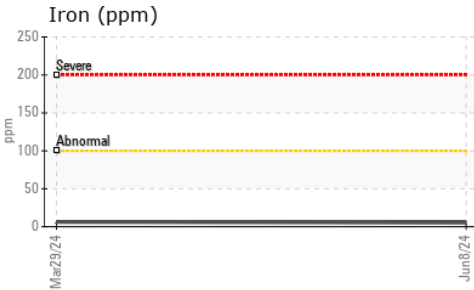

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0940232      **Received** : 12 Jun 2024  
**Lab Number** : **02641360**      **Tested** : 12 Jun 2024  
**Unique Number** : 5798899      **Diagnosed** : 12 Jun 2024 - Kevin Marson  
**Test Package** : MOB 2

**TransitNext M&R Inc**  
 3110 Albion Road North  
 Ottawa, ON  
 CA K1V 9V9  
 Contact: Glenn Skilton  
 Glenn.Skilton@atkinsrealis.com  
 T: (613)907-7100  
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.