



OIL ANALYSIS REPORT

Sample Rating Trend



CONTAMINANT



Area

UNASSIGNED [SV2405060697]

Machine Id

REF PLUS SYSTEM #16 (S/N 02019050974)

Component

Reciprocating Compressor

Fluid

COMP OIL (POE) ISO 32 (--- GAL)

DIAGNOSIS

Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

The water content is negligible.

Fluid Condition

The oil viscosity is lower than typical, possibly indicating the addition of lighter grade oil. This plus the additive levels indicates that this is not the same brand, or type of oil as reported. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0947105	---	---
Sample Date	Client Info		29 May 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	---	---
Iron	ppm	ASTM D5185(m) >50	2	---	---
Chromium	ppm	ASTM D5185(m) >10	0	---	---
Nickel	ppm	ASTM D5185(m)	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m)	0	---	---
Aluminum	ppm	ASTM D5185(m) >25	0	---	---
Lead	ppm	ASTM D5185(m) >25	0	---	---
Copper	ppm	ASTM D5185(m) >50	<1	---	---
Tin	ppm	ASTM D5185(m) >15	0	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 5	<1	---	---
Barium	ppm	ASTM D5185(m) 5	0	---	---
Molybdenum	ppm	ASTM D5185(m) 5	0	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m) 5	0	---	---
Calcium	ppm	ASTM D5185(m) 5	0	---	---
Phosphorus	ppm	ASTM D5185(m) 400	<1	---	---
Zinc	ppm	ASTM D5185(m) 5	<1	---	---
Sulfur	ppm	ASTM D5185(m) 100	4	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	<1	---	---
Sodium	ppm	ASTM D5185(m)	0	---	---
Potassium	ppm	ASTM D5185(m) >20	<1	---	---
Water	%	ASTM D6304* >0.1	0.065	---	---
ppm Water	ppm	ASTM D6304* >1000	650	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.40	0.05	---	---



OIL ANALYSIS REPORT

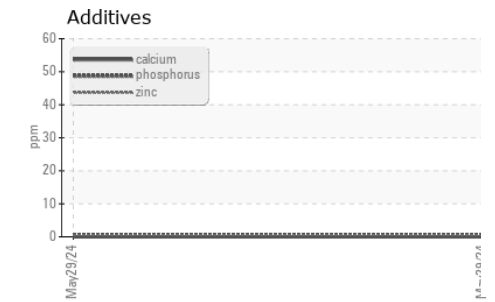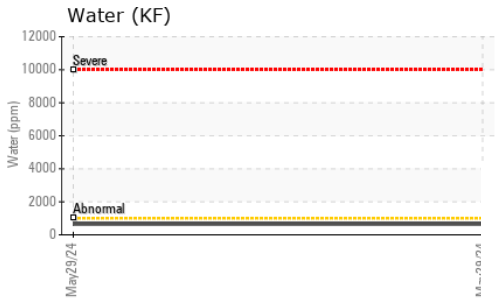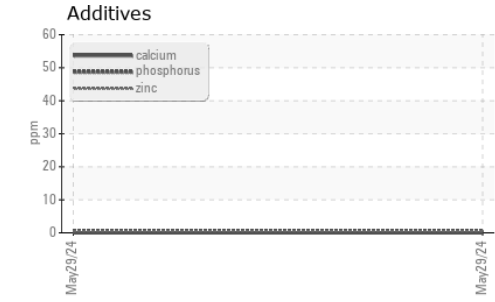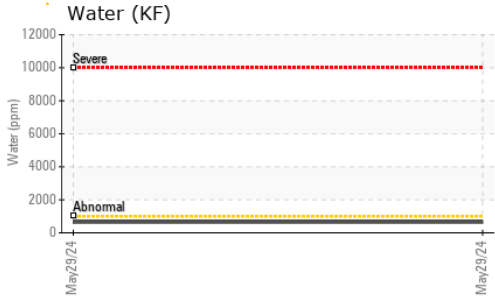





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	▲ FREON	---
Emulsified Water	scalar	Visual*	>0.1	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	32	▲ 24.4	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

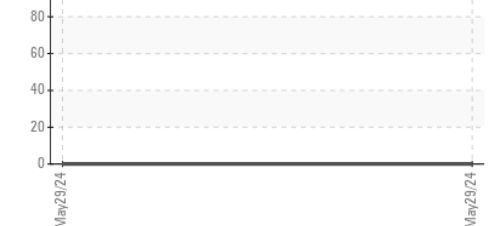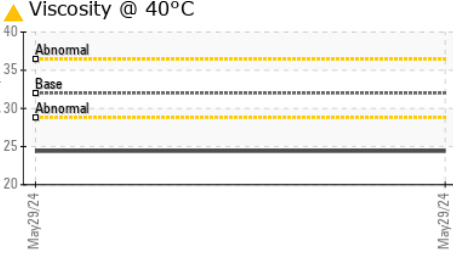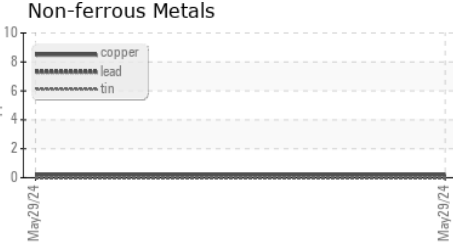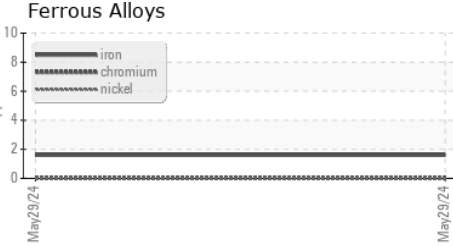

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0947105 **Received** : 12 Jun 2024
Lab Number : 02641423 **Tested** : 14 Jun 2024
Unique Number : 5798962 **Diagnosed** : 14 Jun 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: KF)

BGIS-ITS
 171 Hachborn Rd.
 Brantford, ON
 CA N3S 7W7
 Contact: Terry Barnes
 terry.barnes@bgis.com
 T: (519)802-7911
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.