




# OIL ANALYSIS REPORT

Sample Rating Trend

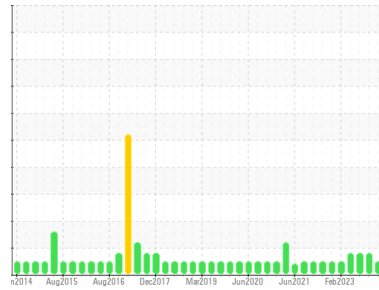

**NORMAL**



Area  
**CURING/PRESS EFGH**  
 Machine Id  
**101817 Main**  
 Component  
**Hydraulic System**  
 Fluid  
**ESSO TERESSO ISO 68 (5000 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0940143</b>	WC0889301	WC0855072
Sample Date	Client Info			<b>11 Jun 2024</b>	13 Feb 2024	05 Dec 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ATTENTION	ATTENTION

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>20	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	0
Lead	ppm	ASTM D5185(m)	>20	<b>0</b>	0	<1
Copper	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	4.5	<b>0</b>	0	<1
Barium	ppm	ASTM D5185(m)	0.4	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	6	<1
Phosphorus	ppm	ASTM D5185(m)	0.7	<b>2</b>	40	<1
Zinc	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	46	1
Sulfur	ppm	ASTM D5185(m)	1315	<b>5946</b>	6315	6154
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Sodium	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	<1
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>725</b>	6696	5066
Particles >6µm		ASTM D7647	>1300	<b>173</b>	1234	916
Particles >14µm		ASTM D7647	>160	<b>8</b>	30	20
Particles >21µm		ASTM D7647	>40	<b>1</b>	7	3
Particles >38µm		ASTM D7647	>10	<b>0</b>	1	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	1	1
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>17/15/10</b>	20/17/12	20/17/11



# OIL ANALYSIS REPORT

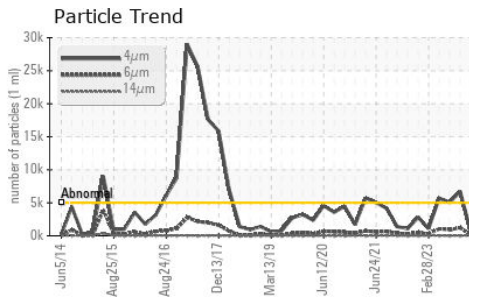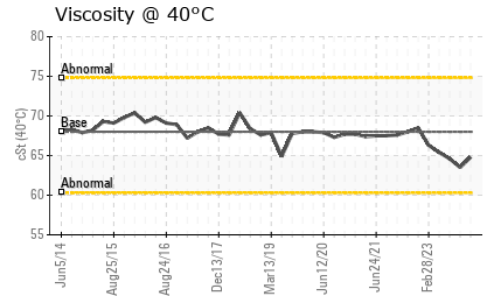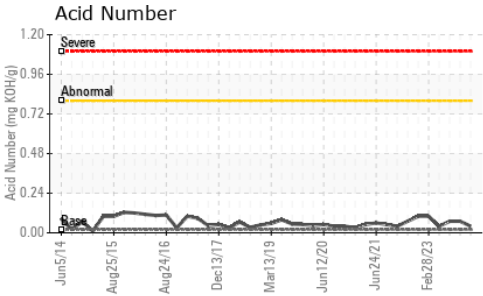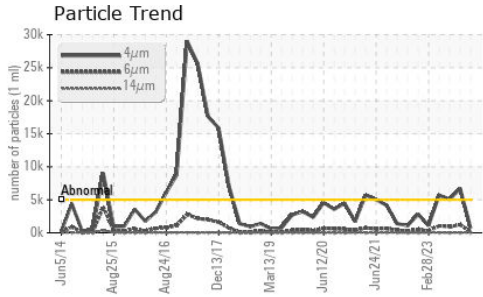






FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.02	<b>0.04</b>	0.07	0.07

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	<b>64.8</b>	63.5	64.6

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

## GRAPHS

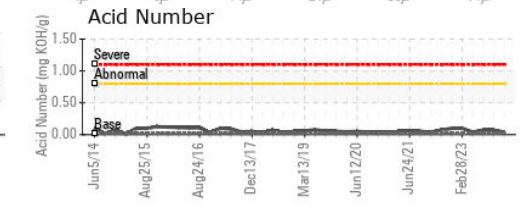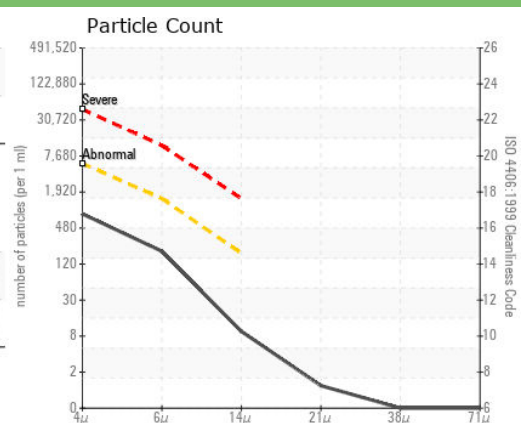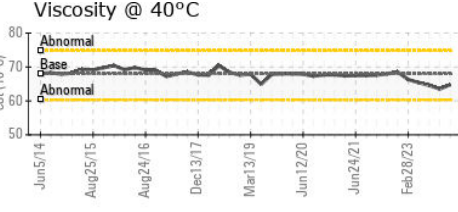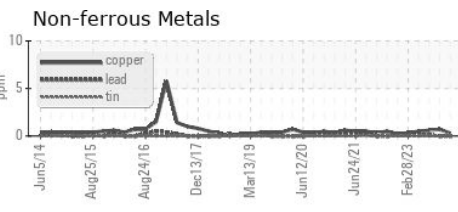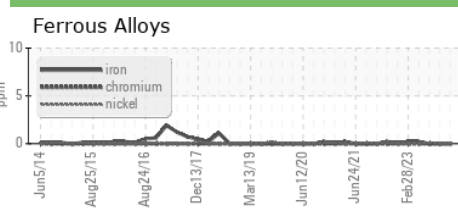

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0940143 **Received** : 14 Jun 2024  
**Lab Number** : **02641980** **Tested** : 17 Jun 2024  
**Unique Number** : 5799519 **Diagnosed** : 17 Jun 2024 - Wes Davis  
**Test Package** : IND 2 ( Additional Tests: TAN Man )

**MICHELIN TIRE**  
 866 RANDOLPH RD  
 WATERVILLE, NS  
 CA B0P 1V0  
 Contact: Alan Davies  
 alan.davies@michelin.com  
 T: (902)534-3590  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.