




# OIL ANALYSIS REPORT



Area  
Hop Trois-Riviere Circ A REF-7 [GTT224-437 853796]  
Machine Id  
**CARRIER 3508Q16380(7A)**  
Component  
**Chiller**  
Fluid  
**CASTROL AIRCOL SW 220 (--- GAL)**

Sample Rating Trend

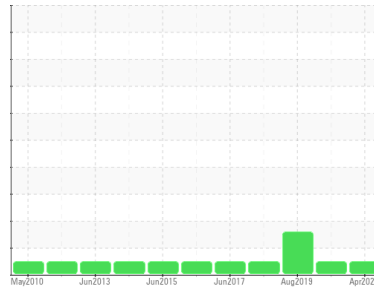

**NORMAL**



## DIAGNOSIS

- Recommendation**  
Resample at the next service interval to monitor.
- Wear**  
All component wear rates are normal.
- Contamination**  
The water content is negligible. There is no indication of any contamination in the oil.
- Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GTT0003233</b>	GTT11584	GTT11585
Sample Date	Client Info		<b>16 Apr 2024</b>	21 Jul 2020	13 Aug 2019
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	ATTENTION

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185(m) >2	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m) >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m) >3	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185(m) >2	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185(m) >8	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m) >4	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Calcium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185(m) 30	<b>&lt;1</b>	---	---
Zinc	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Sulfur	ppm	ASTM D5185(m) 30	<b>35</b>	---	---
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>10</b>	---	---
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
ppm Water	ppm	ASTM D6304* >200	<b>99</b>	282	376



## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.03	<b>0.01</b>	0.008	0.008

# OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	220	<b>185</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS



**Sample No.** : GTT0003233  
**Lab Number** : 02642228  
**Unique Number** : 5799767  
**Test Package** : IND 2 ( Additional Tests: KV40 )  
**Received** : 14 Jun 2024  
**Tested** : 24 Jun 2024  
**Diagnosed** : 24 Jun 2024 - Bill Quesnel

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

**Ainsworth Inc.**  
 1375 Fran-Carrell, bureau 16 Quebec  
 Quebec, QC  
 CA G1N 2E7  
 Contact: Service Manager  
 invoices@ainsworth.com

T:  
F: