

FUEL REPORT

Area DIEPPE AQUATIQUE CENTRE Machine Id PERKINS E3H00402

Diesel Fuel

Fluid No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation


Laboratory test indicate that this fuel is suitable for use and meets all test requirements. We advise that you filter this fluid before use. We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Contaminants

There is a moderate amount of silt (particulates < 14 microns in size) present in the fuel. The water content is negligible. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B). The fuel is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

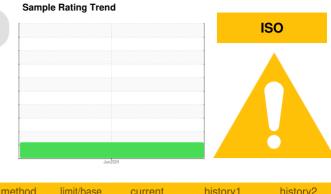

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WA0020715		
Sample Date		Client Info		14 Jun 2024		
Machine Age	hrs	Client Info		122		
Sample Status				ABNORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*	0.839	0.838		
Fuel Color	text	Visual Screen*	Yllow	Orang		
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	2.4		
Pensky-Martens Flash Point	°C	ASTM D7215*	52	57		
SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	10	14		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	165	166		
5% Distillation Point	°C	ASTM D2887*		187		
10% Distill Point	°C	ASTM D2887*	201	197		
15% Distillation Point	°C	ASTM D2887*		204		
20% Distill Point	°C	ASTM D2887*	216	212		
30% Distill Point	°C	ASTM D2887*	230	226		
40% Distill Point	°C	ASTM D2887*	243	238		
50% Distill Point	°C	ASTM D2887*	255	251		
60% Distill Point	°C	ASTM D2887*	267	264		
70% Distill Point	°C	ASTM D2887*	280	277		
80% Distill Point	°C	ASTM D2887*	295	293		
85% Distillation Point	°C	ASTM D2887*		305		
90% Distill Point	°C	ASTM D2887*	310	317		
95% Distillation Point	°C	ASTM D2887*		339		
Final Boiling Point	°C	ASTM D2887*	341	374		
IGNITION QUALIT	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D1298*	37.7	37		
Cetane Index		ASTM D4737*	<40.0	47		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	0		
Sodium	ppm	ASTM D5185(m)	<0.1	<1		
Potassium	ppm	ASTM D5185(m)	<0.1	0		
Water	%	ASTM D6304*	< 0.05	0.015		
ppm Water	ppm	ASTM D6304*	<500	151		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	<u> </u>		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>160	81		
Particles >21µm		ASTM D7647	>40	9		
Particles >38μm		ASTM D7647	>10	0		
Particles >71µm		ASTM D7647	>3	0		


ISO 4406 (c) >18/17/14 **20/19/14**


Oil Cleanliness

Contact/Location: Doug Balser - DDAMON Page 1 of 2



FUEL REPORT

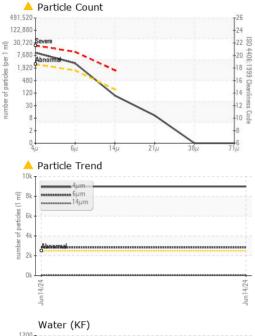

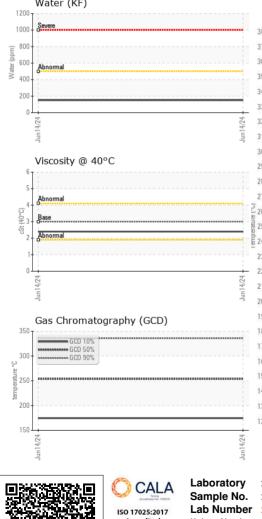


HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0		
Nickel	ppm	ASTM D5185(m)	<0.1	0		
Lead	ppm	ASTM D5185(m)	<0.1	<1		
Vanadium	ppm	ASTM D5185(m)	<0.1	0		
Iron	ppm	ASTM D5185(m)	<0.1	<1		
Calcium	ppm	ASTM D5185(m)	<0.1	<1		
Magnesium	ppm	ASTM D5185(m)	<0.1	0		
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1		
Zinc	ppm	ASTM D5185(m)	<0.1	2		
SAMPLE IMAGES		method	limit/base	current	history1	history2

Color



65

1 A I

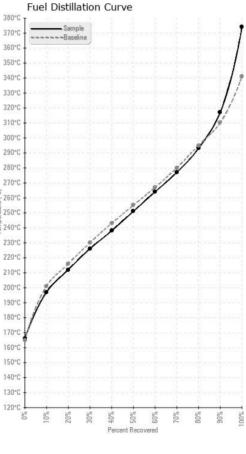

60 e 55 Ba 50 GCD Spectrum 17,000 **TU**N 16,000 15,000 14,000 13,000 12,000 11,000 10,000 9,000 8,000 7,000 6,000 5,000 4,000 3,000 2,000 1.00 Time (min)

Pensky-Martens Flash Point (°C)

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 : WA0020715 Received : 17 Jun 2024 Lab Number : 02642433 Tested : 19 Jun 2024 Accredited Unique Number : 5799972 Diagnosed : 19 Jun 2024 - Kevin Marson Laboratory Test Package : FUEL (Additional Tests: CC Flash, PrtCount) To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

Wajax Power Systems 485 VENTURE DR MONCTON, NB CA E1H 2P4 Contact: Doug Balser dbalser@wajax.com T: (506)855-5371 F: (506)870-4448

Report Id: DDAMON [WCAMIS] 02642433 (Generated: 06/19/2024 13:46:01) Rev: 1

Contact/Location: Doug Balser - DDAMON

Page 2 of 2