




OIL ANALYSIS REPORT



Area
Hop, Pierre Le Gardeur Ch#2 [GTT224-455]
 Machine Id
TRANE L02L20084
 Component
Chiller
 Fluid
TRANE 0022 (--- GAL)

Sample Rating Trend

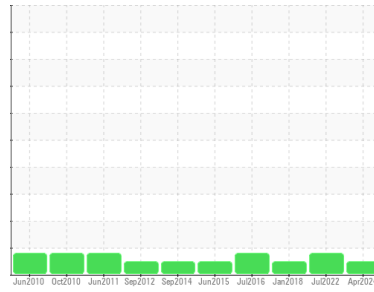

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	GTT0003323	GTT33479	GTT33480
Sample Date	Client Info	22 Apr 2024	05 Jul 2022	23 Jan 2018
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	ABNORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >8	<1	2	<1
Chromium	ppm ASTM D5185(m) >2	0	<1	<1
Nickel	ppm ASTM D5185(m)	<1	---	---
Titanium	ppm ASTM D5185(m)	0	---	---
Silver	ppm ASTM D5185(m) >2	0	---	---
Aluminum	ppm ASTM D5185(m) >3	0	<1	<1
Lead	ppm ASTM D5185(m) >2	0	<1	<1
Copper	ppm ASTM D5185(m) >8	3	<1	<1
Tin	ppm ASTM D5185(m) >4	0	▲ 4	<1
Antimony	ppm ASTM D5185(m)	0	---	---
Vanadium	ppm ASTM D5185(m)	0	---	---
Beryllium	ppm ASTM D5185(m)	0	---	---
Cadmium	ppm ASTM D5185(m)	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 0	<1	---	---
Barium	ppm ASTM D5185(m) 0	0	---	---
Molybdenum	ppm ASTM D5185(m) 0	0	---	---
Manganese	ppm ASTM D5185(m) 0	0	---	---
Magnesium	ppm ASTM D5185(m) 0	<1	---	---
Calcium	ppm ASTM D5185(m) 0	<1	---	---
Phosphorus	ppm ASTM D5185(m) 35	1	---	---
Zinc	ppm ASTM D5185(m) 0	2	2	2
Sulfur	ppm ASTM D5185(m) 30	8	---	---
Lithium	ppm ASTM D5185(m)	<1	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >15	<1	---	---
Sodium	ppm ASTM D5185(m)	0	---	---
Potassium	ppm ASTM D5185(m) >20	0	---	---
ppm Water	ppm ASTM D6304* >50	<10	20	30

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974* 0.05	0.01	0.031	0.021

OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	VLITE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	VLITE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	47	35.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS



Sample No. : GTT0003323
Lab Number : 02642448
Unique Number : 5799987
Test Package : IND 2 (Additional Tests: KV40)

Received : 17 Jun 2024
Tested : 18 Jun 2024
Diagnosed : 24 Jun 2024 - Bill Quesnel

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

Baulne Inc
 1850 32nd Avenue
 Montreal, QC
 CA H8T 3J7
 Contact: Paula Carvalho
 pcarvalho@baulne.ca
 T: (514)422-0444
 F: