



OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Area

Production de l'énergie électrique

Machine Id

13B02#03 - Diesel auxiliaire 3 (S/N 524101273)

Component

Diesel Engine

Fluid

PETRO CANADA DURON SHP 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0936133	---	---
Sample Date	Client Info			14 Jun 2024	---	---
Machine Age	hrs	Client Info		26797	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				NORMAL	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<1.0	---	---
Water	WC Method	>0.2		NEG	---	---
Glycol	WC Method			NEG	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	6	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	<1	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<1	---	---
Lead	ppm	ASTM D5185(m)	>40	0	---	---
Copper	ppm	ASTM D5185(m)	>330	5	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Antimony	ppm	ASTM D5185(m)		0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
Beryllium	ppm	ASTM D5185(m)		0	---	---
Cadmium	ppm	ASTM D5185(m)		0	---	---


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	2	---	---
Barium	ppm	ASTM D5185(m)	0	0	---	---
Molybdenum	ppm	ASTM D5185(m)	60	62	---	---
Manganese	ppm	ASTM D5185(m)	0	<1	---	---
Magnesium	ppm	ASTM D5185(m)	1010	1011	---	---
Calcium	ppm	ASTM D5185(m)	1070	1106	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	1034	---	---
Zinc	ppm	ASTM D5185(m)	1270	1249	---	---
Sulfur	ppm	ASTM D5185(m)	2060	2674	---	---
Lithium	ppm	ASTM D5185(m)		<1	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	3	---	---
Sodium	ppm	ASTM D5185(m)		2	---	---
Potassium	ppm	ASTM D5185(m)	>20	0	---	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	6.6	---	---
Sulfation	Abs.1mm	ASTM D7415*	>30	19.0	---	---



OIL ANALYSIS REPORT



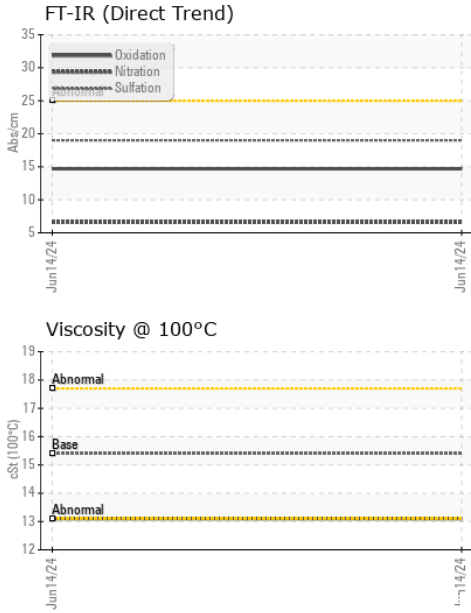


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	14.7	---	---

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	VLITE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.1	---	---

GRAPHS

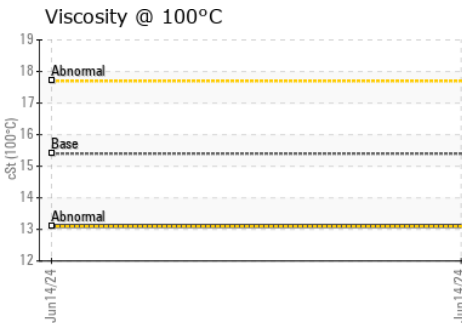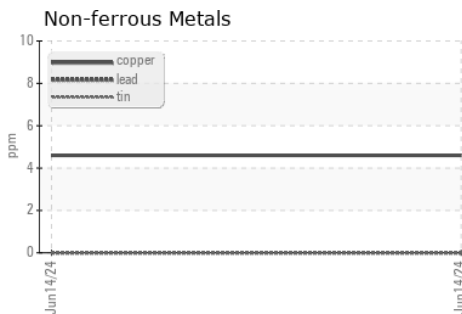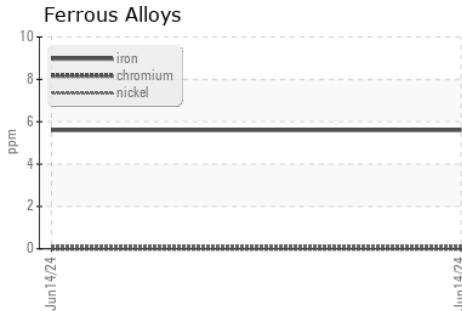

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0936133
Lab Number : 02642453
Unique Number : 5799992
Test Package : MAR 1

Received : 18 Jun 2024
Tested : 18 Jun 2024
Diagnosed : 18 Jun 2024 - Wes Davis

Canadian Coast Guard
 CCGS Pierre Radisson, 101 Boul. Champlain
 Quebec, QC
 CA G1K 7Y7
 Contact: Pierre Radisson
 PierreRadissonCE@ccgs-ngcc.gc.ca
 T: (418)563-1737
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.