




OIL ANALYSIS REPORT

Sample Rating Trend

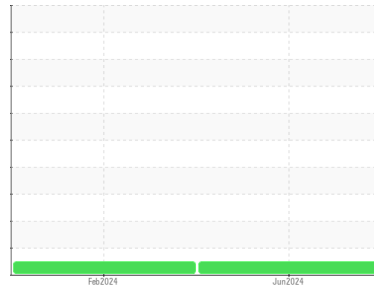

NORMAL



Area

Production de l'énergie électrique

Machine Id

13B02#02 - Diesel auxiliaire 2 (S/N 524101272)

Component

Diesel Engine

Fluid

PETRO CANADA DURON SHP 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0936134	WC0866049	---
Sample Date	Client Info		14 Jun 2024	15 Feb 2024	---
Machine Age	hrs	Client Info	34486	33979	---
Oil Age	hrs	Client Info	0	683	---
Oil Changed	Client Info		N/A	Not Changd	---
Sample Status			NORMAL	NORMAL	---

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	<1.0	---
Water	WC Method	>0.2	NEG	NEG	---
Glycol	WC Method		NEG	NEG	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >100	4	3	---
Chromium	ppm	ASTM D5185(m) >20	0	0	---
Nickel	ppm	ASTM D5185(m) >4	0	0	---
Titanium	ppm	ASTM D5185(m)	0	0	---
Silver	ppm	ASTM D5185(m) >3	0	0	---
Aluminum	ppm	ASTM D5185(m) >20	<1	1	---
Lead	ppm	ASTM D5185(m) >40	0	0	---
Copper	ppm	ASTM D5185(m) >330	<1	<1	---
Tin	ppm	ASTM D5185(m) >15	0	0	---
Antimony	ppm	ASTM D5185(m)	0	0	---
Vanadium	ppm	ASTM D5185(m)	0	0	---
Beryllium	ppm	ASTM D5185(m)	0	0	---
Cadmium	ppm	ASTM D5185(m)	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	2	2	---
Barium	ppm	ASTM D5185(m) 0	0	0	---
Molybdenum	ppm	ASTM D5185(m) 60	64	60	---
Manganese	ppm	ASTM D5185(m) 0	0	0	---
Magnesium	ppm	ASTM D5185(m) 1010	1033	987	---
Calcium	ppm	ASTM D5185(m) 1070	1108	1079	---
Phosphorus	ppm	ASTM D5185(m) 1150	1047	1040	---
Zinc	ppm	ASTM D5185(m) 1270	1258	1197	---
Sulfur	ppm	ASTM D5185(m) 2060	2696	2763	---
Lithium	ppm	ASTM D5185(m)	<1	<1	---

CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	2	2	---
Sodium	ppm	ASTM D5185(m)	1	<1	---
Potassium	ppm	ASTM D5185(m) >20	0	<1	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	0	0	---
Nitration	Abs/cm	ASTM D7624* >20	6.6	6.0	---
Sulfation	Abs.1mm	ASTM D7415* >30	19.0	18.5	---



OIL ANALYSIS REPORT



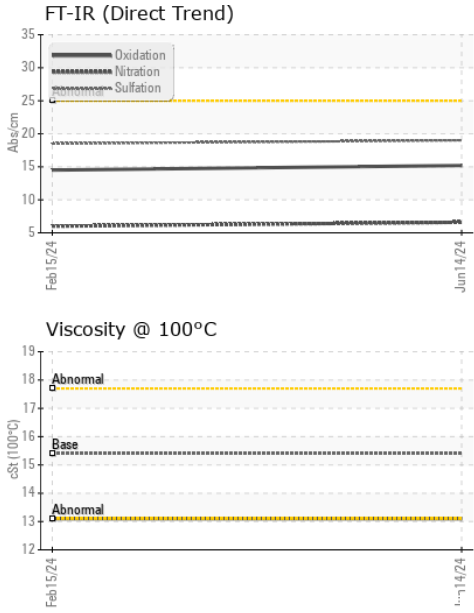


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	15.2	14.5	---

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	---	NONE	---
Yellow Metal	scalar	Visual*	NONE	---	NONE	---
Precipitate	scalar	Visual*	NONE	---	NONE	---
Silt	scalar	Visual*	NONE	---	NONE	---
Debris	scalar	Visual*	NONE	---	NONE	---
Sand/Dirt	scalar	Visual*	NONE	---	NONE	---
Appearance	scalar	Visual*	NORML	---	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	---
Free Water	scalar	Visual*		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.1	13.1	---

GRAPHS

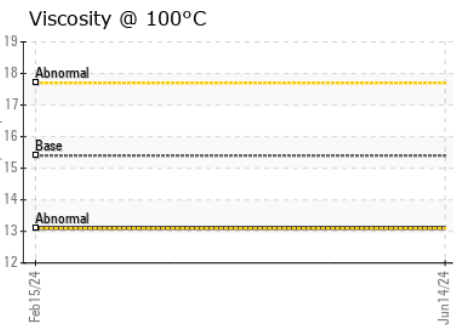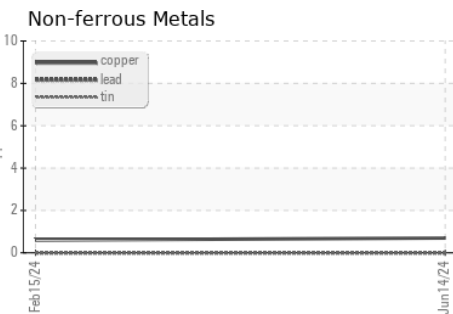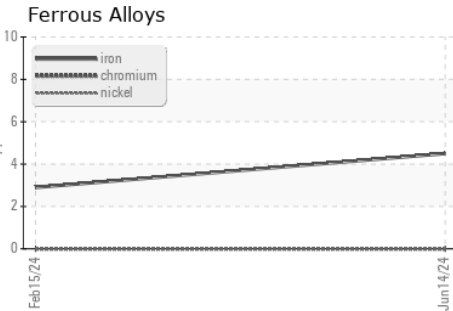

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0936134
Lab Number : 02642454
Unique Number : 5799993
Test Package : MAR 1

Canadian Coast Guard
 CCGS Pierre Radisson, 101 Boul. Champlain
 Quebec, QC
 CA G1K 7Y7
 Contact: Pierre Radisson
 PierreRadissonCE@ccgs-ngcc.gc.ca
 T: (418)563-1737
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.