




PROBLEM SUMMARY


Area
RHOB/HYDRAULICS
 Machine Id
E - 2 Hydraulics Repair Car
 Component
Tank Hydraulic System
 Fluid
FIRE-RESISTANT FLUID ISO 46 (132 GAL)

Sample Rating Trend

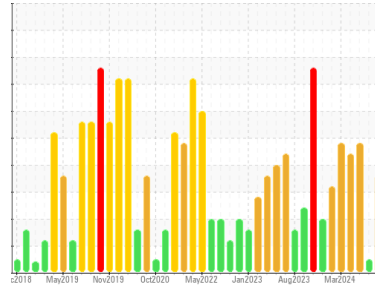

COMPONENT CONDITION SUMMARY

▲ Particle Trend

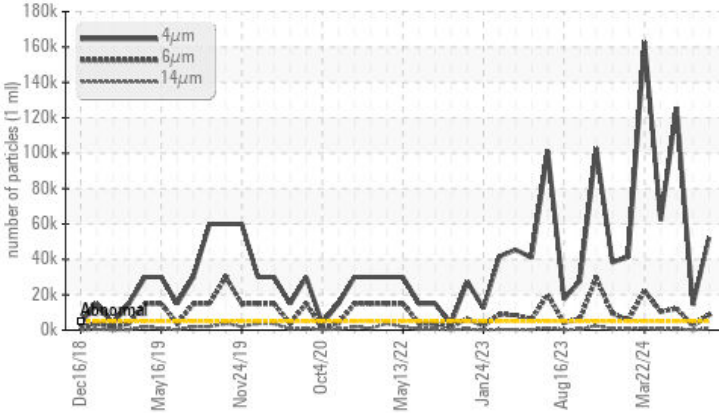

RECOMMENDATION

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	>	SEVERE	---	SEVERE
Particles >4µm	ASTM D7647	>5000	▲ 52180	▲ 14408	▲ 125696
Particles >6µm	ASTM D7647	>1300	▲ 8568	● 2464	▲ 12151
Particles >14µm	ASTM D7647	>160	▲ 694	● 192	▲ 700
Particles >21µm	ASTM D7647	>40	▲ 249	● 59	▲ 185
Particles >38µm	ASTM D7647	>10	▲ 25	● 8	▲ 25
Particles >71µm	ASTM D7647	>3	▲ 6	● 0	▲ 2
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 23/20/17	▲ 21/18/15	▲ 24/21/17

Customer Id: LEWBOSC
 Sample No.: WC0956525
 Lab Number: 02642692
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Dirt Access	---	---	?	We advise that you check all areas where contaminants can enter the system.
Filter Fluid	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.

HISTORICAL DIAGNOSIS

17 Jun 2024 Diag:

UNKNOWN



view report



17 May 2024 Diag: Kevin Marson

ISO



We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. There is a high amount of particulates (2 to 100 microns in size) present in the oil. The AN level is acceptable for this fluid. The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable. The water concentration level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



15 Apr 2024 Diag: Kevin Marson

ISO



We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. There is a high amount of particulates (2 to 100 microns in size) present in the oil. The AN level is acceptable for this fluid. The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable. The water concentration level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

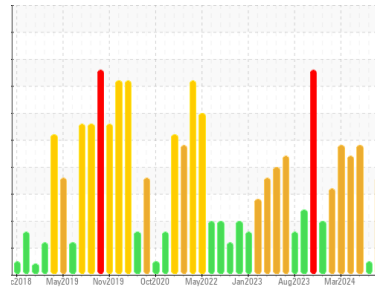

ISO



Area
RHOB/HYDRAULICS
 Machine Id
E - 2 Hydraulics Repair Car
 Component
Tank Hydraulic System
 Fluid
FIRE-RESISTANT FLUID ISO 46 (132 GAL)

DIAGNOSIS

Recommendation

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates (2 to 100 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable. The water concentration level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0956525	WC0956583	WC0947098
Sample Date	Client Info		18 Jun 2024	17 Jun 2024	17 May 2024
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	---	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*	>99999	2	0	0
Iron	ppm	ASTM D5185(m)	>20	0	0
Chromium	ppm	ASTM D5185(m)	>20	0	0
Nickel	ppm	ASTM D5185(m)	>20	0	0
Titanium	ppm	ASTM D5185(m)		0	0
Silver	ppm	ASTM D5185(m)		<1	<1
Aluminum	ppm	ASTM D5185(m)	>20	0	0
Lead	ppm	ASTM D5185(m)	>20	0	0
Copper	ppm	ASTM D5185(m)	>20	<1	<1
Tin	ppm	ASTM D5185(m)	>20	0	0
Antimony	ppm	ASTM D5185(m)		<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0
Beryllium	ppm	ASTM D5185(m)		0	0
Cadmium	ppm	ASTM D5185(m)		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	3	3
Barium	ppm	ASTM D5185(m)	5	1	1
Molybdenum	ppm	ASTM D5185(m)	5	0	<1
Manganese	ppm	ASTM D5185(m)		0	0
Magnesium	ppm	ASTM D5185(m)	5	<1	1
Calcium	ppm	ASTM D5185(m)	50	4	<1
Phosphorus	ppm	ASTM D5185(m)	175	3	24
Zinc	ppm	ASTM D5185(m)	62	2	<1
Sulfur	ppm	ASTM D5185(m)	500	52	53
Lithium	ppm	ASTM D5185(m)		<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	2	1
Sodium	ppm	ASTM D5185(m)		187	230
Potassium	ppm	ASTM D5185(m)	>20	20	90
Water	%	ASTM D6304*	>55	37.6	---
ppm Water	ppm	ASTM D6304*	>55000	376000	---

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 52180	▲ 14408	▲ 125696
Particles >6µm	ASTM D7647	>1300	▲ 8568	● 2464	▲ 12151
Particles >14µm	ASTM D7647	>160	▲ 694	● 192	▲ 700
Particles >21µm	ASTM D7647	>40	▲ 249	● 59	▲ 185
Particles >38µm	ASTM D7647	>10	▲ 25	8	▲ 25
Particles >71µm	ASTM D7647	>3	▲ 6	0	2
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 23/20/17	▲ 21/18/15	▲ 24/21/17



OIL ANALYSIS REPORT

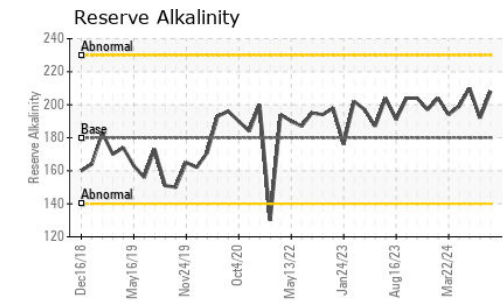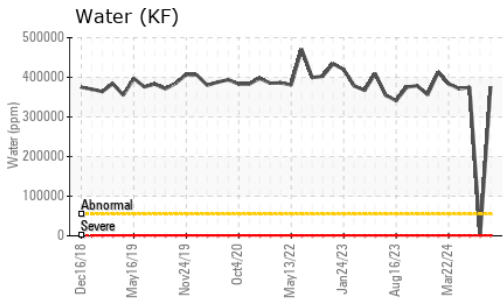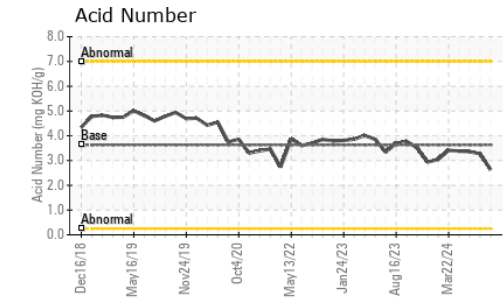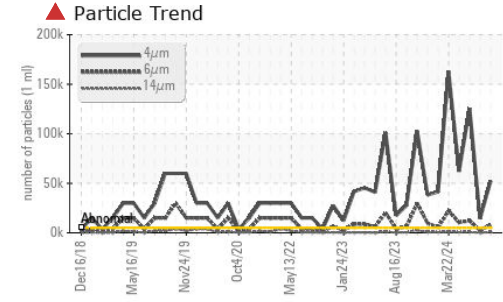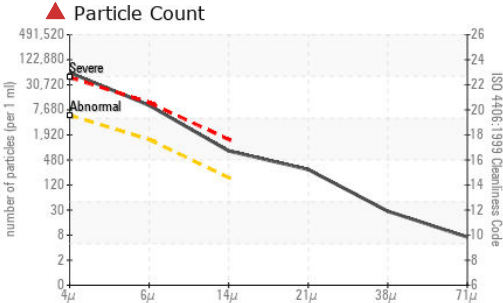


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974*	3.63	2.63	3.27	3.36
Alkiline Reserve (Oils)	ml KOH/g	ASTM D1121*		208	192	210

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>55	NEG	NEG	>10%
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
pH	Scale 0-14	ASTM D1287*		9.82	9.82	9.57
Visc @ 40°C	cSt	ASTM D7279(m)	46	42.4	42.5	42.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

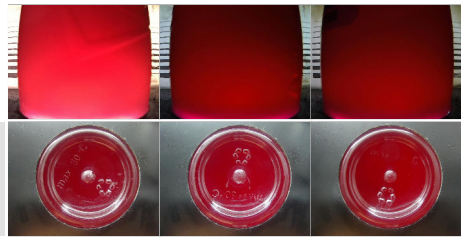

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0956525 **Received** : 18 Jun 2024
Lab Number : **02642692** **Tested** : 21 Jun 2024
Unique Number : 5800231 **Diagnosed** : 21 Jun 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: KF, pH, PQ, ReserveAlk)

STELCO - BOSC - Basic Oxygen Slab Caster
 2330 Regional Road #3, Door: BOSC8
 NANTICOKE, ON
 CA N0A 1L0
 Contact: Tom Walden
 Thomas.Walden@stelco.com
 T: (519)587-4541
 F: (519)587-7702

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.