




OIL ANALYSIS REPORT

Sample Rating Trend

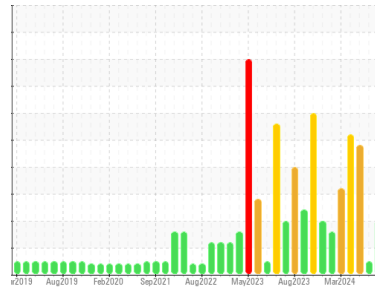

ISO



Area

BOF/OG SYSTEM

Machine Id

D - 7 Skirt Lifting and Seal Jacking Hydraulics

Component

Hydraulic System

Fluid

FORSYTHE NO FIRE WG 200R (350 GAL)

DIAGNOSIS

Recommendation

We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. We recommend an early resample to monitor this condition. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid.

Wear

Component wear rates appear to be normal (unconfirmed).

Contamination

There is a moderate amount of particulates (2 to 100 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable. The water concentration level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0956538	WC0956585	WC0947094
Sample Date	Client Info	18 Jun 2024	17 Jun 2024	17 May 2024
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	---	SEVERE

WEAR METALS

method	limit/base	current	history1	history2	
PQ	ASTM D8184*	>99999	0	0	
Iron	ppm	ASTM D5185(m)	>20	0	0
Chromium	ppm	ASTM D5185(m)	>20	0	0
Nickel	ppm	ASTM D5185(m)	>20	0	<1
Titanium	ppm	ASTM D5185(m)		0	0
Silver	ppm	ASTM D5185(m)		<1	0
Aluminum	ppm	ASTM D5185(m)	>20	0	0
Lead	ppm	ASTM D5185(m)	>20	0	0
Copper	ppm	ASTM D5185(m)	>20	0	0
Tin	ppm	ASTM D5185(m)	>20	0	0
Antimony	ppm	ASTM D5185(m)		0	0
Vanadium	ppm	ASTM D5185(m)		0	0
Beryllium	ppm	ASTM D5185(m)		0	0
Cadmium	ppm	ASTM D5185(m)		0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		1	<1
Barium	ppm	ASTM D5185(m)		1	1
Molybdenum	ppm	ASTM D5185(m)		0	0
Manganese	ppm	ASTM D5185(m)		0	0
Magnesium	ppm	ASTM D5185(m)		<1	1
Calcium	ppm	ASTM D5185(m)		<1	<1
Phosphorus	ppm	ASTM D5185(m)		8	2
Zinc	ppm	ASTM D5185(m)		<1	<1
Sulfur	ppm	ASTM D5185(m)		47	47
Lithium	ppm	ASTM D5185(m)		<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185(m)	>15	<1	1	1
Sodium	ppm	ASTM D5185(m)		211	185	155
Potassium	ppm	ASTM D5185(m)	>20	76	22	17
Water	%	ASTM D6304*		39.8	---	40.9
ppm Water	ppm	ASTM D6304*	>10%	398000	---	409000






FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	▲ 17270	▲ 10566	▲ 162940
Particles >6µm	ASTM D7647	>1300	▲ 2564	● 2340	▲ 45159
Particles >14µm	ASTM D7647	>160	● 222	112	▲ 932
Particles >21µm	ASTM D7647	>40	▲ 101	35	● 61
Particles >38µm	ASTM D7647	>10	4	2	2
Particles >71µm	ASTM D7647	>3	0	0	0

Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/19/15	▲ 21/18/14	▲ 25/23/17
-----------------	--------------	-----------	------------	------------	------------



OIL ANALYSIS REPORT

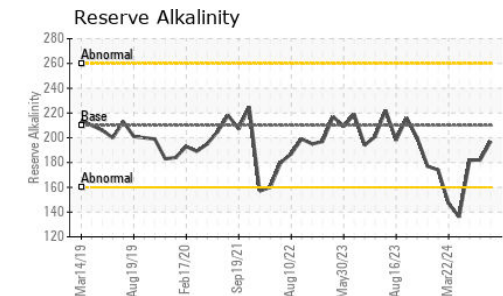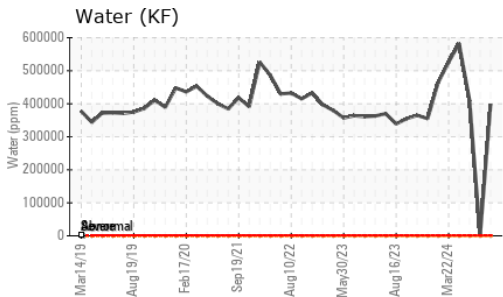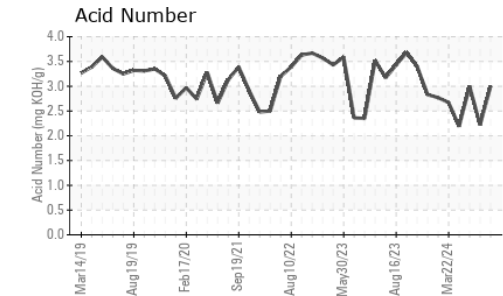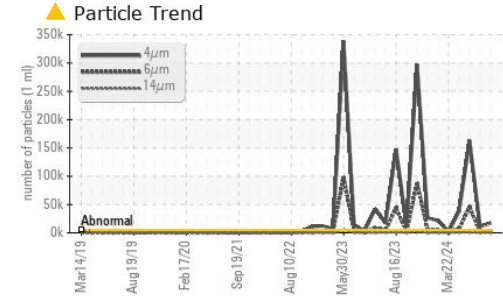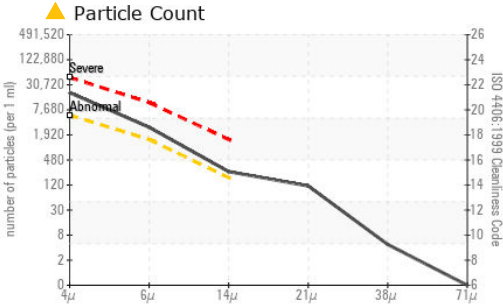


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	3.00	2.22	3.00
Alkiline Reserve (Oils)	ml KOH/g	ASTM D1121*	197	182	182

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	NEG	NEG	>10%
Free Water	scalar	Visual*	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
pH	Scale 0-14	ASTM D1287*	9.87	9.85	9.74
Visc @ 40°C	cSt	ASTM D7279(m)	39.0	39.7	▲ 30.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

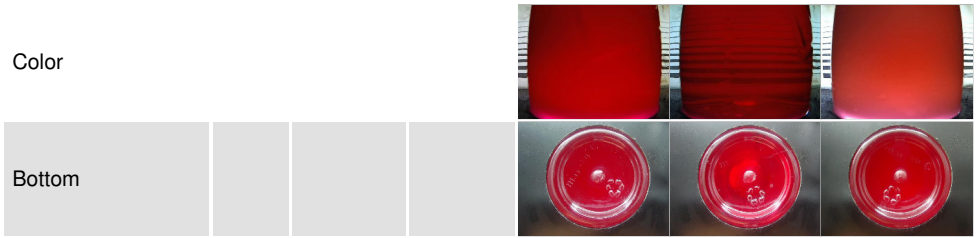

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0956538
Lab Number : **02642697**
Unique Number : 5800236
Test Package : IND 2 (Additional Tests: KF, pH, PQ, ReserveAlk)

STELCO - BOSC - Basic Oxygen Slab Caster
 2330 Regional Road #3, Door: BOSC8
 NANTICOKE, ON
 CA N0A 1L0
 Contact: Tom Walden
 Thomas.Walden@stelco.com
 T: (519)587-4541
 F: (519)587-7702

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.