




OIL ANALYSIS REPORT

Sample Rating Trend

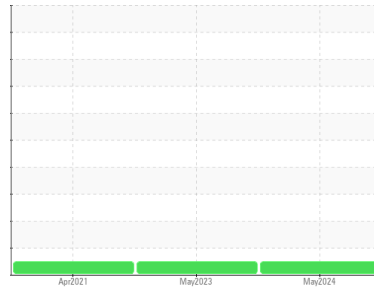

NORMAL



Machine Id

C0423

Component

Diesel Engine

Fluid

DISEL ENGINE OIL SAE 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | WC0918888 | WC0634034 | WC0510715 |
| Sample Date | Client Info | | | 28 May 2024 | 02 May 2023 | 07 Apr 2021 |
| Machine Age | hrs | Client Info | | 112 | 98 | 64 |
| Oil Age | hrs | Client Info | | 30 | 16 | 0 |
| Oil Changed | Client Info | | | Not Changed | Not Changed | Not Changed |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

| CONTAMINATION | | method | limit/base | current | history1 | history2 |
|---------------|-----------|--------|------------|----------------|----------|----------|
| Fuel | WC Method | >3.0 | | <1.0 | <1.0 | <1.0 |
| Water | WC Method | >0.2 | | NEG | NEG | NEG |
| Glycol | WC Method | | | NEG | NEG | NEG |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|---------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185(m) | >90 | 2 | 2 | 3 |
| Chromium | ppm | ASTM D5185(m) | >20 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185(m) | >2 | <1 | <1 | <1 |
| Titanium | ppm | ASTM D5185(m) | >2 | 0 | <1 | <1 |
| Silver | ppm | ASTM D5185(m) | >2 | 0 | 0 | <1 |
| Aluminum | ppm | ASTM D5185(m) | >20 | <1 | <1 | <1 |
| Lead | ppm | ASTM D5185(m) | >40 | 0 | 0 | <1 |
| Copper | ppm | ASTM D5185(m) | >330 | 1 | <1 | 2 |
| Tin | ppm | ASTM D5185(m) | >15 | 0 | 0 | 0 |
| Antimony | ppm | ASTM D5185(m) | | 0 | <1 | 0 |
| Vanadium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |



| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|---------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185(m) | 250 | 12 | 5 | 45 |
| Barium | ppm | ASTM D5185(m) | 10 | 0 | 0 | <1 |
| Molybdenum | ppm | ASTM D5185(m) | 100 | 1 | 2 | 30 |
| Manganese | ppm | ASTM D5185(m) | | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185(m) | 450 | 19 | 20 | 419 |
| Calcium | ppm | ASTM D5185(m) | 3000 | 2167 | 2319 | 1709 |
| Phosphorus | ppm | ASTM D5185(m) | 1150 | 843 | 929 | 934 |
| Zinc | ppm | ASTM D5185(m) | 1350 | 944 | 977 | 1149 |
| Sulfur | ppm | ASTM D5185(m) | 4250 | 2930 | 3146 | 2893 |
| Lithium | ppm | ASTM D5185(m) | | <1 | <1 | <1 |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|---------------|------------|----------|----------|----------|
| Silicon | ppm | ASTM D5185(m) | >25 | 2 | 2 | 6 |
| Sodium | ppm | ASTM D5185(m) | >158 | 2 | 2 | 3 |
| Potassium | ppm | ASTM D5185(m) | >20 | 1 | <1 | <1 |

| INFRA-RED | | method | limit/base | current | history1 | history2 |
|-----------|----------|-------------|------------|-------------|----------|----------|
| Soot % | % | ASTM D7844* | >6 | 0 | 0 | 0 |
| Nitration | Abs/cm | ASTM D7624* | >20 | 5.4 | 5.1 | 6.6 |
| Sulfation | Abs./1mm | ASTM D7415* | >30 | 15.3 | 15.4 | 21.4 |



OIL ANALYSIS REPORT







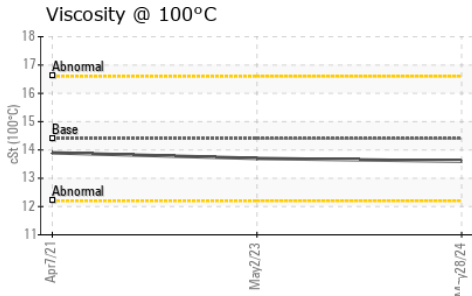
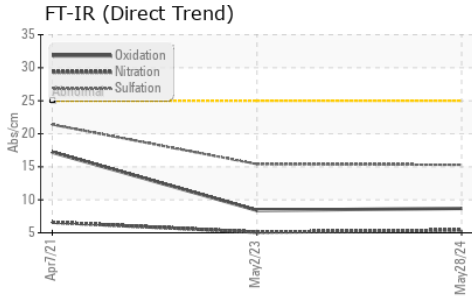


| FLUID DEGRADATION | method | limit/base | current | history1 | history2 | |
|-------------------|----------|-------------|---------|------------|----------|------|
| Oxidation | Abs./1mm | ASTM D7414* | >25 | 8.7 | 8.4 | 17.2 |

| VISUAL | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|--------------|----------|-----|
| White Metal | scalar | Visual* | NONE | NONE | --- | --- |
| Yellow Metal | scalar | Visual* | NONE | NONE | --- | --- |
| Precipitate | scalar | Visual* | NONE | NONE | --- | --- |
| Silt | scalar | Visual* | NONE | NONE | --- | --- |
| Debris | scalar | Visual* | NONE | NONE | --- | --- |
| Sand/Dirt | scalar | Visual* | NONE | NONE | --- | --- |
| Appearance | scalar | Visual* | NORML | NORML | --- | --- |
| Odor | scalar | Visual* | NORML | NORML | NORML | --- |
| Emulsified Water | scalar | Visual* | >0.2 | NEG | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 | |
|------------------|--------|---------------|---------|-------------|----------|------|
| Visc @ 100°C | cSt | ASTM D7279(m) | 14.4 | 13.6 | 13.7 | 13.9 |

GRAPHS

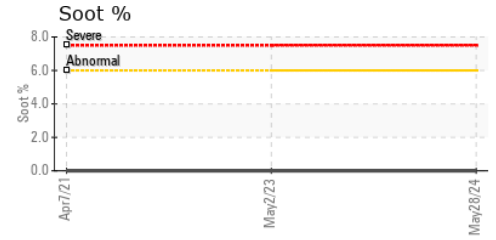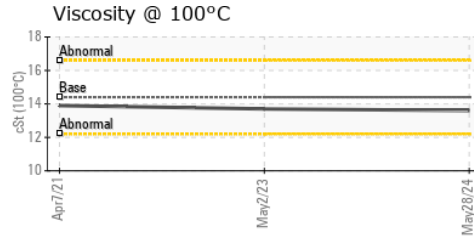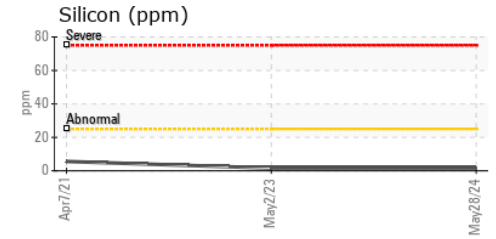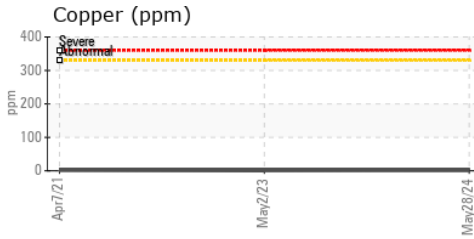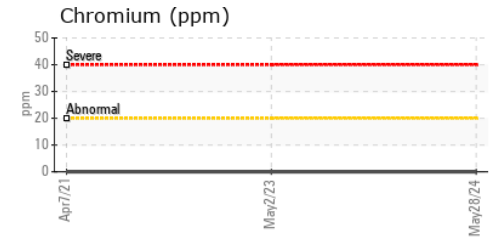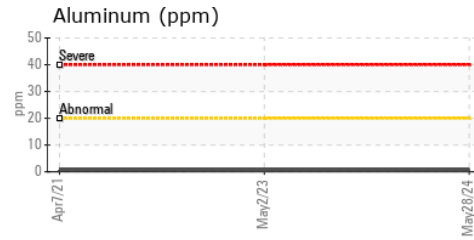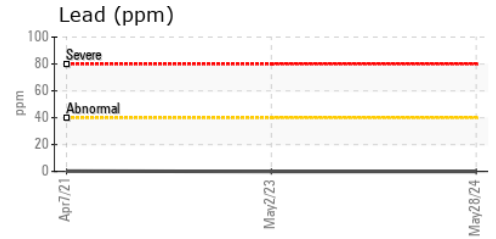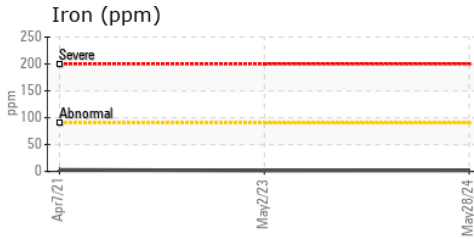

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0918888 **Received** : 19 Jun 2024
Lab Number : **02642822** **Tested** : 19 Jun 2024
Unique Number : 5800361 **Diagnosed** : 19 Jun 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

GENCARE SERVICES LTD.
 360 SOVEREIGN ROAD
 LONDON, ON
 CA N6M 1A8
 Contact: Teresa Matthews
 tmatthews@gencare.com
 T: (519)659-7118
 F: (519)451-1707

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.