OIL ANALYSIS REPORT

Sample Rating Trend

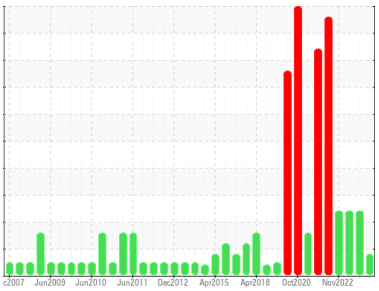

WEAR

Machine Id
PBK G LGBR
Component
Bearing
Fluid
MOBIL DTE OIL HVY MEDIUM (136 LTR)

DIAGNOSIS

▲ Recommendation
We recommend an early resample to monitor this condition.

▲ Wear
Copper ppm levels are abnormal. Bearing wear is indicated.

Contamination
The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0706182**	WC0455736	WC0455717
Sample Date		Client Info		**23 Apr 2024**	01 Feb 2024	24 May 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		**0**	0	0
Iron	ppm	ASTM D5185(m)	>63	**8**	8	8
Chromium	ppm	ASTM D5185(m)	>20	**0**	0	0
Nickel	ppm	ASTM D5185(m)	>20	**<1**	0	<1
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**0**	0	0
Aluminum	ppm	ASTM D5185(m)	>2	**<1**	0	<1
Lead	ppm	ASTM D5185(m)	>161	**10**	11	43
Copper	ppm	ASTM D5185(m)	>13	▲ **18**	▲ 19	▲ 17
Tin	ppm	ASTM D5185(m)	>27	**0**	0	<1
Antimony	ppm	ASTM D5185(m)		**0**	0	<1
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**<1**	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		**<1**	0	<1
Barium	ppm	ASTM D5185(m)		**0**	0	0
Molybdenum	ppm	ASTM D5185(m)		**0**	0	0
Manganese	ppm	ASTM D5185(m)		**0**	0	<1
Magnesium	ppm	ASTM D5185(m)		**<1**	<1	0
Calcium	ppm	ASTM D5185(m)		**<1**	0	0
Phosphorus	ppm	ASTM D5185(m)		**123**	121	139
Zinc	ppm	ASTM D5185(m)		**21**	23	29
Sulfur	ppm	ASTM D5185(m)		**1269**	1248	1365
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>12	**<1**	0	1
Sodium	ppm	ASTM D5185(m)		**0**	0	0
Potassium	ppm	ASTM D5185(m)	>20	**<1**	<1	0
Water	%	ASTM D6304*	>2	**0.022**	---	---
ppm Water	ppm	ASTM D6304*		**220**	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		**0.04**	0.06	0.05

OIL ANALYSIS REPORT

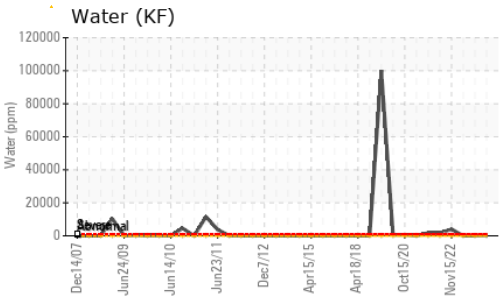

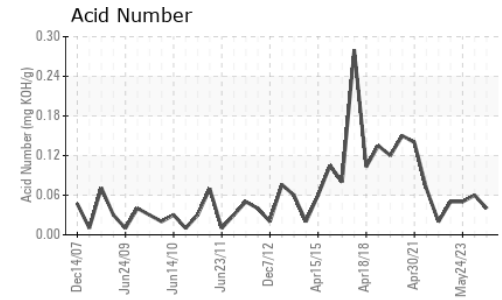

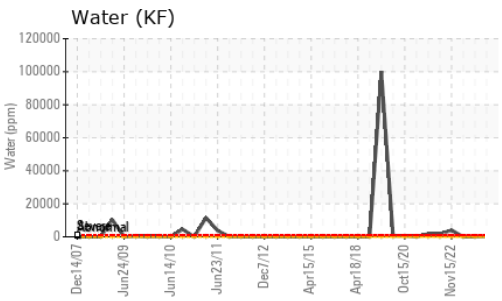

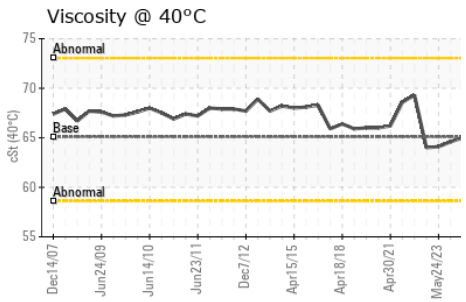

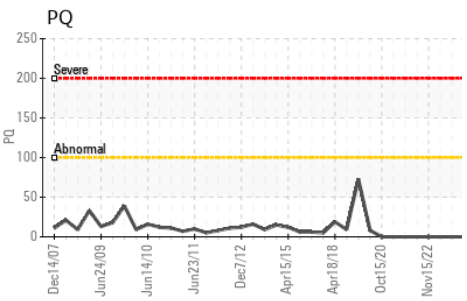

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	VLITE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**WGOIL**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>2	**.5%**	.2%	.2%
Free Water	scalar	Visual*		**NEG**	▲ 1%	▲ 5%

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	65.1	**65.0**	64.6	64.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			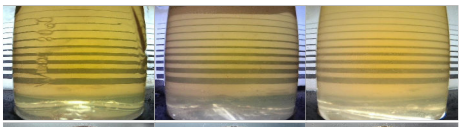		
Bottom					

GRAPHS

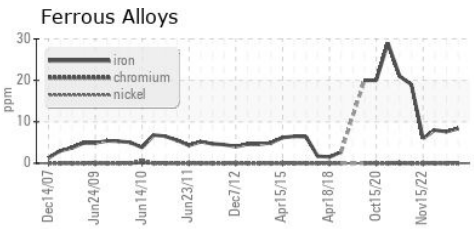

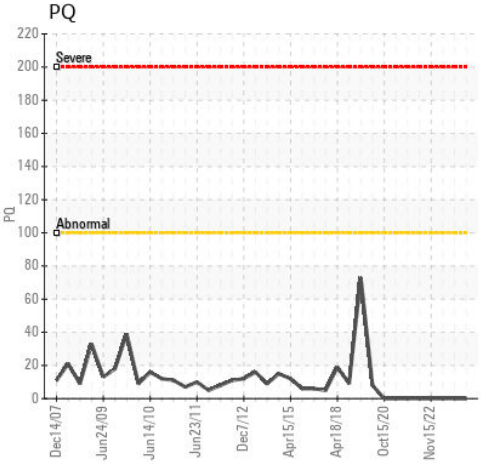

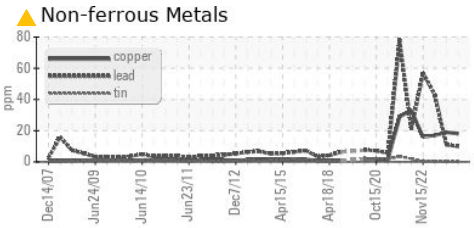

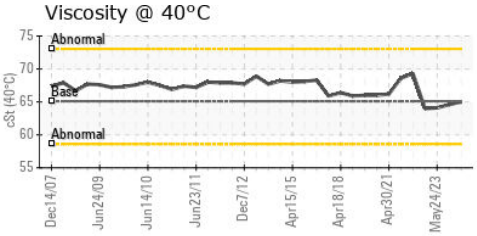

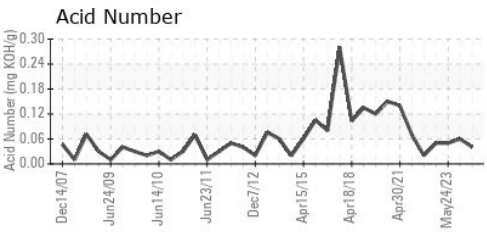

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0706182 **Received** : 19 Jun 2024
Lab Number : 02642910 **Tested** : 21 Jun 2024
Unique Number : 5800449 **Diagnosed** : 21 Jun 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: KF, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

NEWFOUNDLAND POWER INC.
50 DUFFY PLACE, PO BOX 8910
ST. JOHNS, NL
CA A1B 3P6
Contact: Paul Martin
pmartin@newfoundlandpower.com
T:
F: (709)737-2926