




# OIL ANALYSIS REPORT

Sample Rating Trend

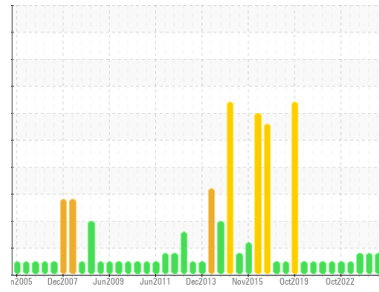

WEAR



Machine Id  
**LBK G3 GEBR**  
 Component  
**Bearing**  
 Fluid  
**ESSO TERESSO ISO 68 (30 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

Copper ppm levels are noted. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0706119</b>	WC0706106	WC0706102
Sample Date	Client Info		<b>29 May 2024</b>	22 Nov 2023	26 Oct 2023
Machine Age	wks	Client Info	<b>0</b>	0	0
Oil Age	wks	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ATTENTION</b>	ATTENTION	ATTENTION

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>2	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m) >63	<b>3</b>	2	2
Chromium	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185(m) >2	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m) >161	<b>4</b>	5	4
Copper	ppm	ASTM D5185(m) >13	<b>19</b>	23	19
Tin	ppm	ASTM D5185(m) >27	<b>3</b>	3	3
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 4.5	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185(m) 0.4	<b>0</b>	<1	<1
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Phosphorus	ppm	ASTM D5185(m) 0.7	<b>26</b>	23	20
Zinc	ppm	ASTM D5185(m) 0	<b>41</b>	40	37
Sulfur	ppm	ASTM D5185(m) 1315	<b>2290</b>	2370	2347
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1





## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >12	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	1	2
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	0

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.02	<b>0.08</b>	0.13	0.09

# OIL ANALYSIS REPORT


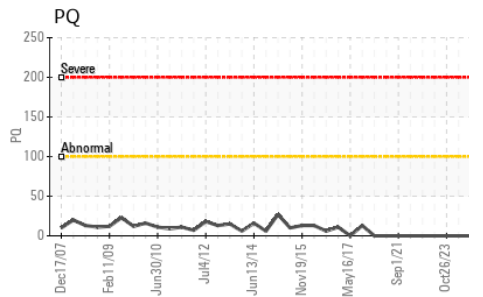
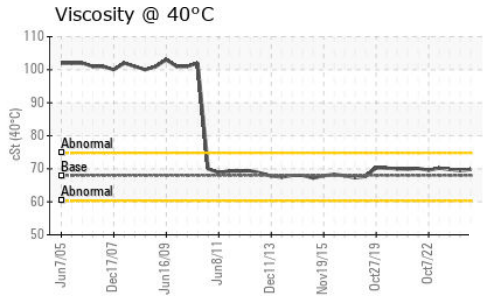
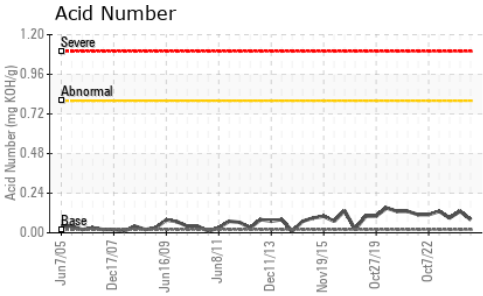
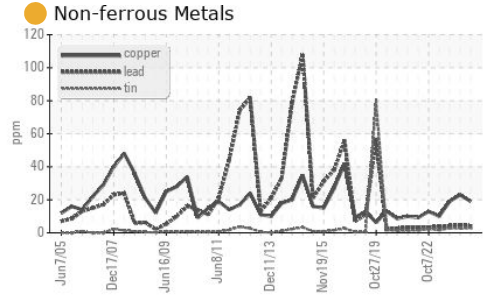


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	69.5	69.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

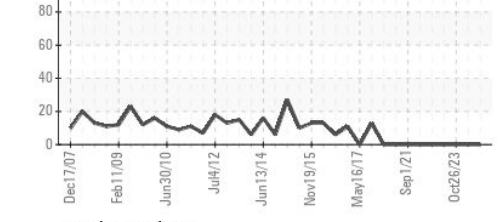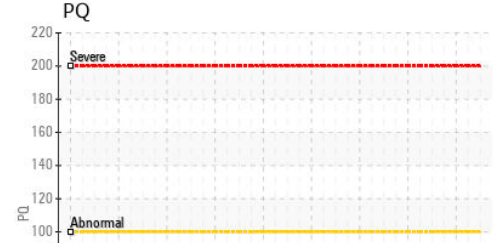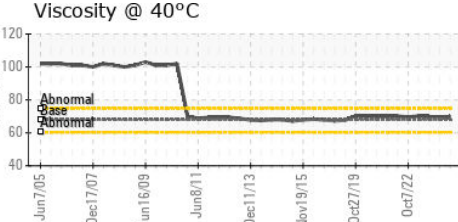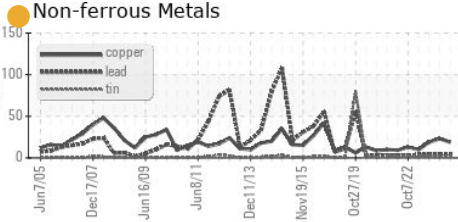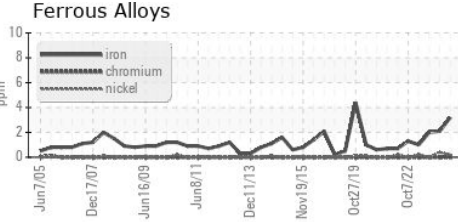

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0706119 **Received** : 19 Jun 2024  
**Lab Number** : 02642929 **Tested** : 20 Jun 2024  
**Unique Number** : 5800468 **Diagnosed** : 20 Jun 2024 - Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: TAN Man )

**NEWFOUNDLAND POWER INC.**  
 50 DUFFY PLACE, PO BOX 8910  
 ST. JOHNS, NL  
 CA A1B 3P6  
 Contact: Paul Martin  
 pmartin@newfoundlandpower.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

T:  
 F: (709)737-2926